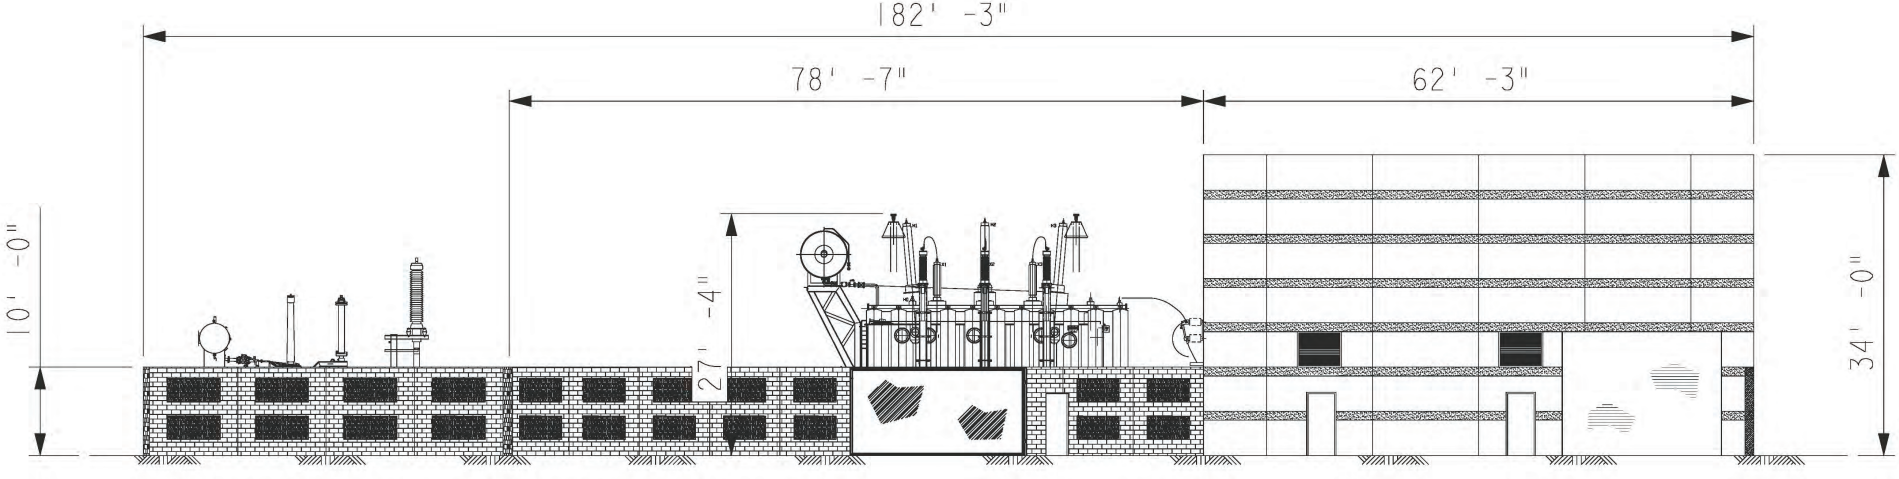

Source: PG&E, 2013b.

Figure 4-15a

Revised Potrero 230 kV Switchyard East Elevation