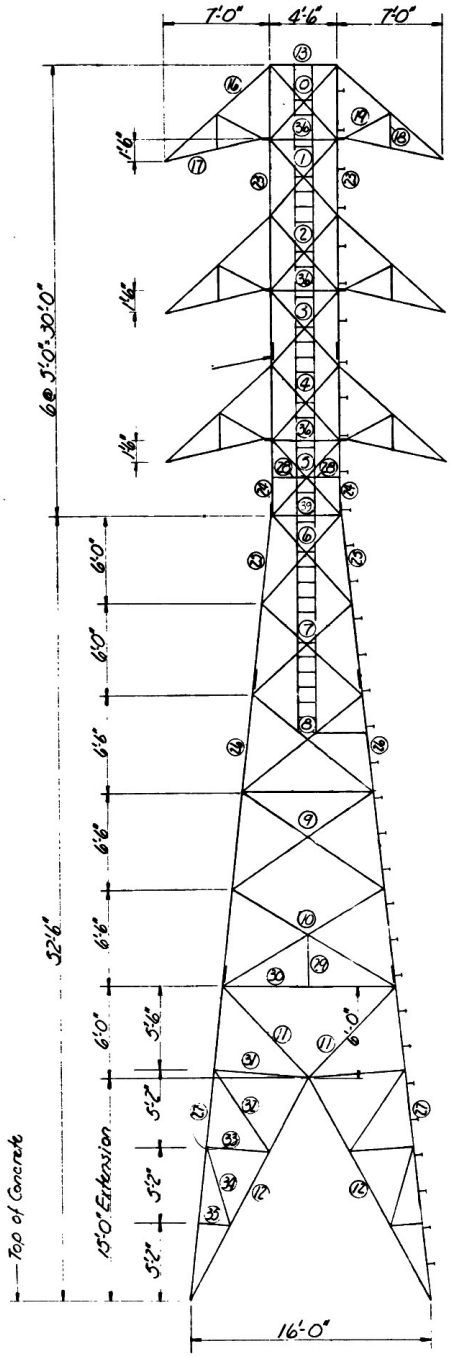

SUSPENSION CONSTRUCTION
TRANSVERSE ELEVATION

Tower 2A/2B

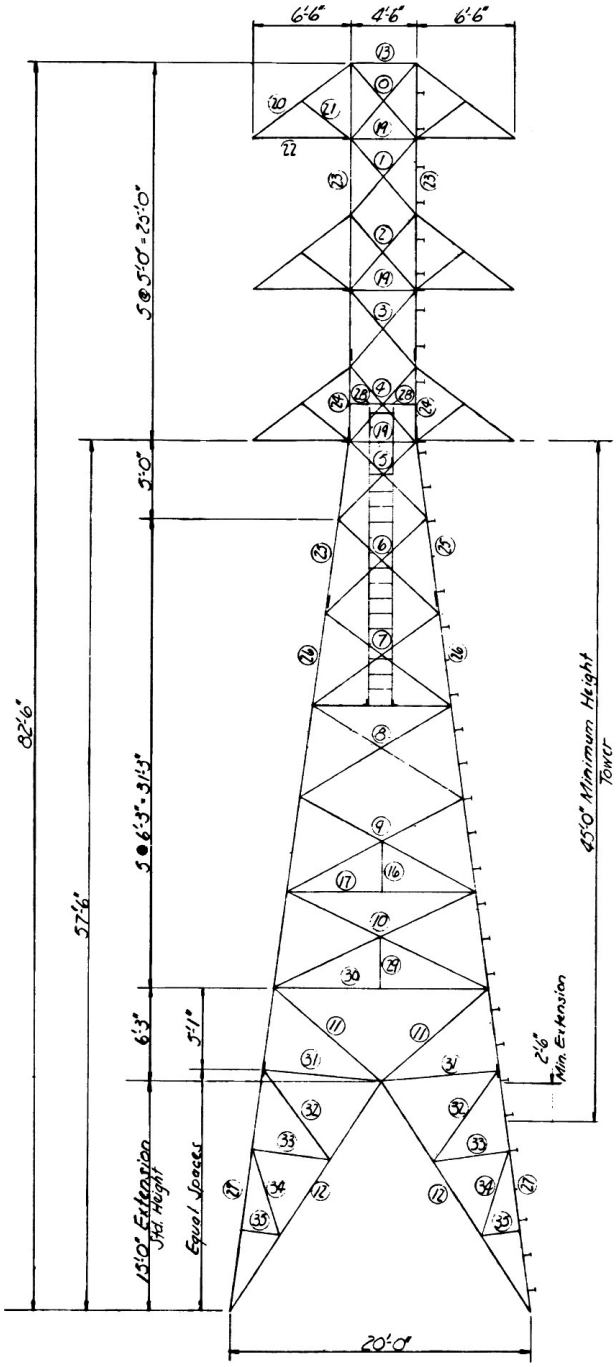

TRANSVERSE ELEVATION
TYPE 2C TOWER

Tower 2C/2D

Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

Source: PG&E 2008.

Graphics ... 00808.07 (10-08) tm

ICF Jones & Stokes
an ICF International Company

Figure 3-20
Typical Towers
Hollister 115 kV Power Line Reconductoring Project