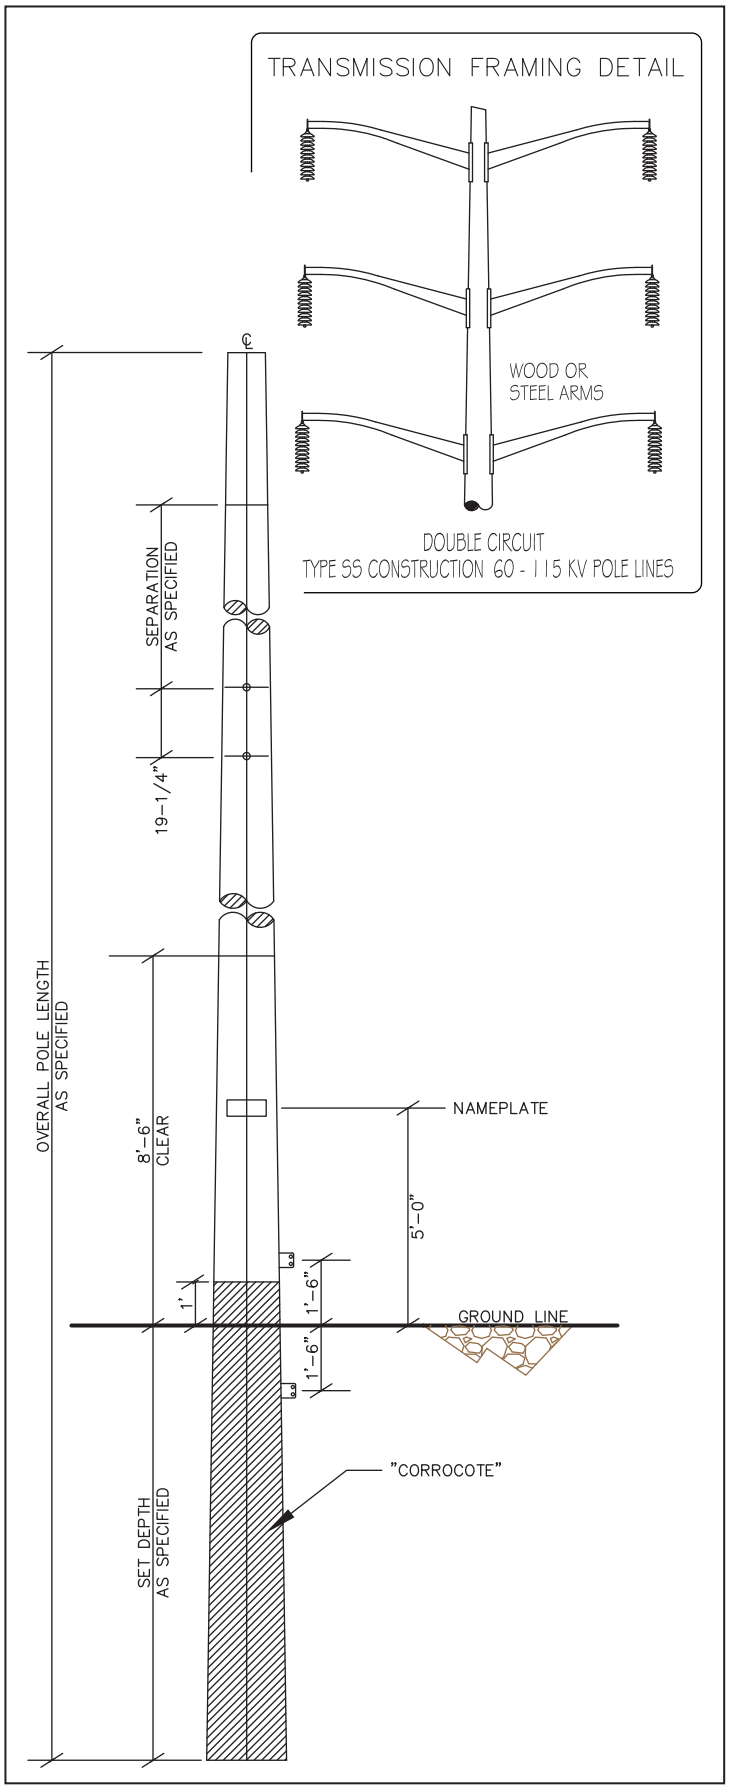

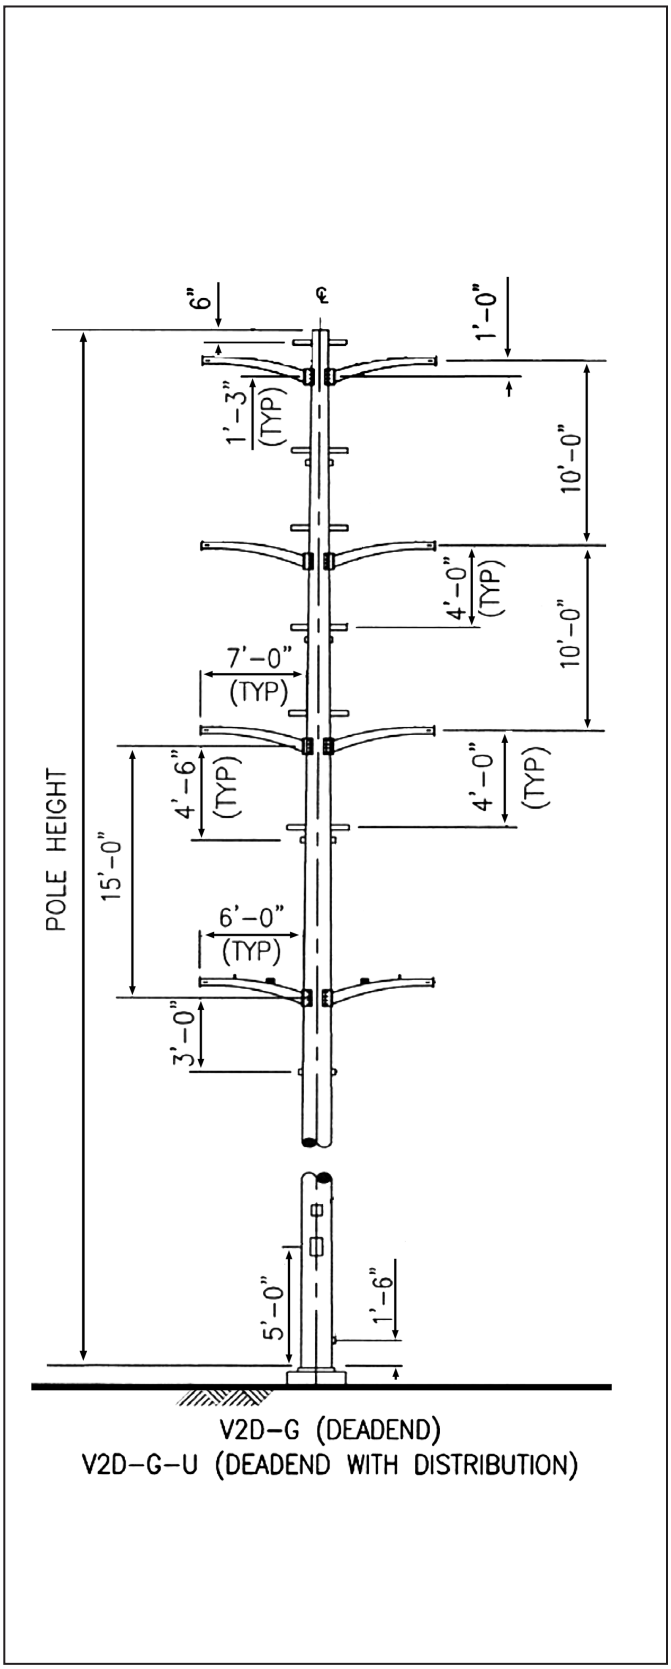

Source: PG&E 2008.

Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

Graphics ... 00808.07 (10-08) tm

ICF Jones & Stokes
an ICF International Company

Figure 3-21
Typical Tubular Steel Poles (TSPs) and Light-Duty Steel (LDS) Poles
Hollister 115 kV Power Line Reconductoring Project