



S:\GIS\PROJECTS\PG&E\00808_07\MAPDOC\PEA\FIGURES\FIGURE_4_5X_CULTURAL_RESOURCES.MXD (08-04-08)

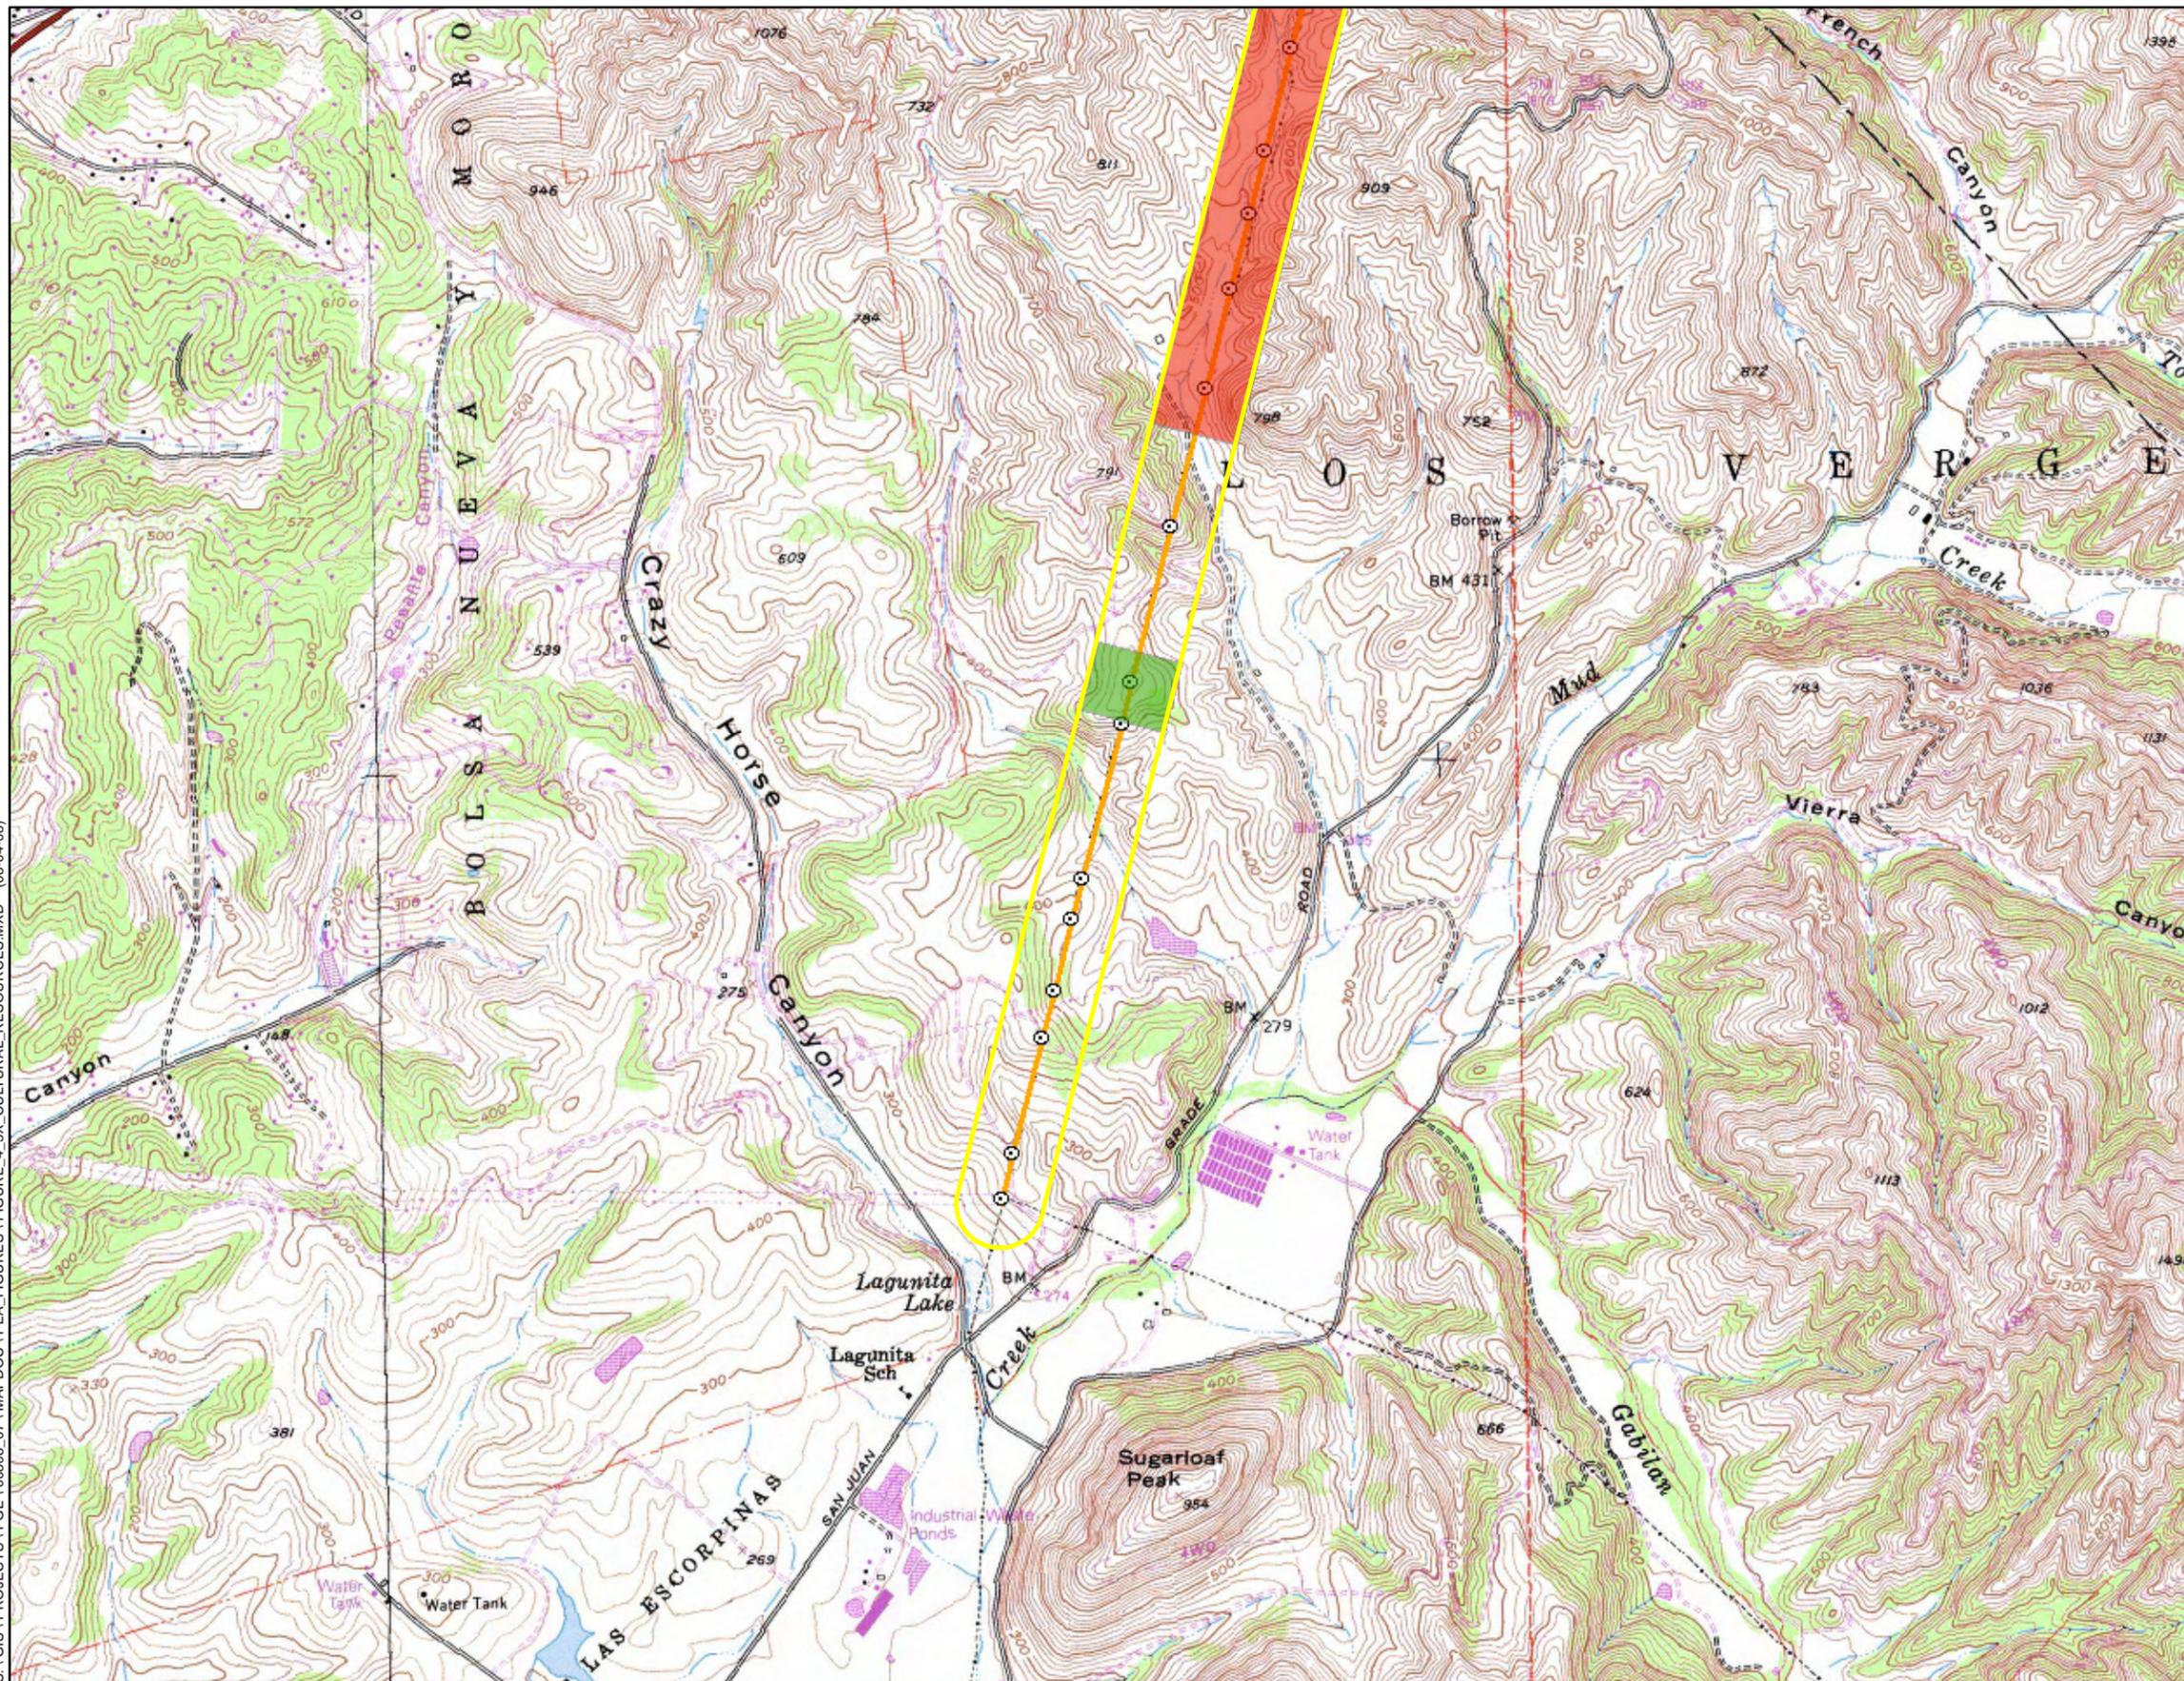

- Hollister Pole Segment
 - Hollister Tower Segment
 - Proposed River Crossing
 - 500-Foot Buffer
 - Tower Location
 - Pole Location
- Cultural Site Potential**
- High Archaeological Sensitivity
 - Moderate Archaeological Sensitivity

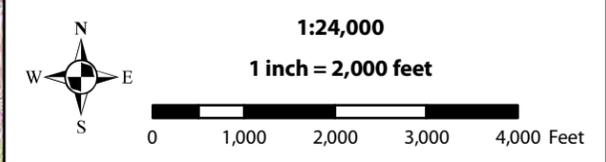


Data Sources: USGS Topographic Map Sheets: Chittenden, Hollister, San Felipe, and San Juan Bautista. Power Line Data from PG&E, 2008



Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

Figure 4.5-1
Cultural Resources Sensitivity (Sheet 1)
Hollister 115 kV Power Line Reconductoring Project

S:\GIS\PROJECTS\PG&E\00808_07\MAPDOC\PEA\FIGURES\FIGURE_4_5X_CULTURAL_RESOURCES.MXD (08-04-08)

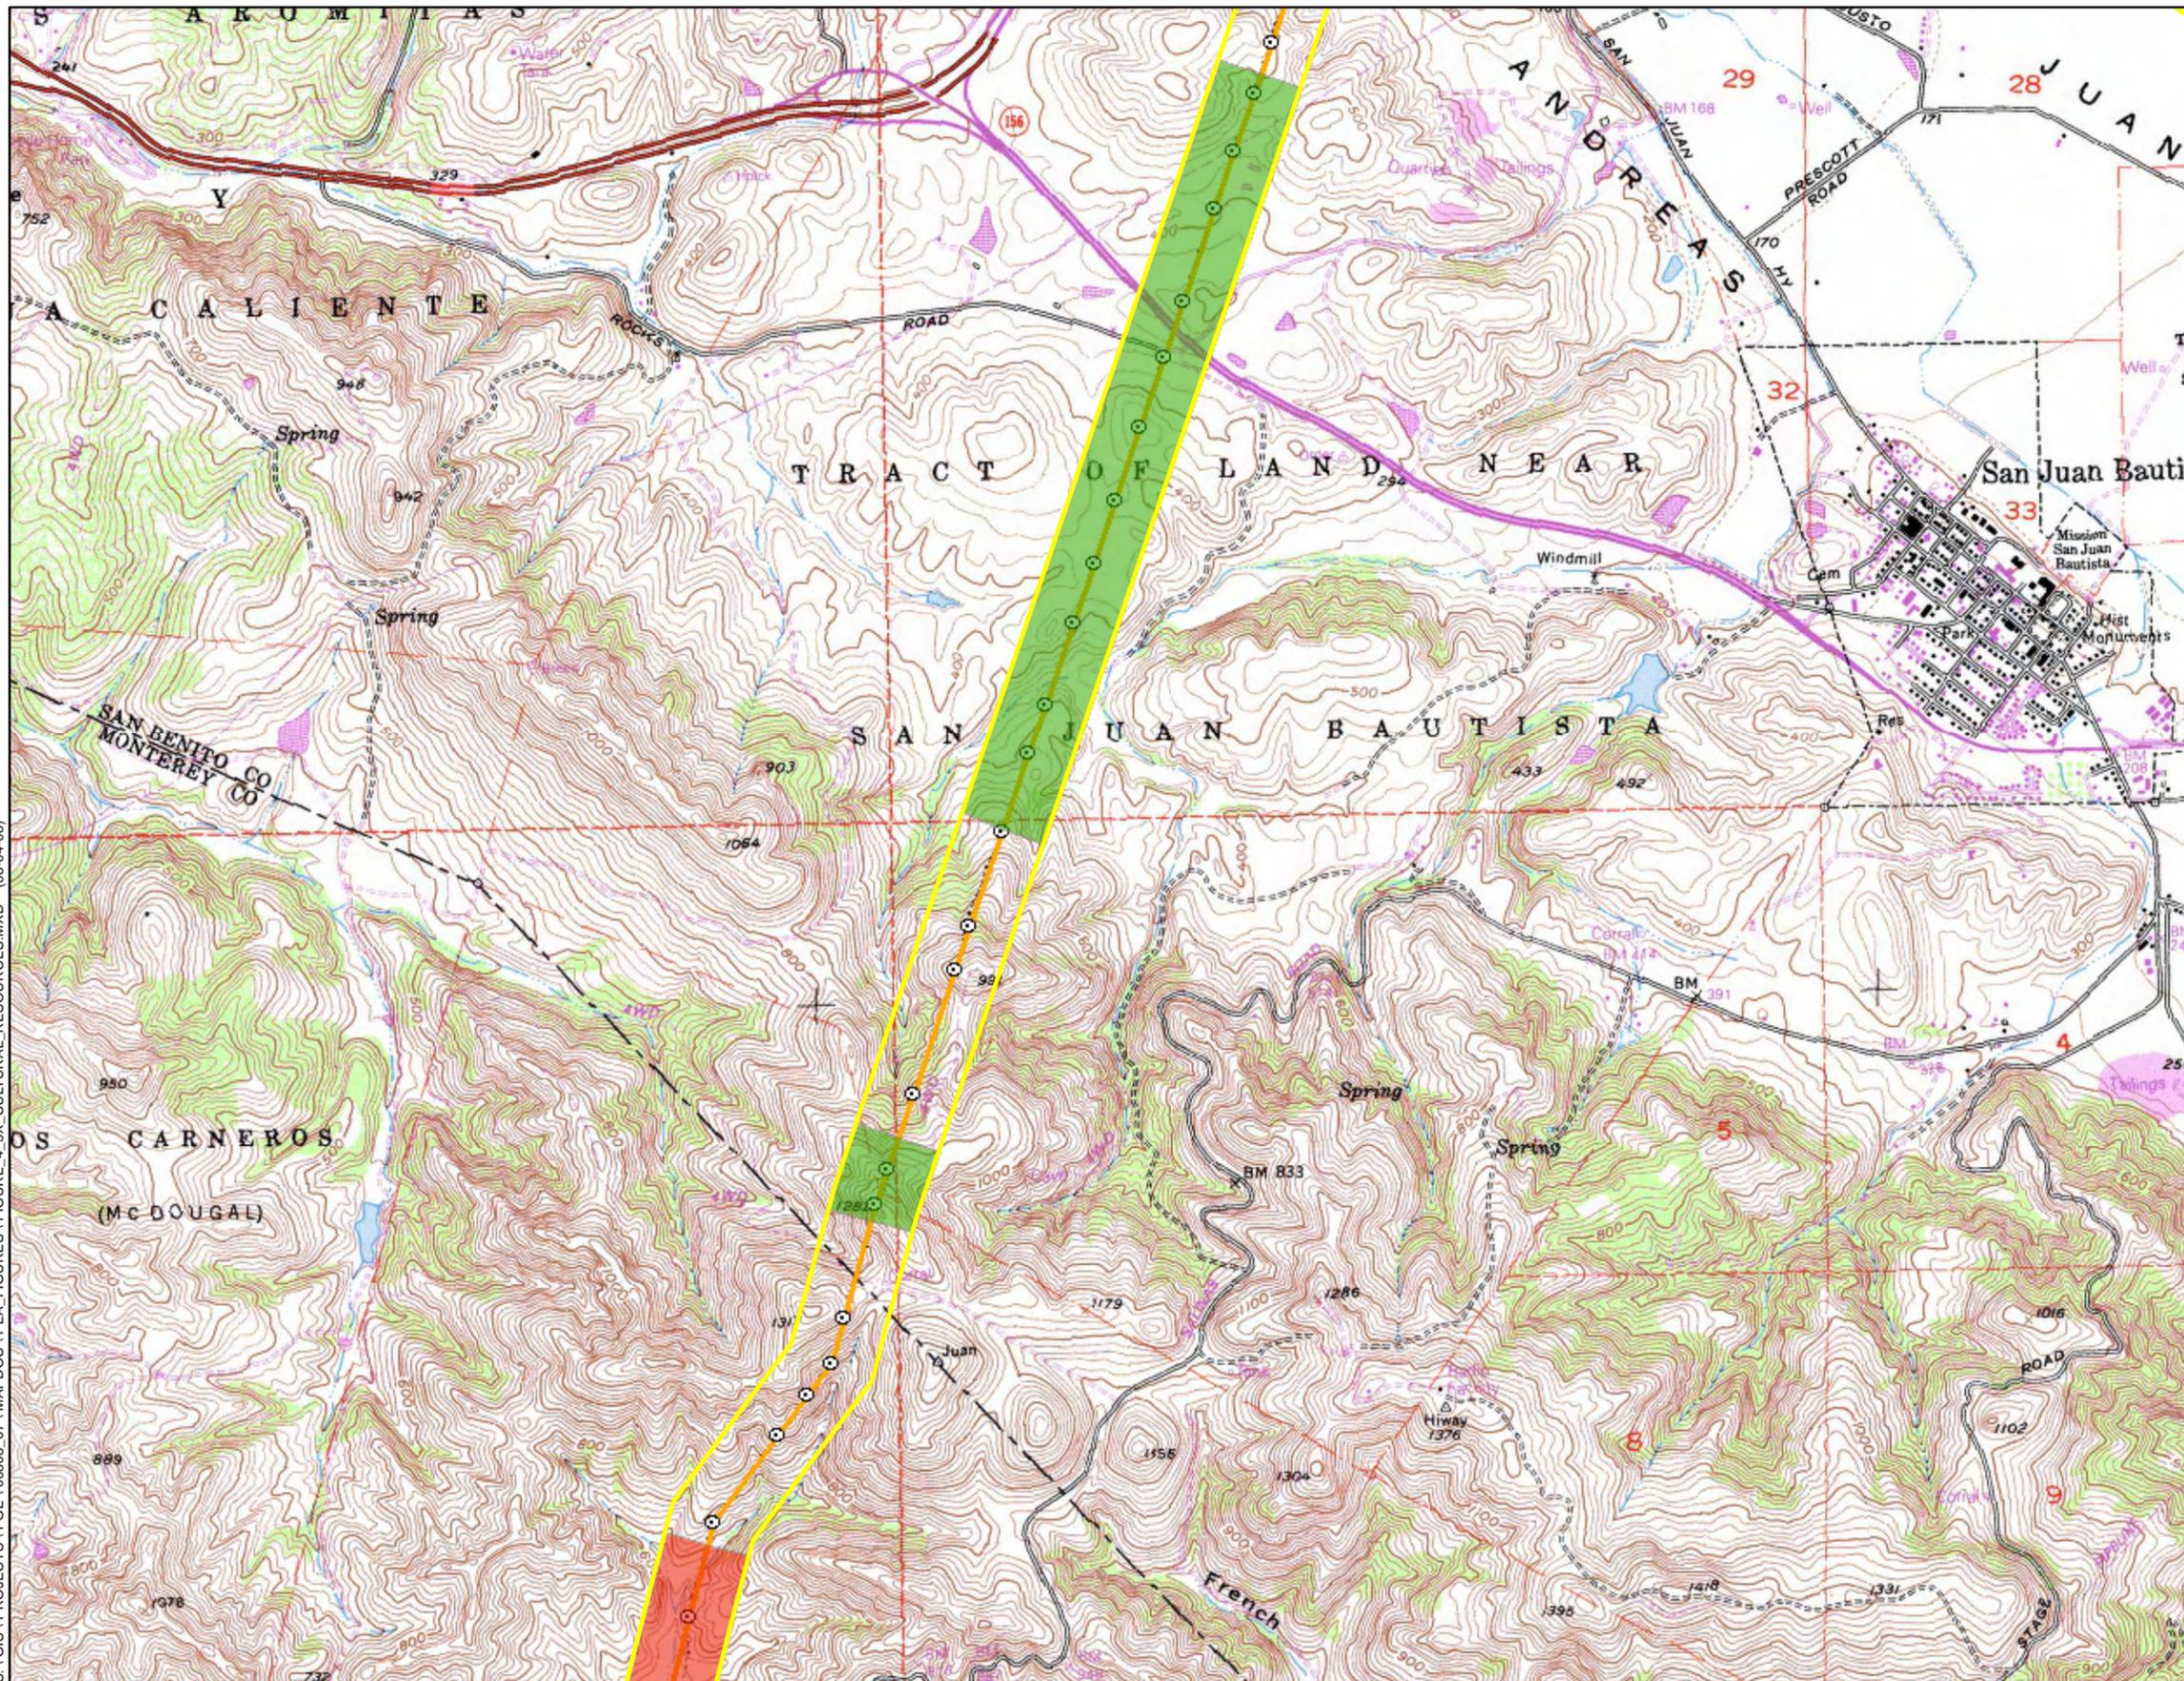

- Hollister Pole Segment
 - Hollister Tower Segment
 - Proposed River Crossing
 - 500-Foot Buffer
 - Tower Location
 - Pole Location
- Cultural Site Potential**
- High Archaeological Sensitivity
 - Moderate Archaeological Sensitivity

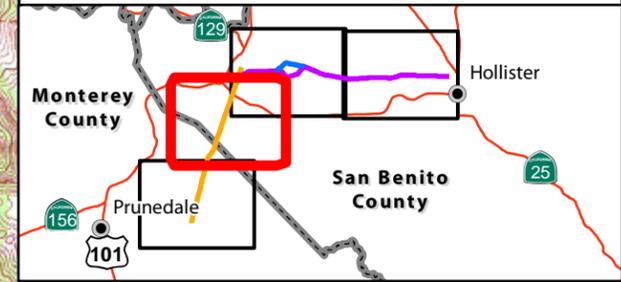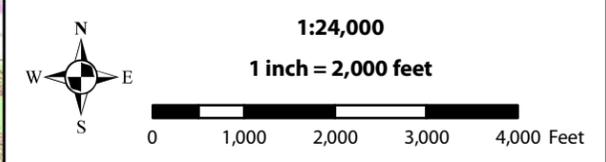


Data Sources: USGS Topographic Map Sheets: Chittenden, Hollister, San Felipe, and San Juan Bautista. Power Line Data from PG&E, 2008



Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

Figure 4.5-2
Cultural Resources Sensitivity (Sheet 2)
Hollister 115 kV Power Line Reconductoring Project

S:\GIS\PROJECTS\PEA\00808_07\MAPDOC\FIGURES\FIGURE_4_5X_CULTURAL_RESOURCES.MXD (08-04-08)

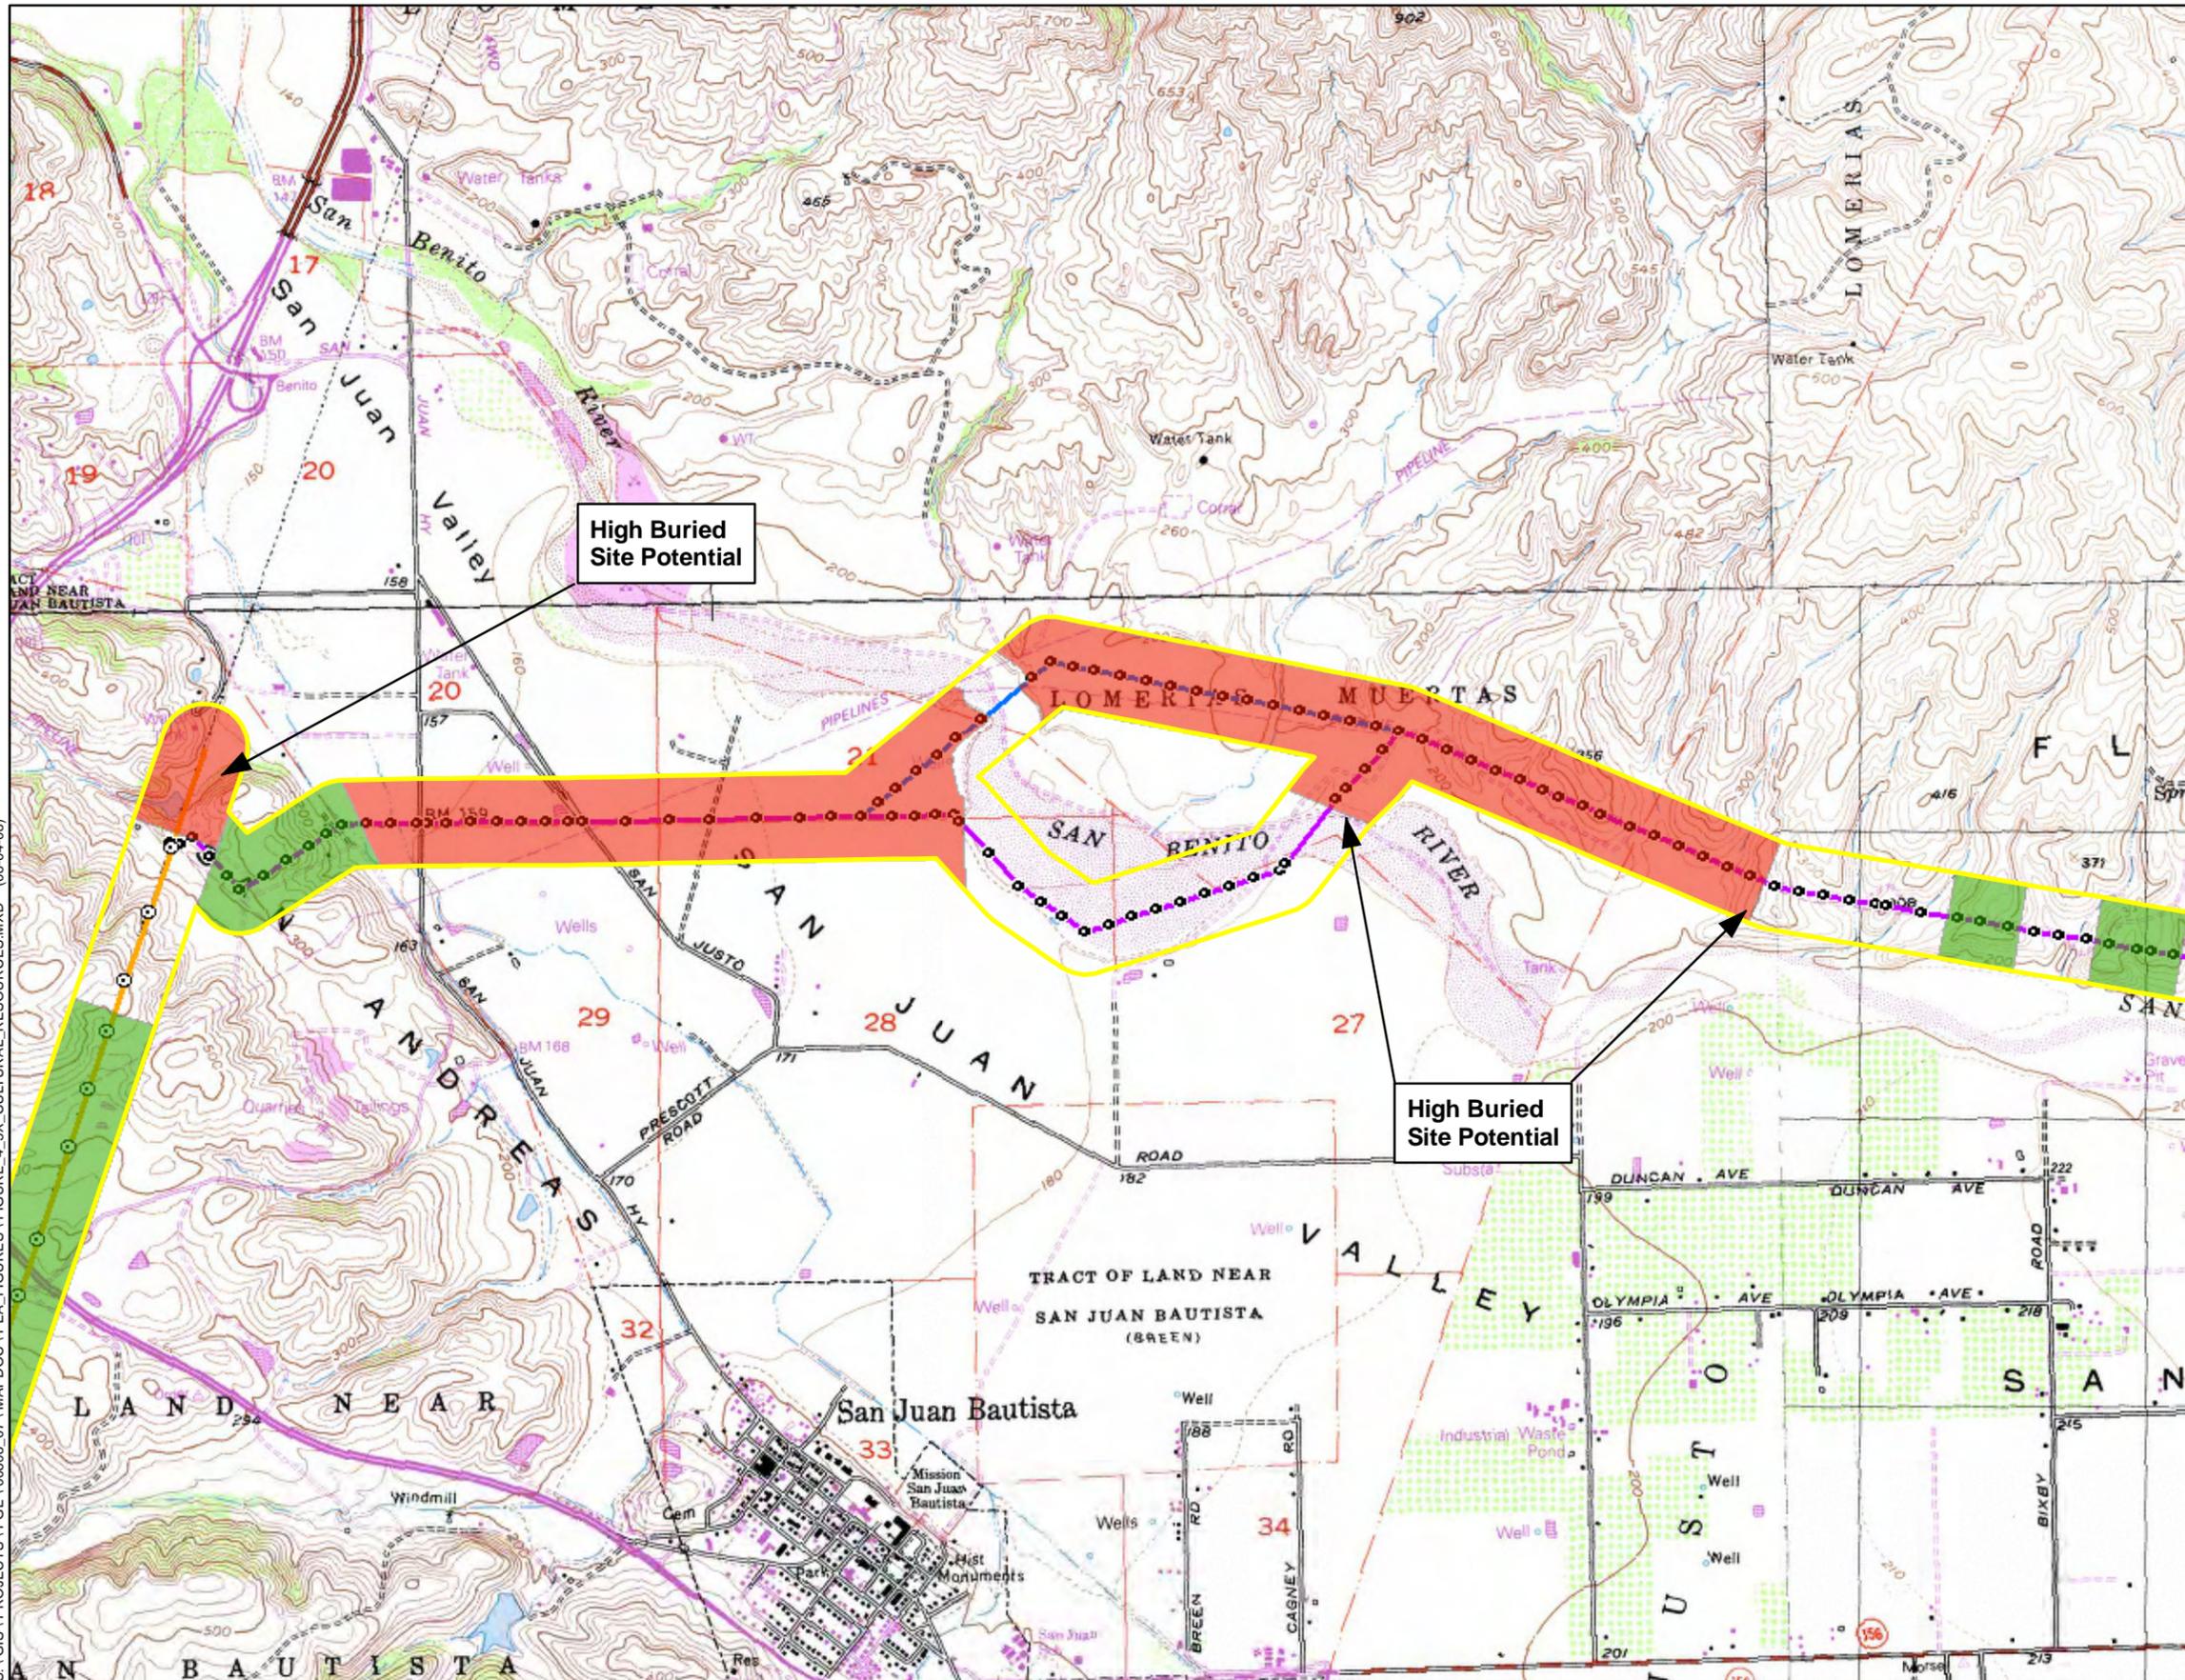


- Hollister Pole Segment
 - Hollister Tower Segment
 - Proposed River Crossing
 - 500-Foot Buffer
 - Tower Location
 - Pole Location
- Cultural Site Potential**
- High Archaeological Sensitivity
 - Moderate Archaeological Sensitivity

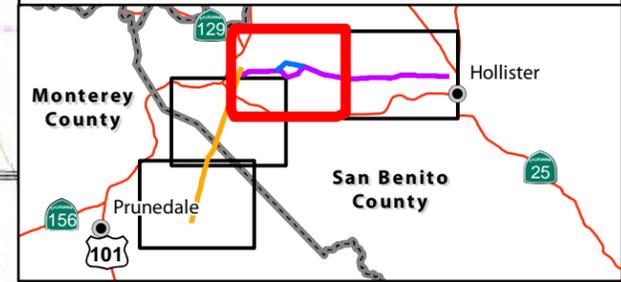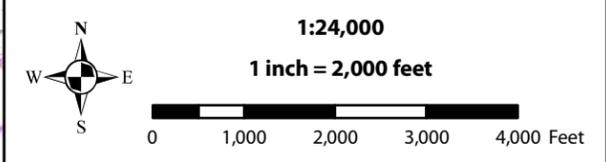

Data Sources: USGS Topographic Map Sheets: Chittenden, Hollister, San Felipe, and San Juan Bautista. Power Line Data from PG&E, 2008

Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

Figure 4.5-3
Cultural Resources Sensitivity (Sheet 3)
Hollister 115 kV Power Line Reconductoring Project

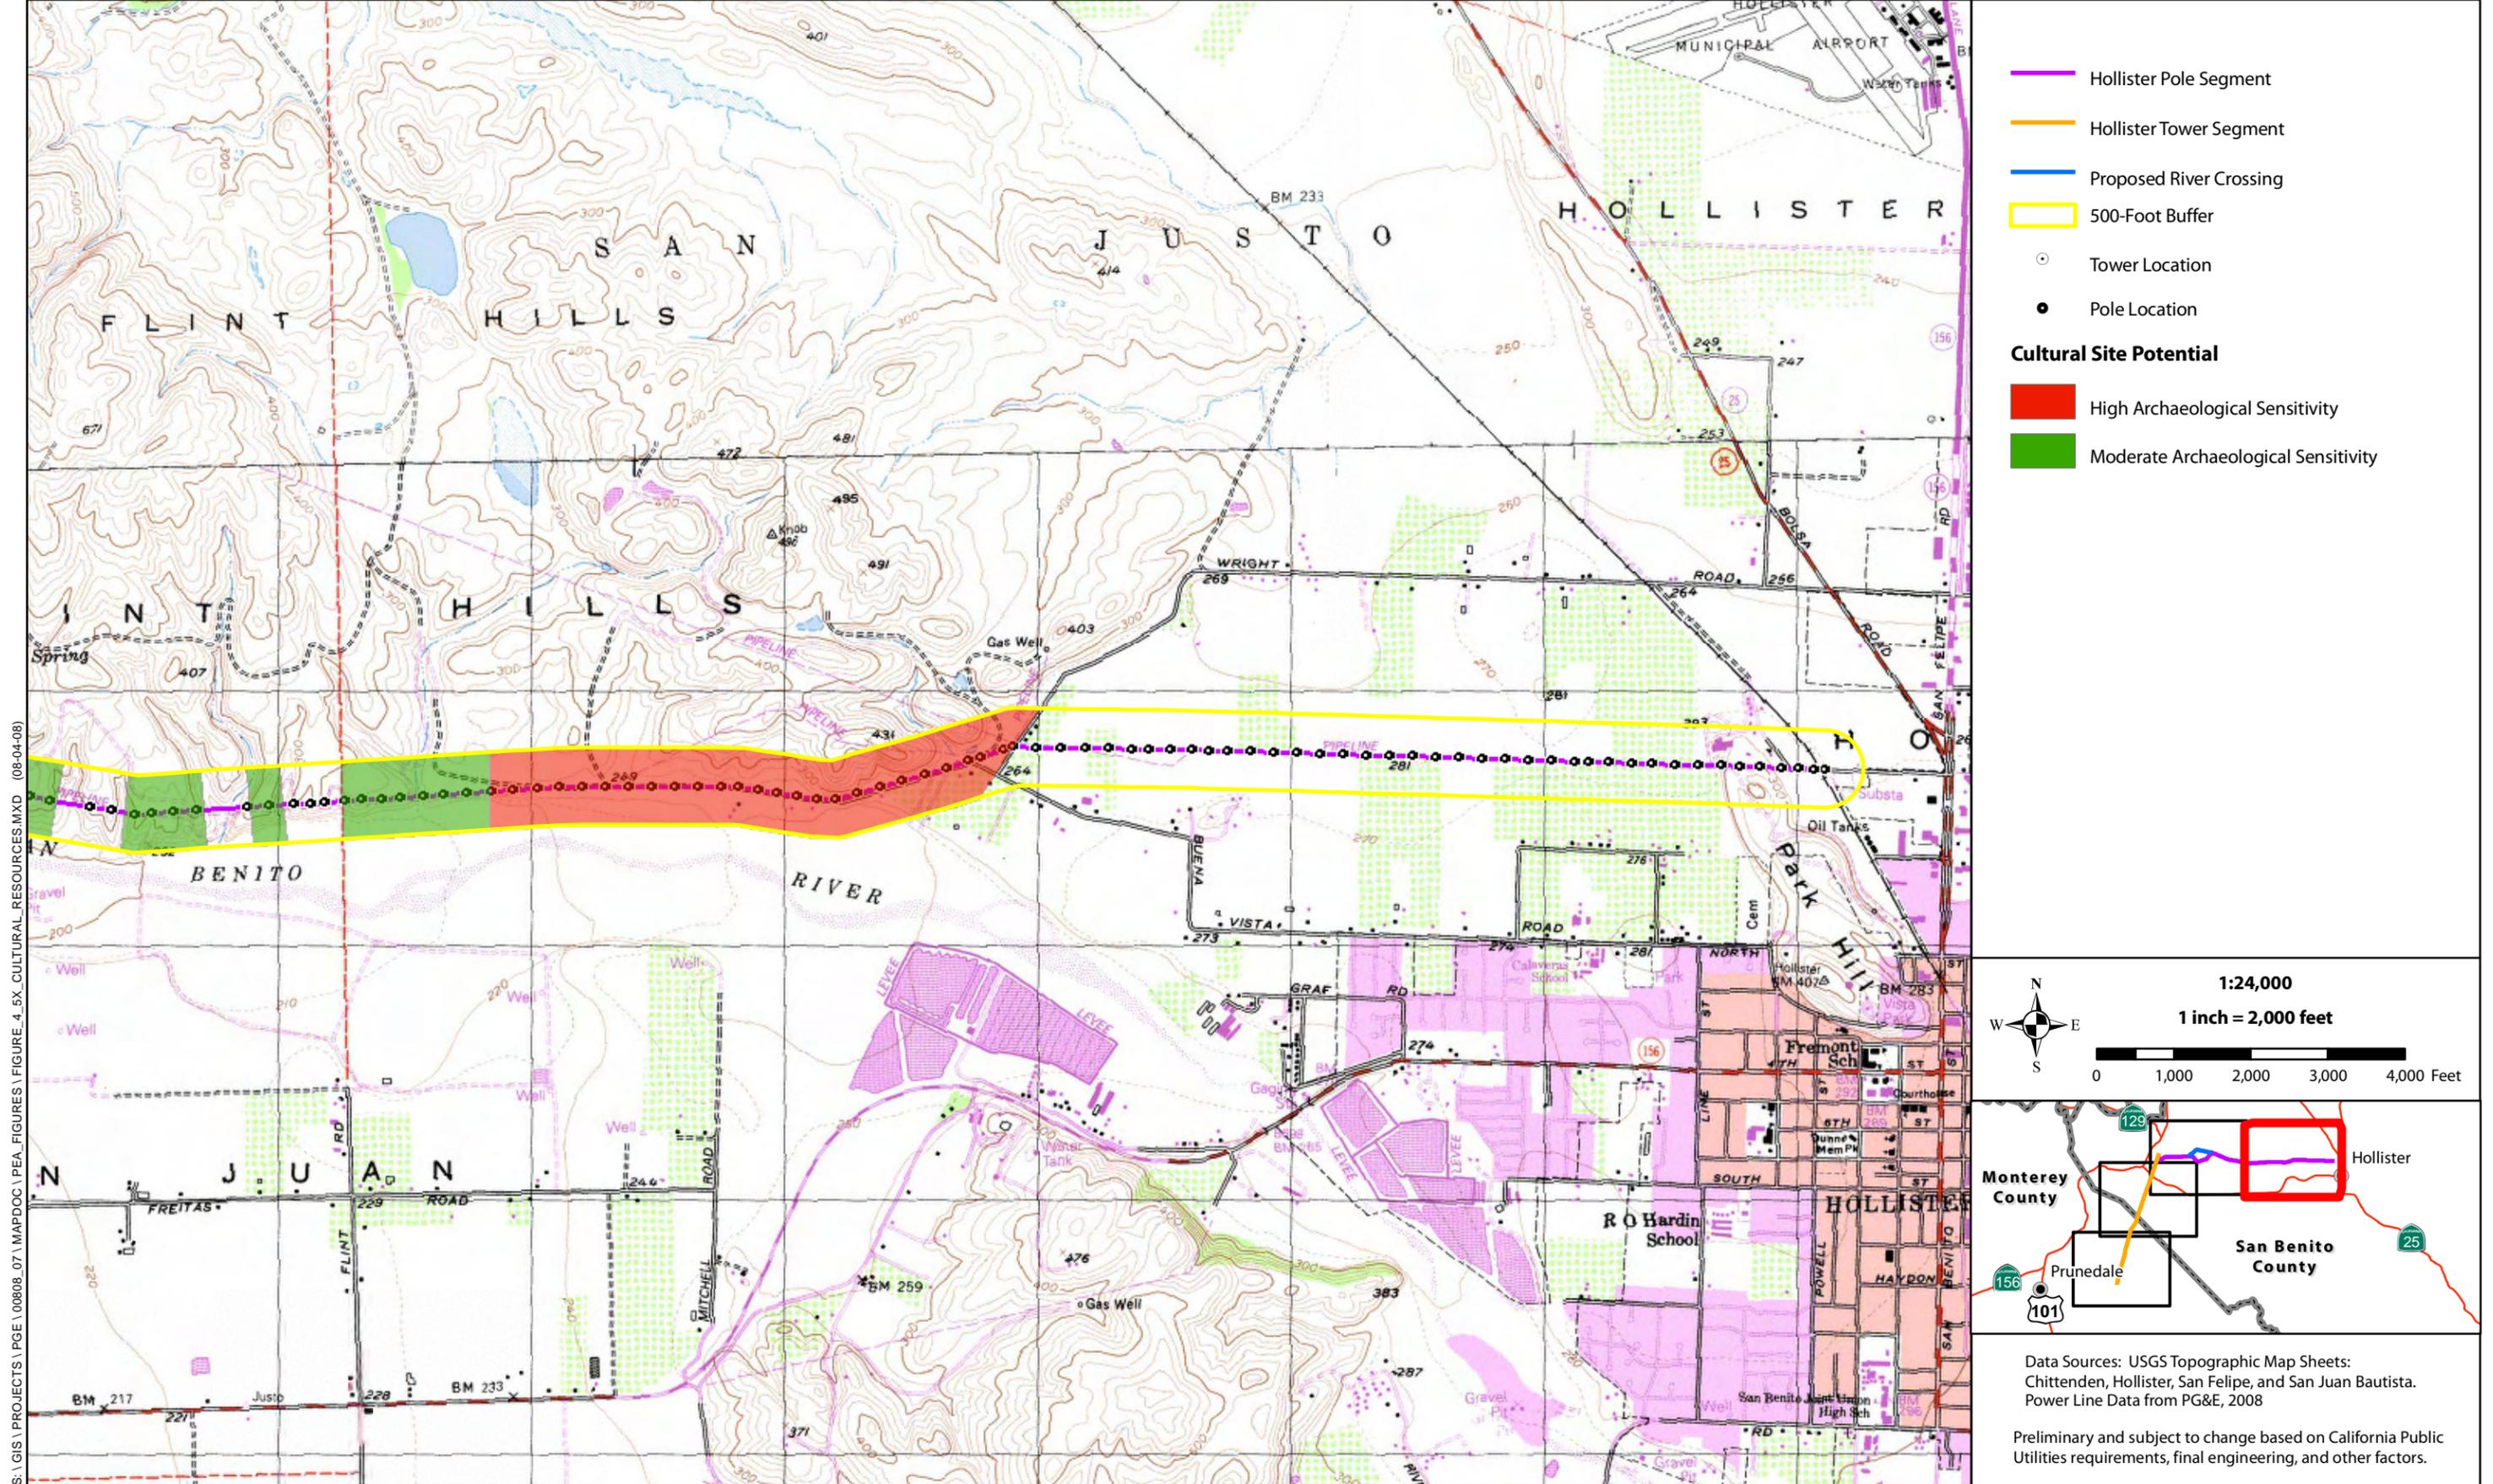

S:\GIS\PROJECTS\PG&E\00808_07\MAPDOC\PEA\FIGURES\FIGURE_4_5X_CULTURAL_RESOURCES.MXD (08-04-08)

Figure 4.5-4
Cultural Resources Sensitivity (Sheet 4)
Hollister 15 kV Power Line Reconductoring Project