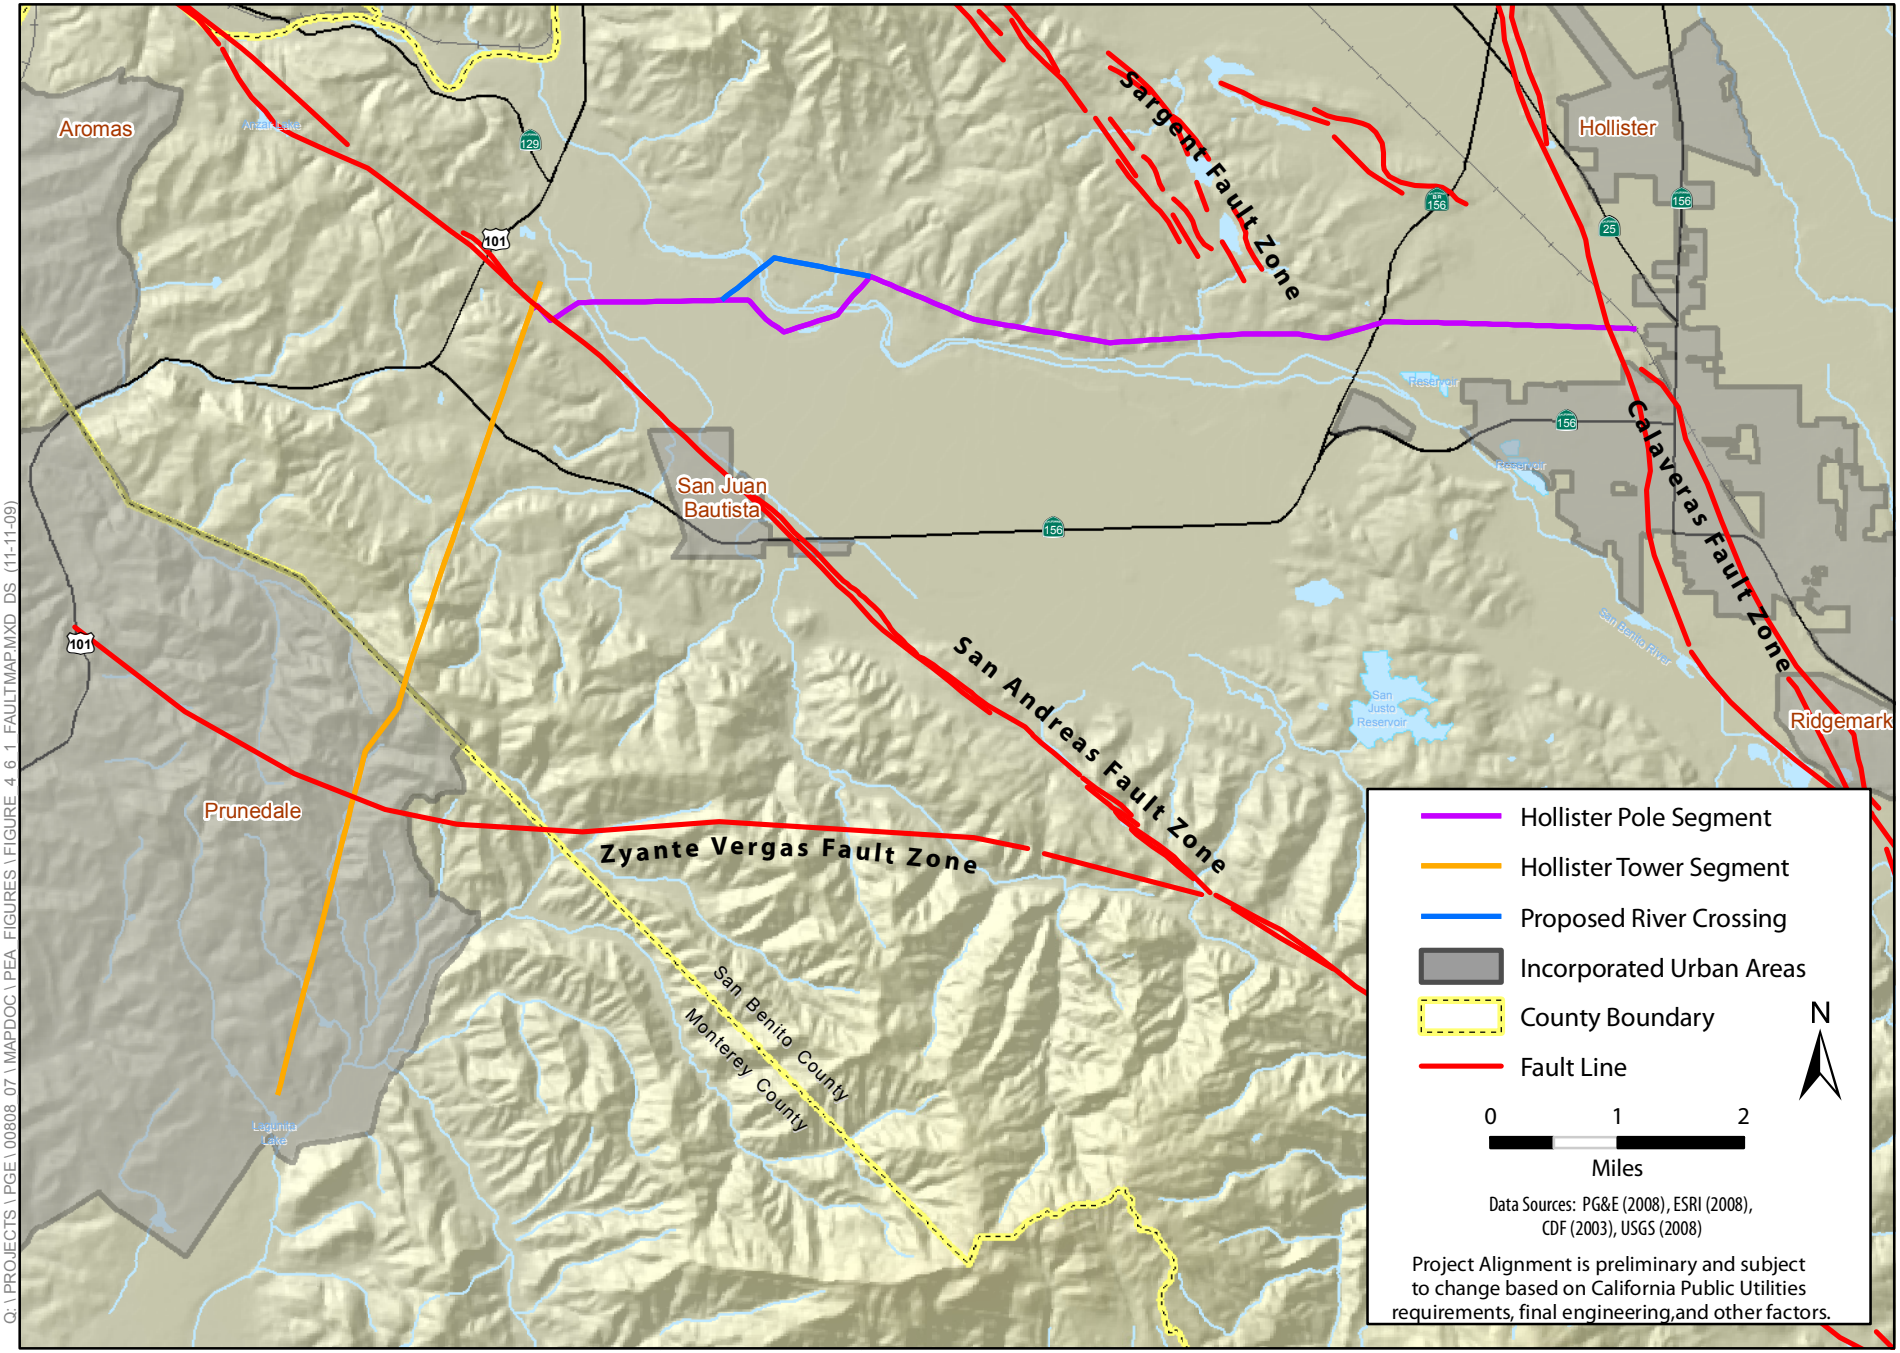

Q:\PROJECTS\PGE\00808_07\MAPDOC\PEA_FIGURES\FIGURE_4_6_1_FAULTMAP.MXD DS (11-11-09)

ICF Jones & Stokes
an ICF International Company

Figure 4.6-1
Principal Faults in Project Vicinity
Hollister 115 kV Power Line Reconductoring Project