

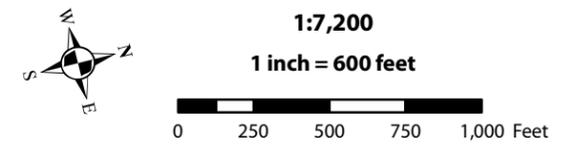


- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

S:\GIS\Projects\PEA\00808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

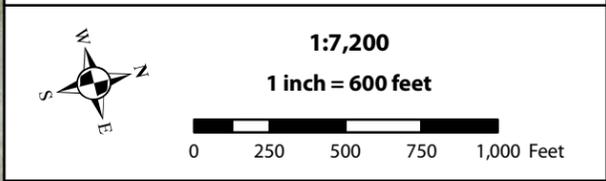

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

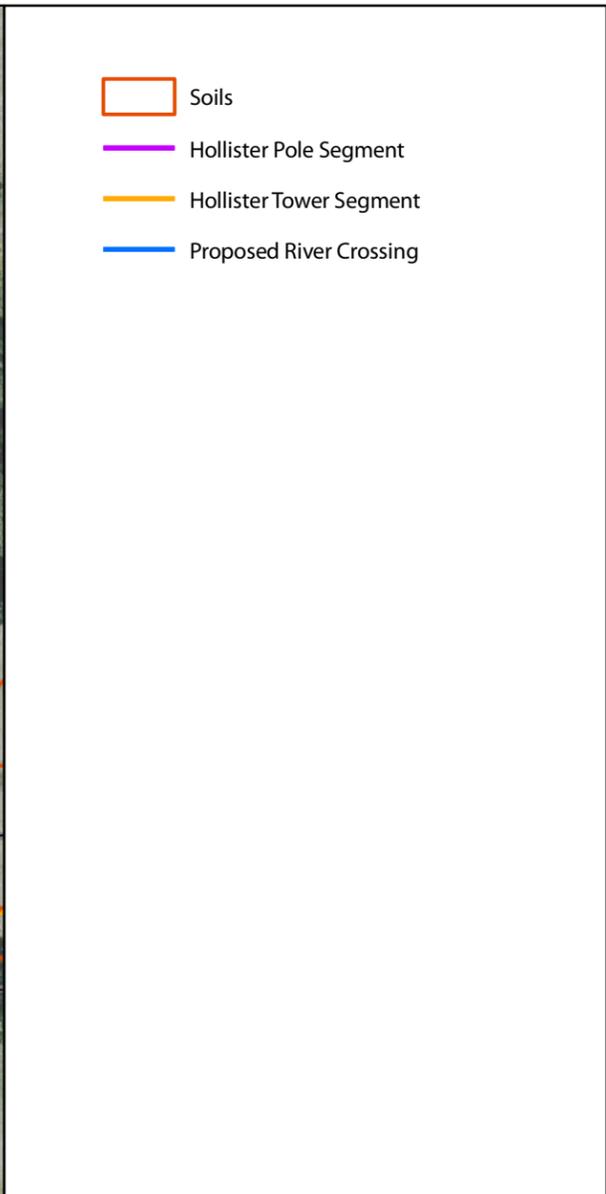


Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.


S:\GIS\Projects\PEA\00808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)



Figure 4.6-3
Soils (Sheet 2)
 Hollister 115 kV Power Line Reconductoring Project

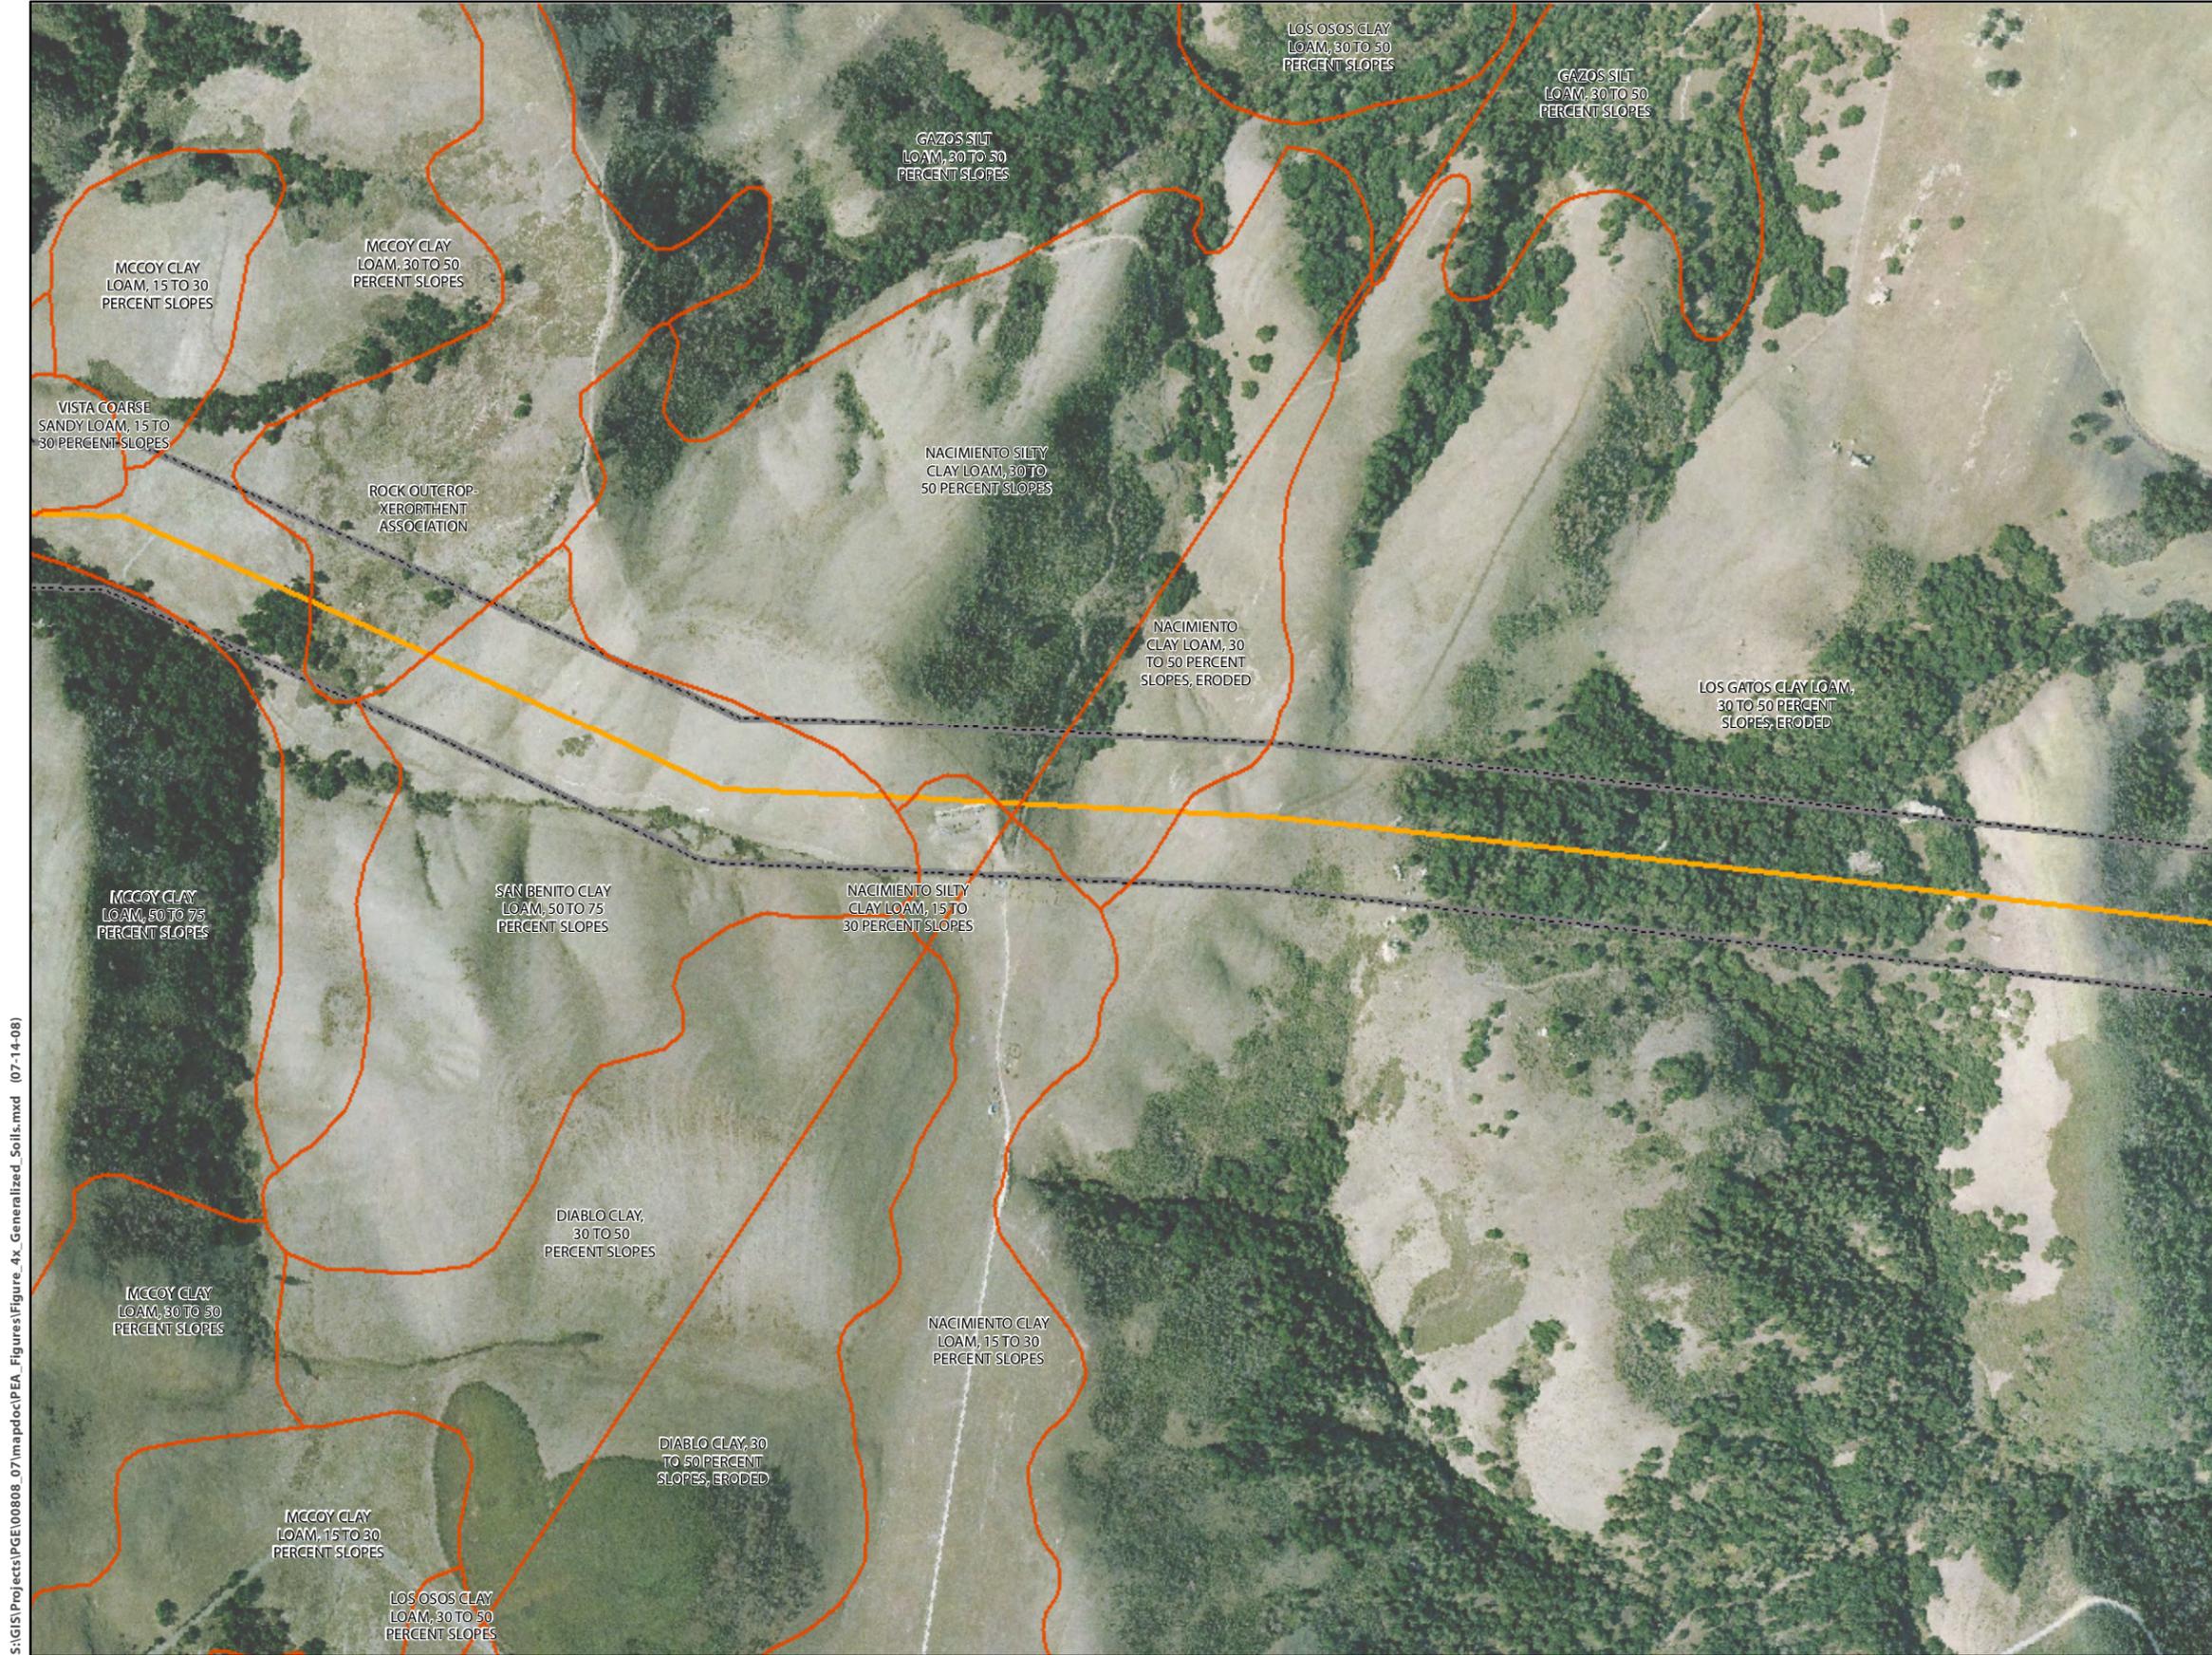

- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

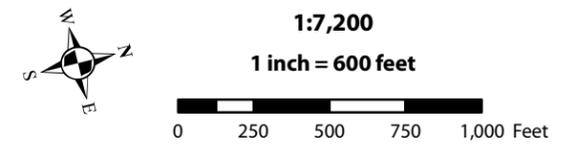

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

S:\GIS\Projects\PEA\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

Figure 4.6-4
Soils (Sheet 3)
 Hollister 115 kV Power Line Reconductoring Project



- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing




1:7,200

1 inch = 600 feet

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.


S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

Figure 4.6-6
Soils (Sheet 5)
Hollister 115 kV Power Line Reconductoring Project

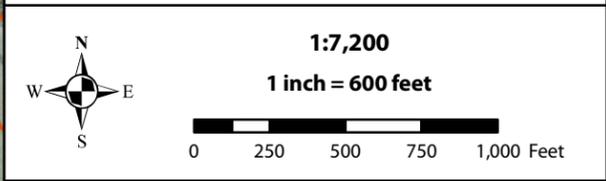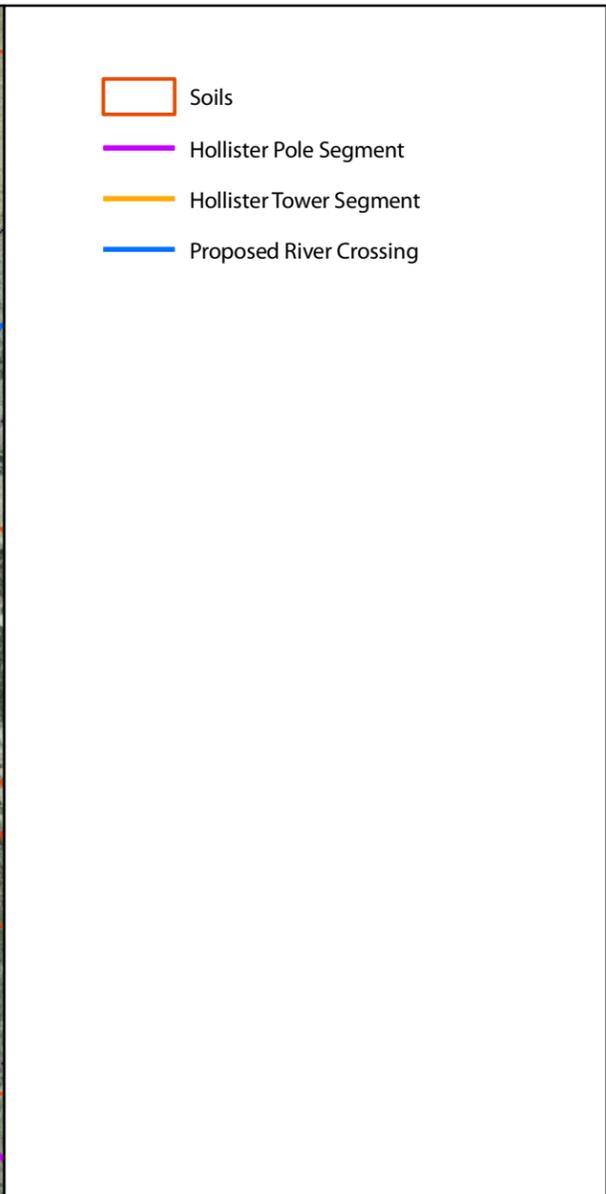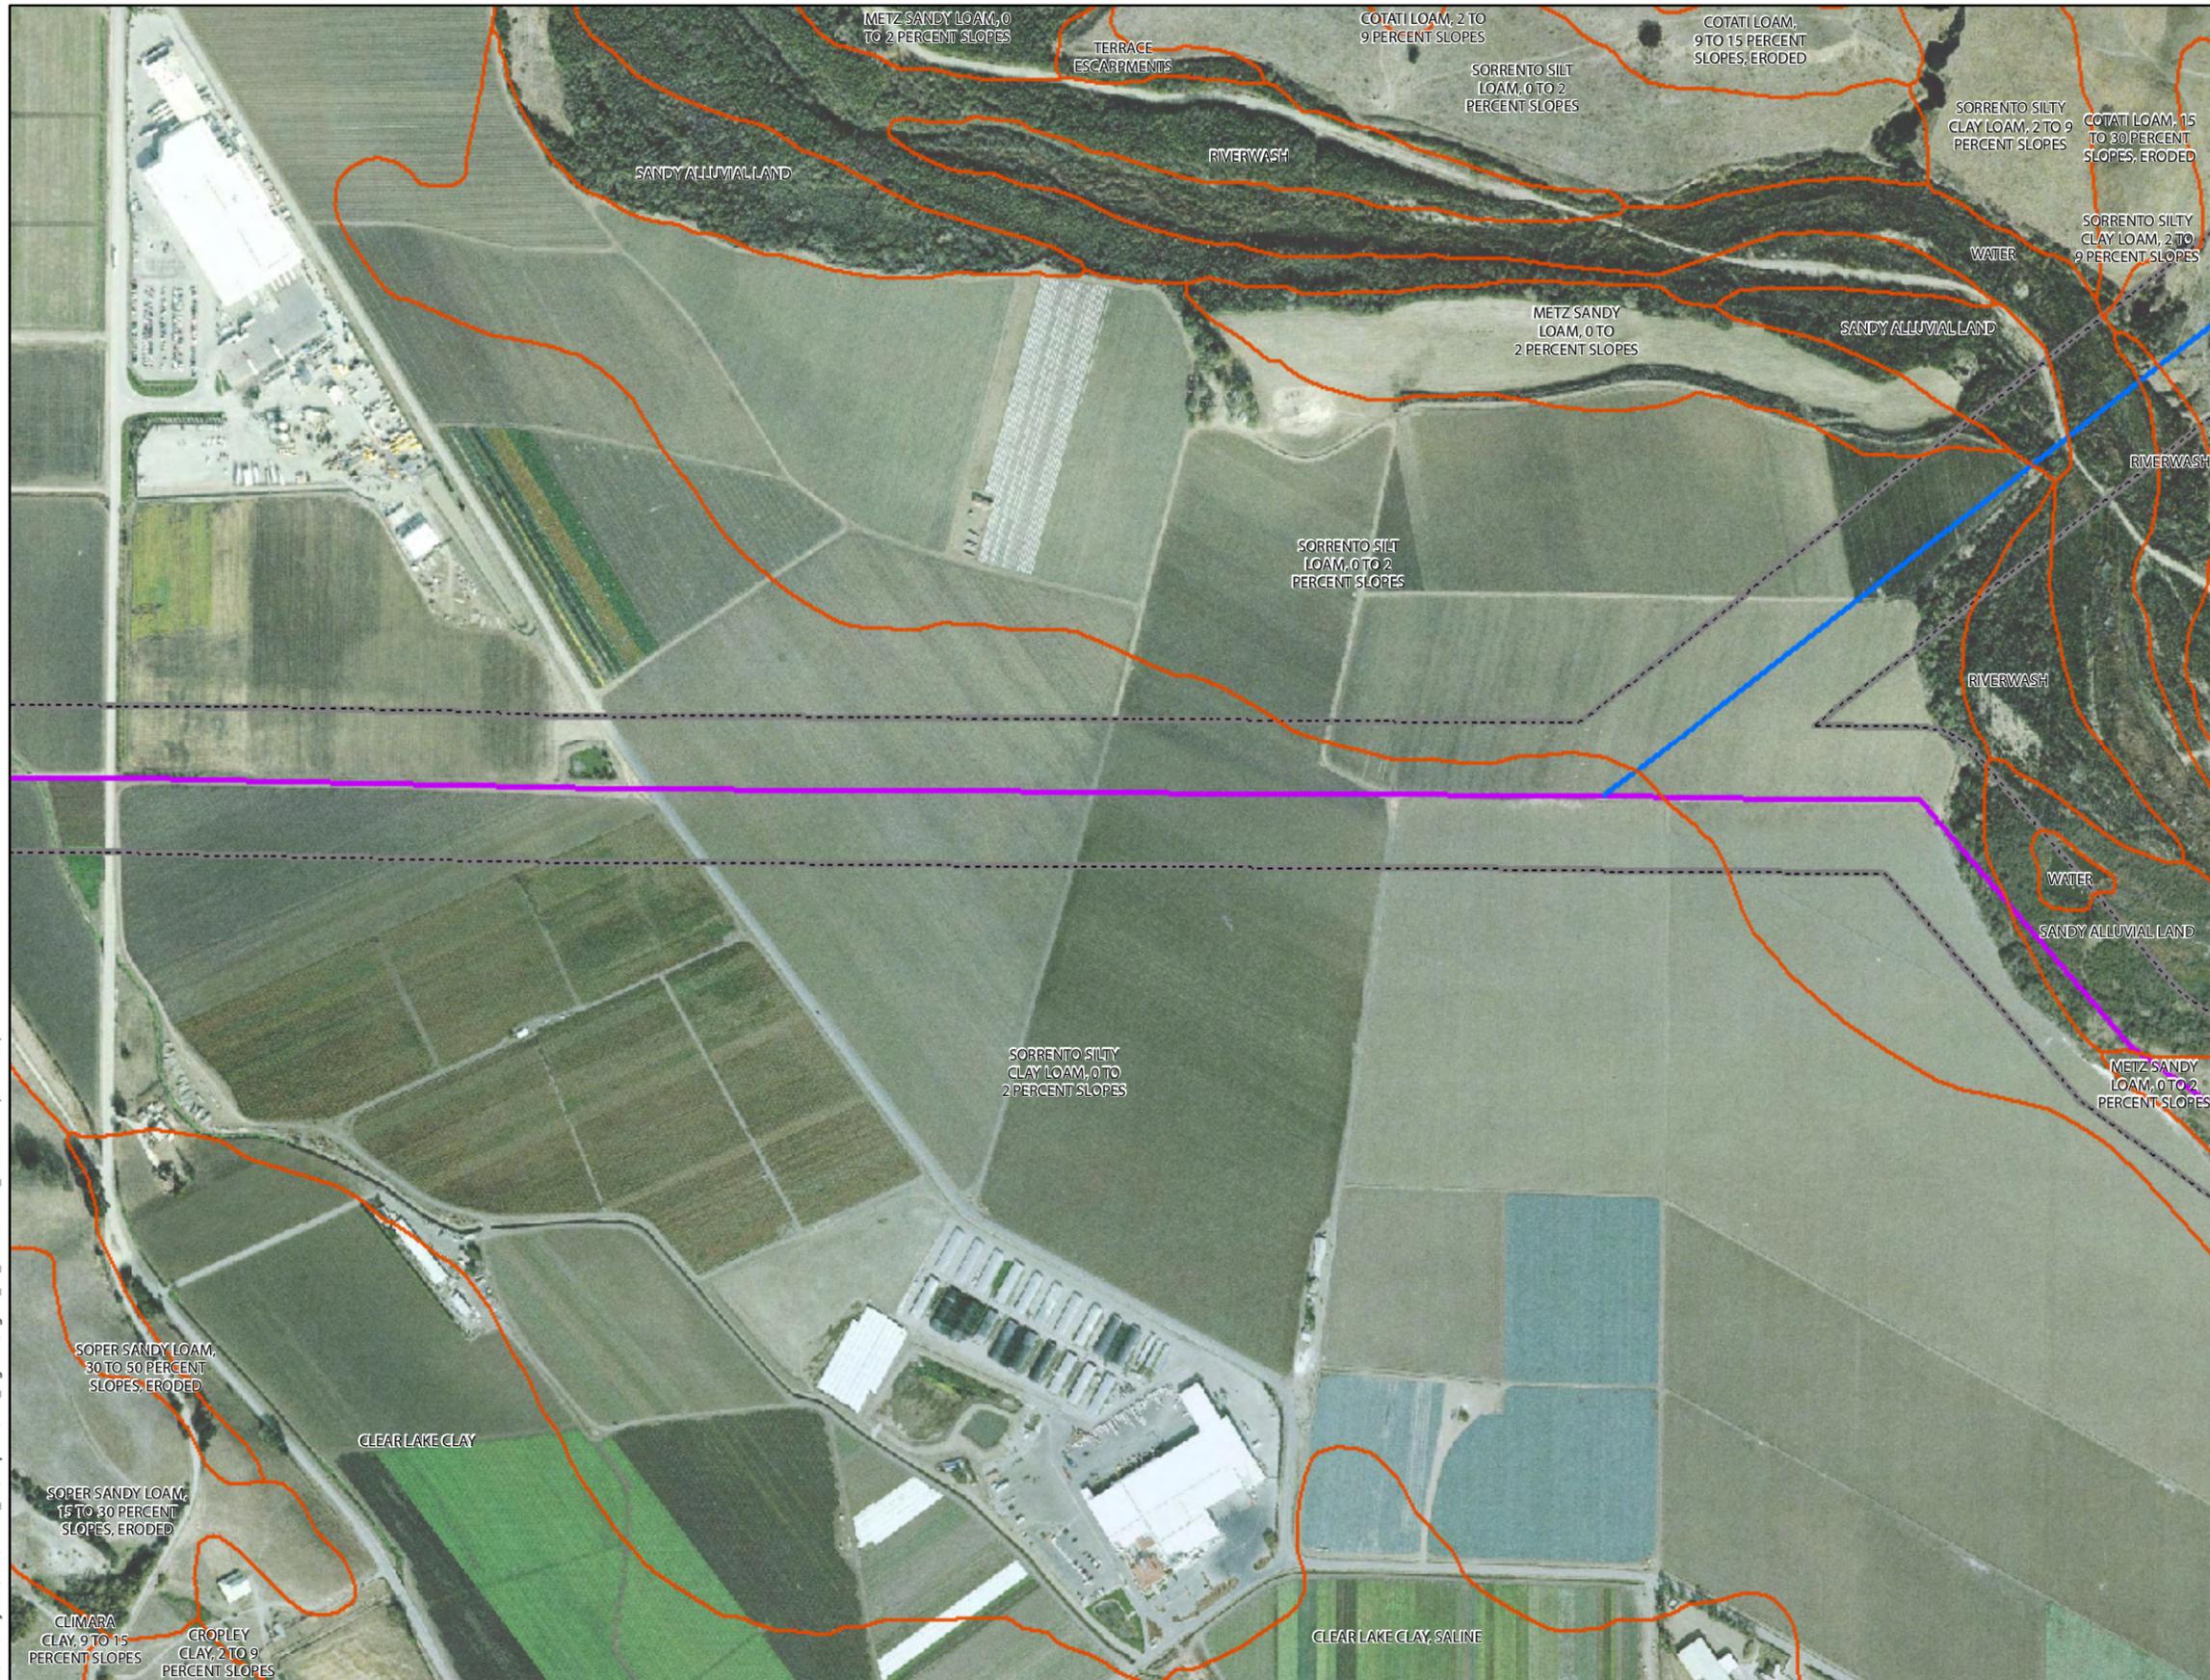

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.


S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

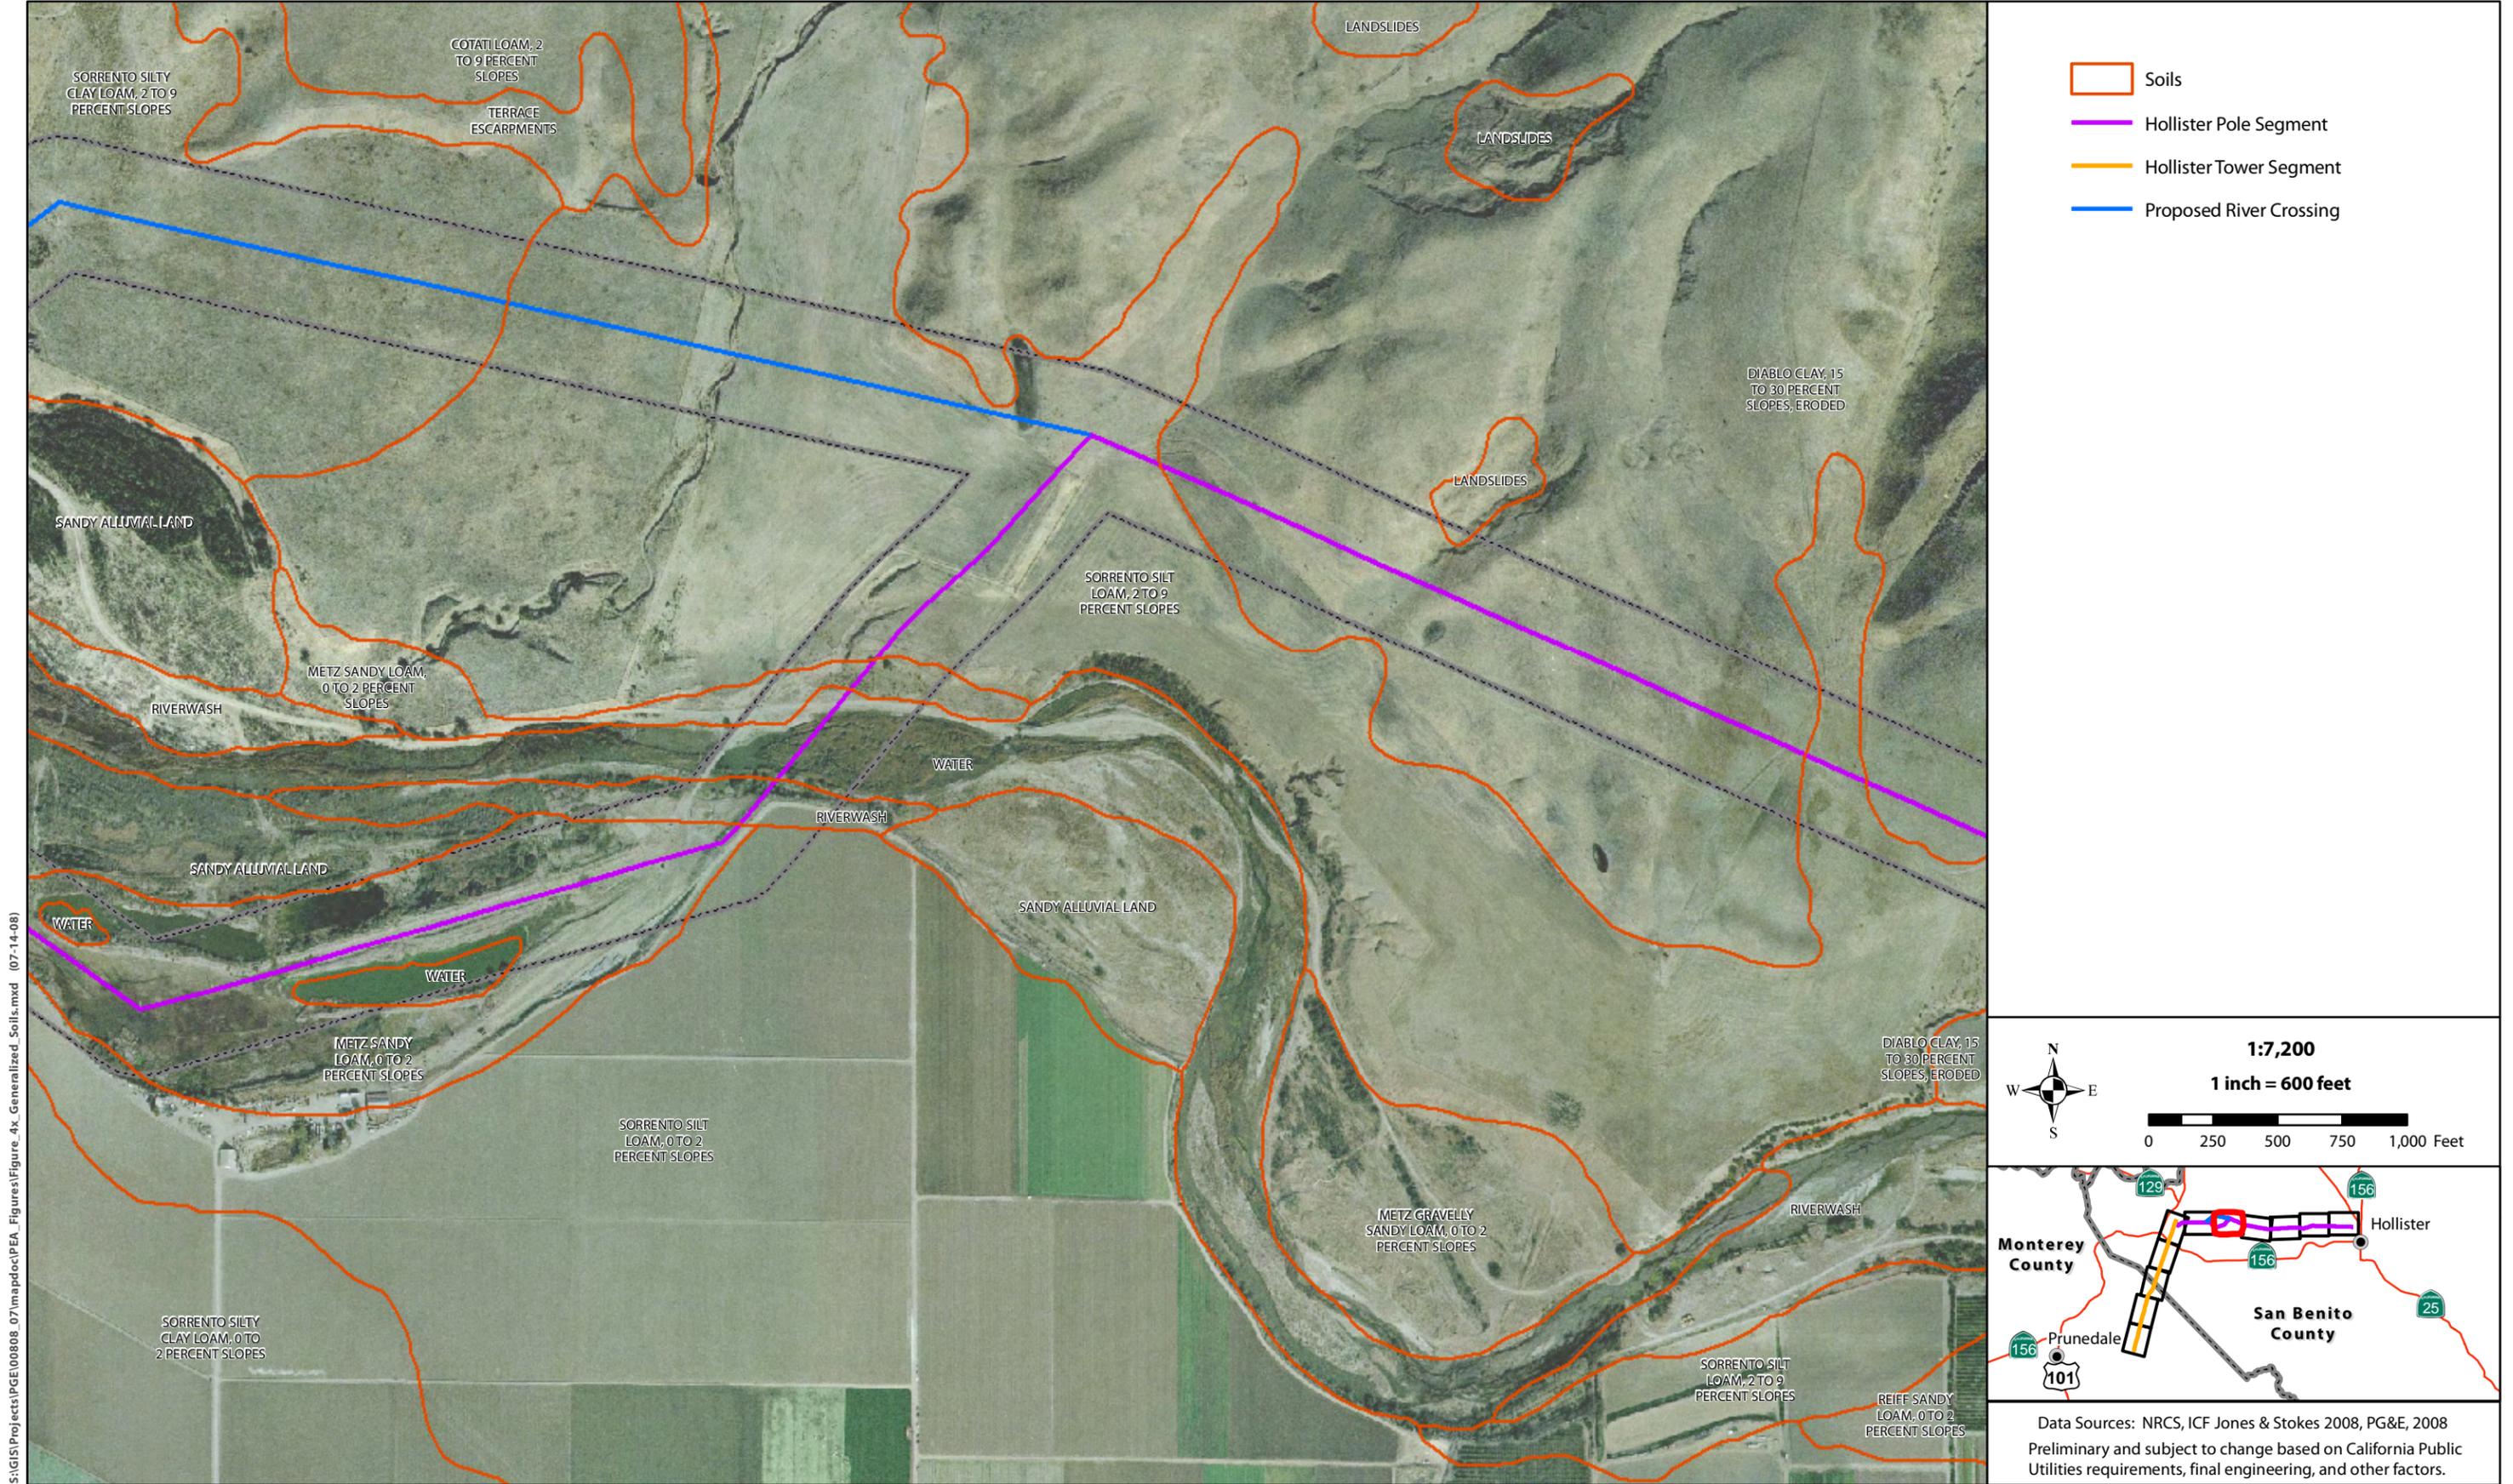


S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

Figure 4.6-8
Soils (Sheet 7)
Hollister 115 kV Power Line Reconductoring Project

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

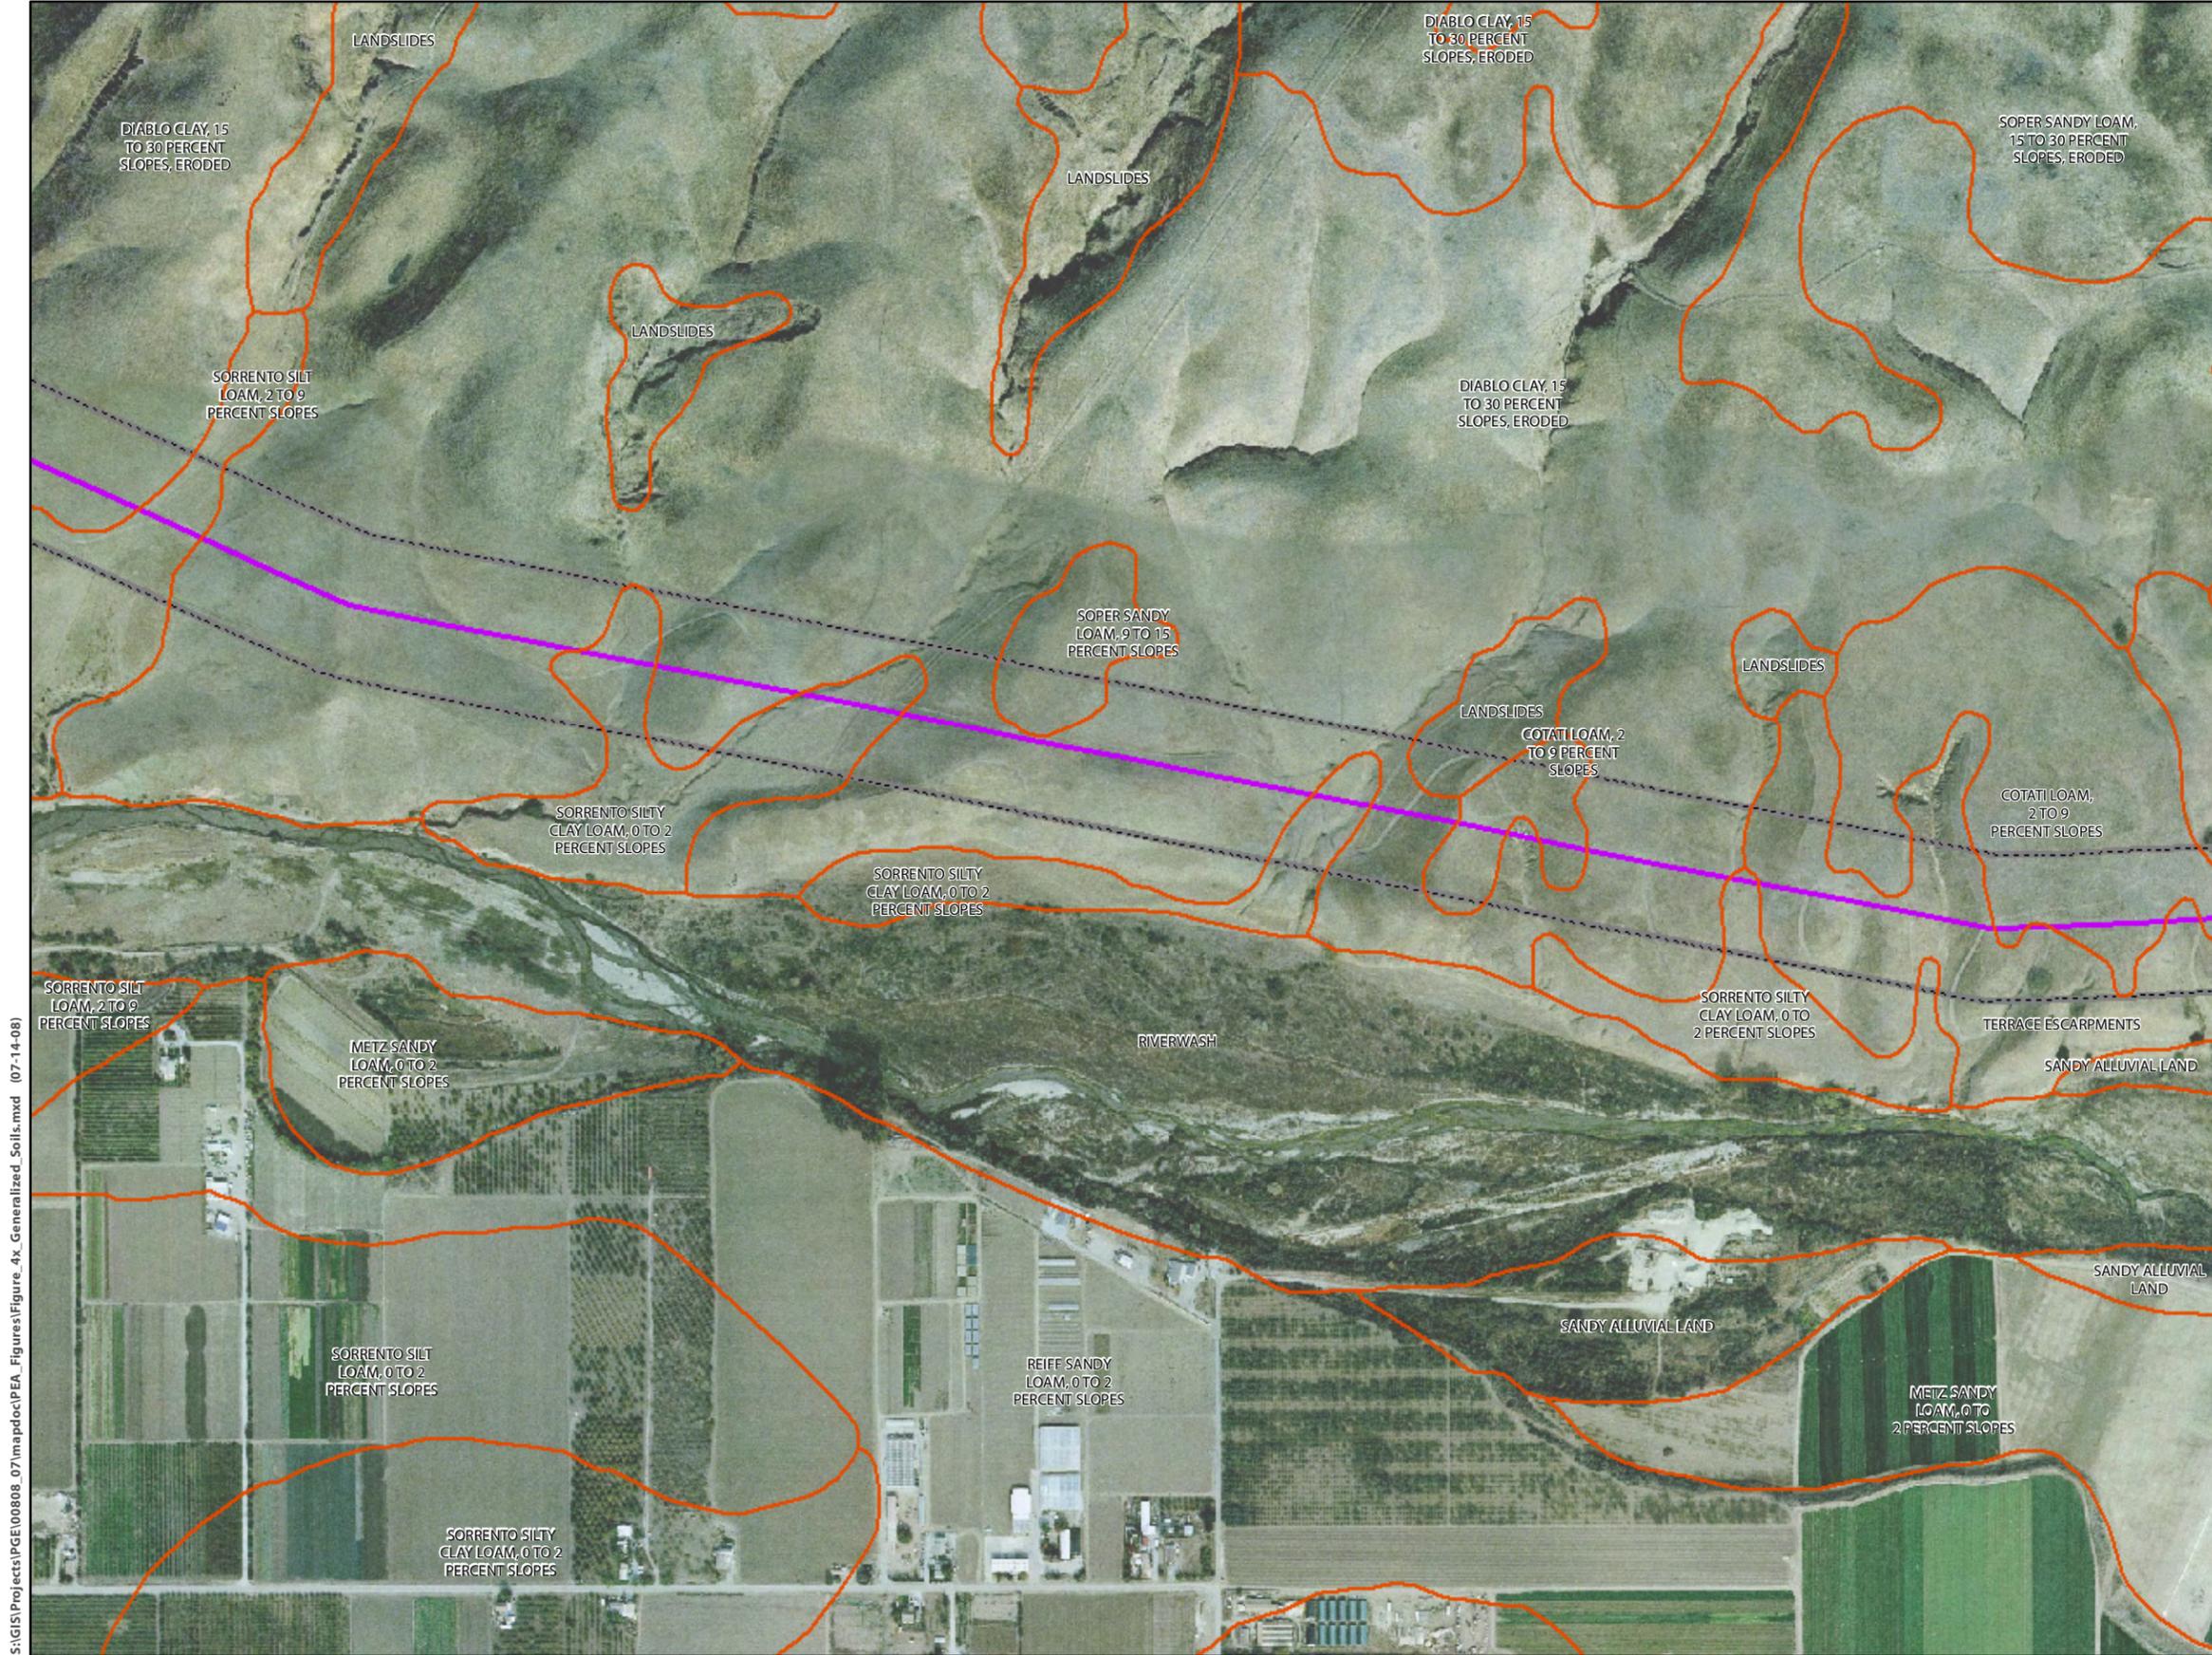


- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

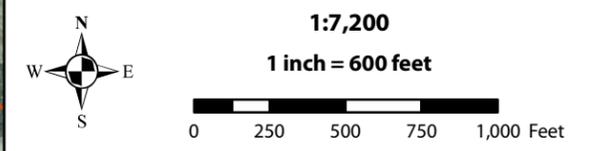


Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

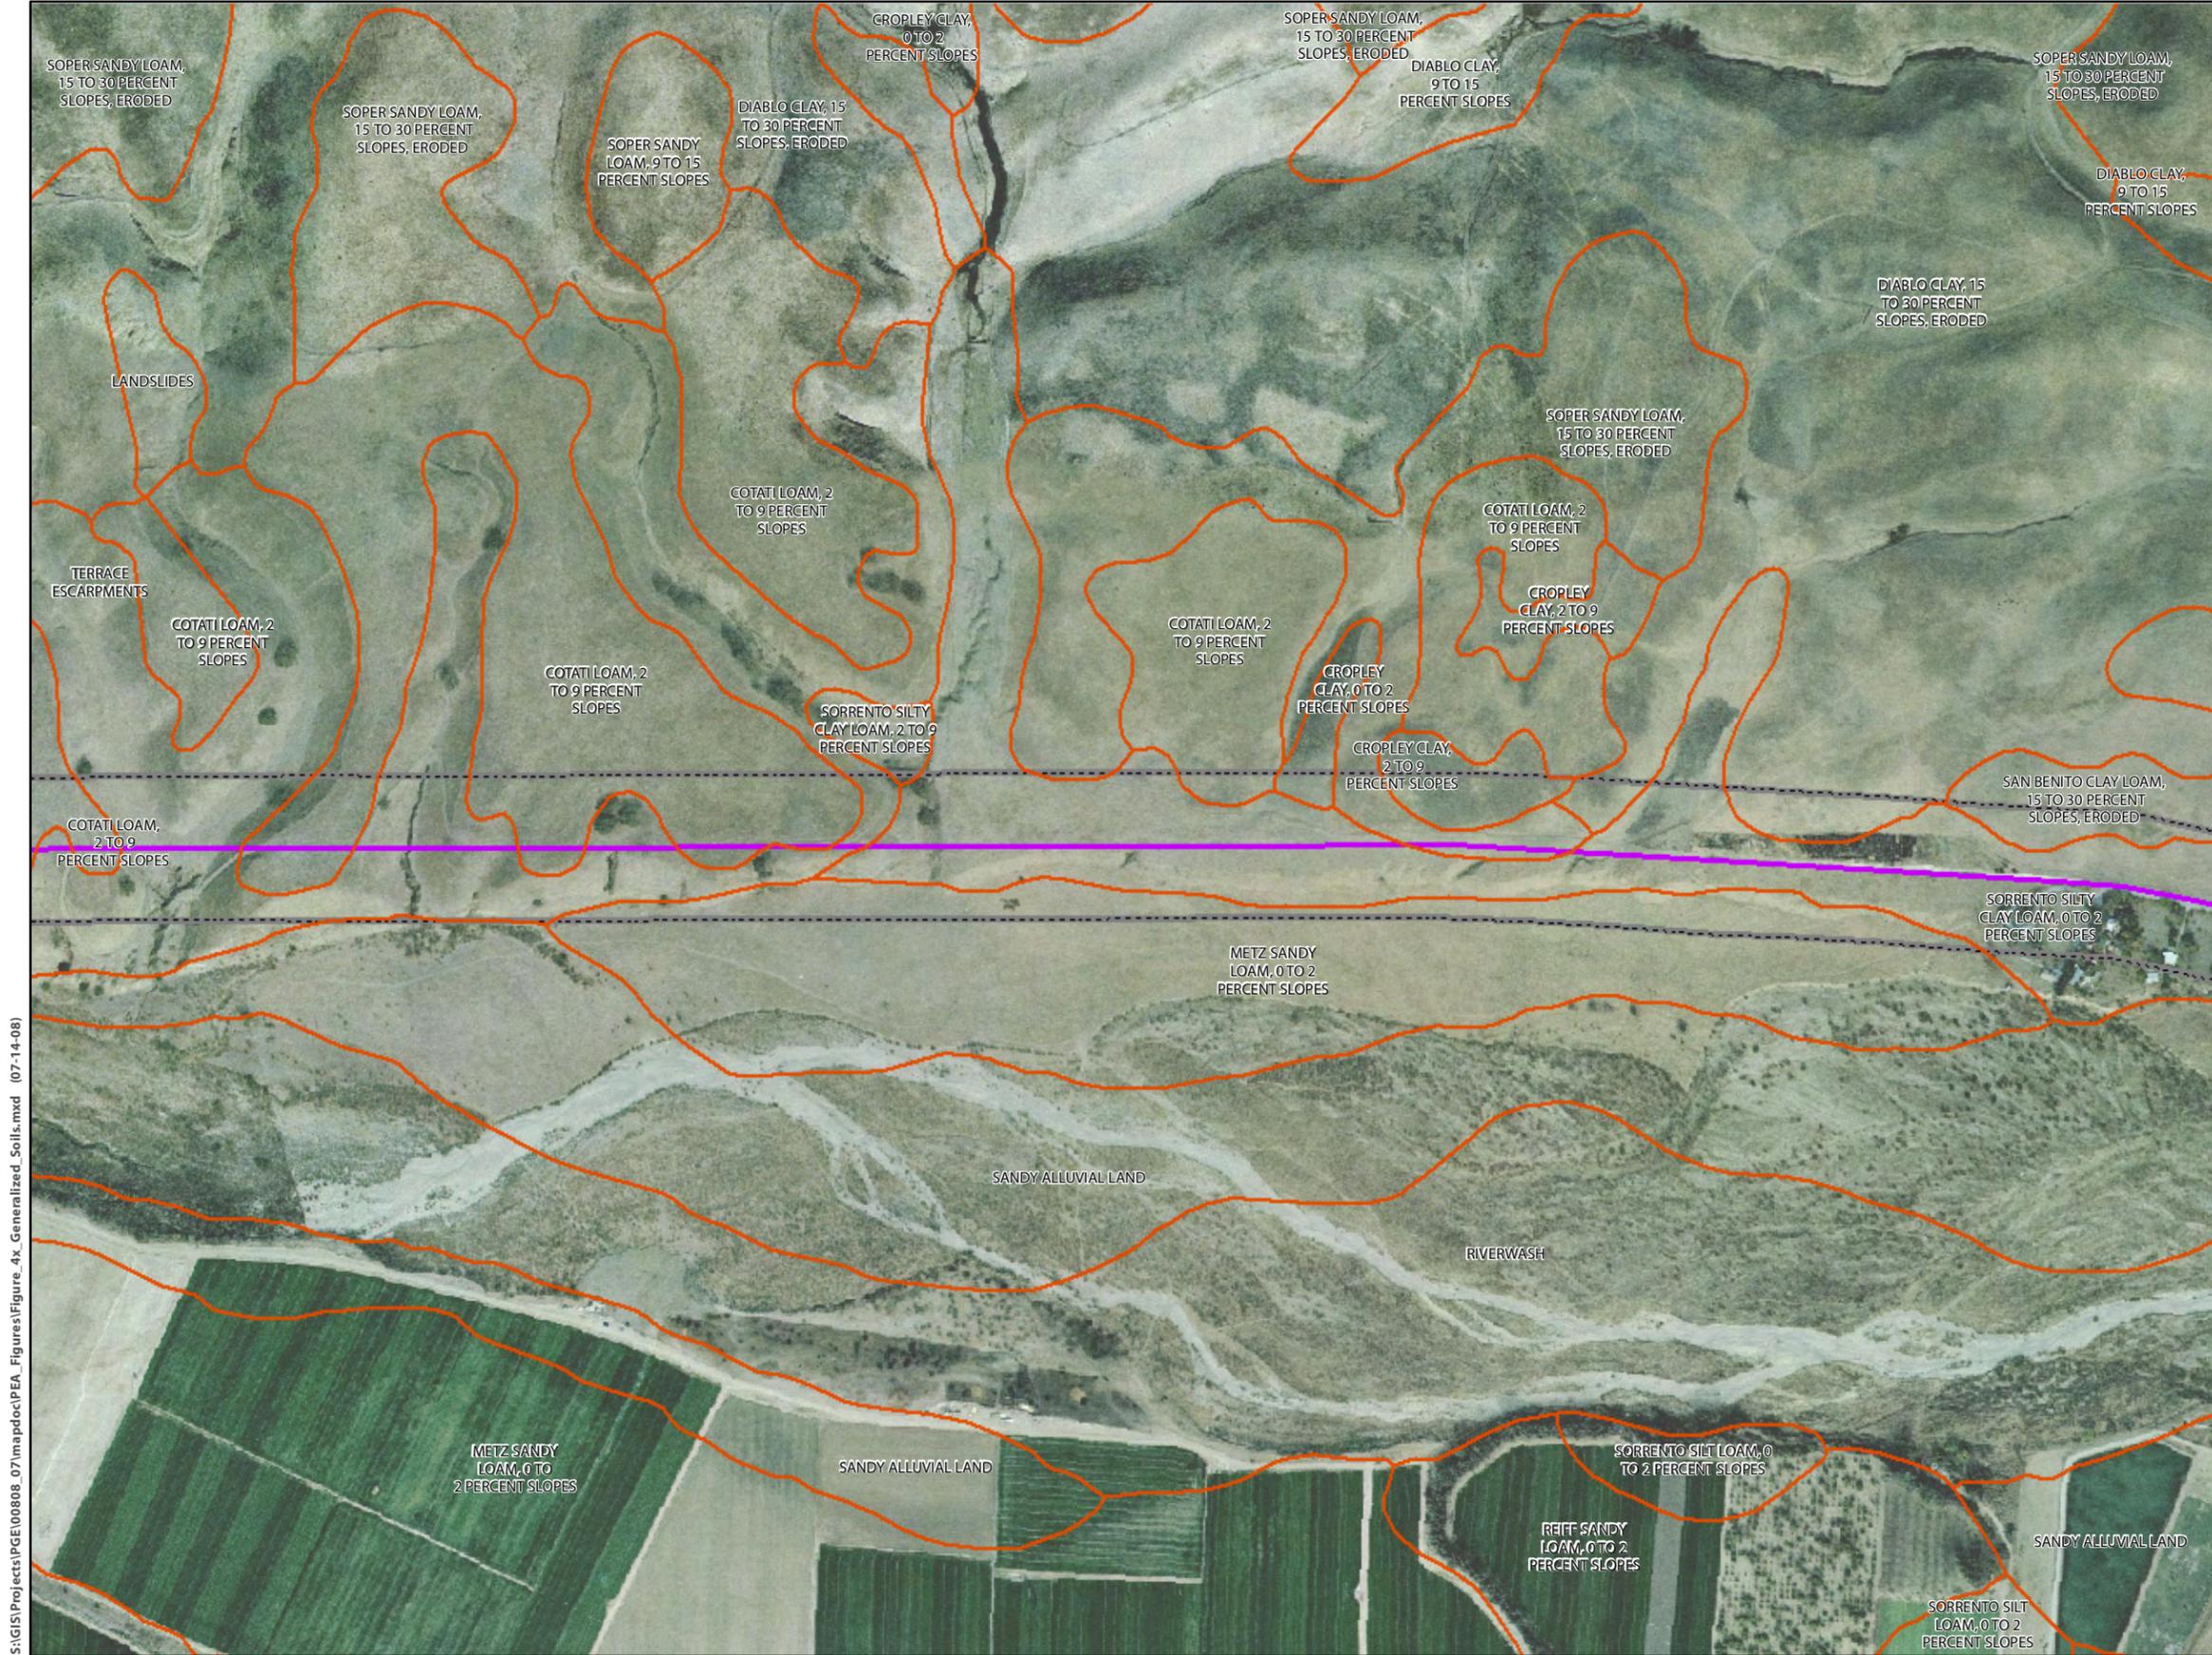


- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

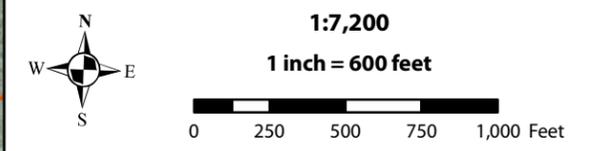


Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

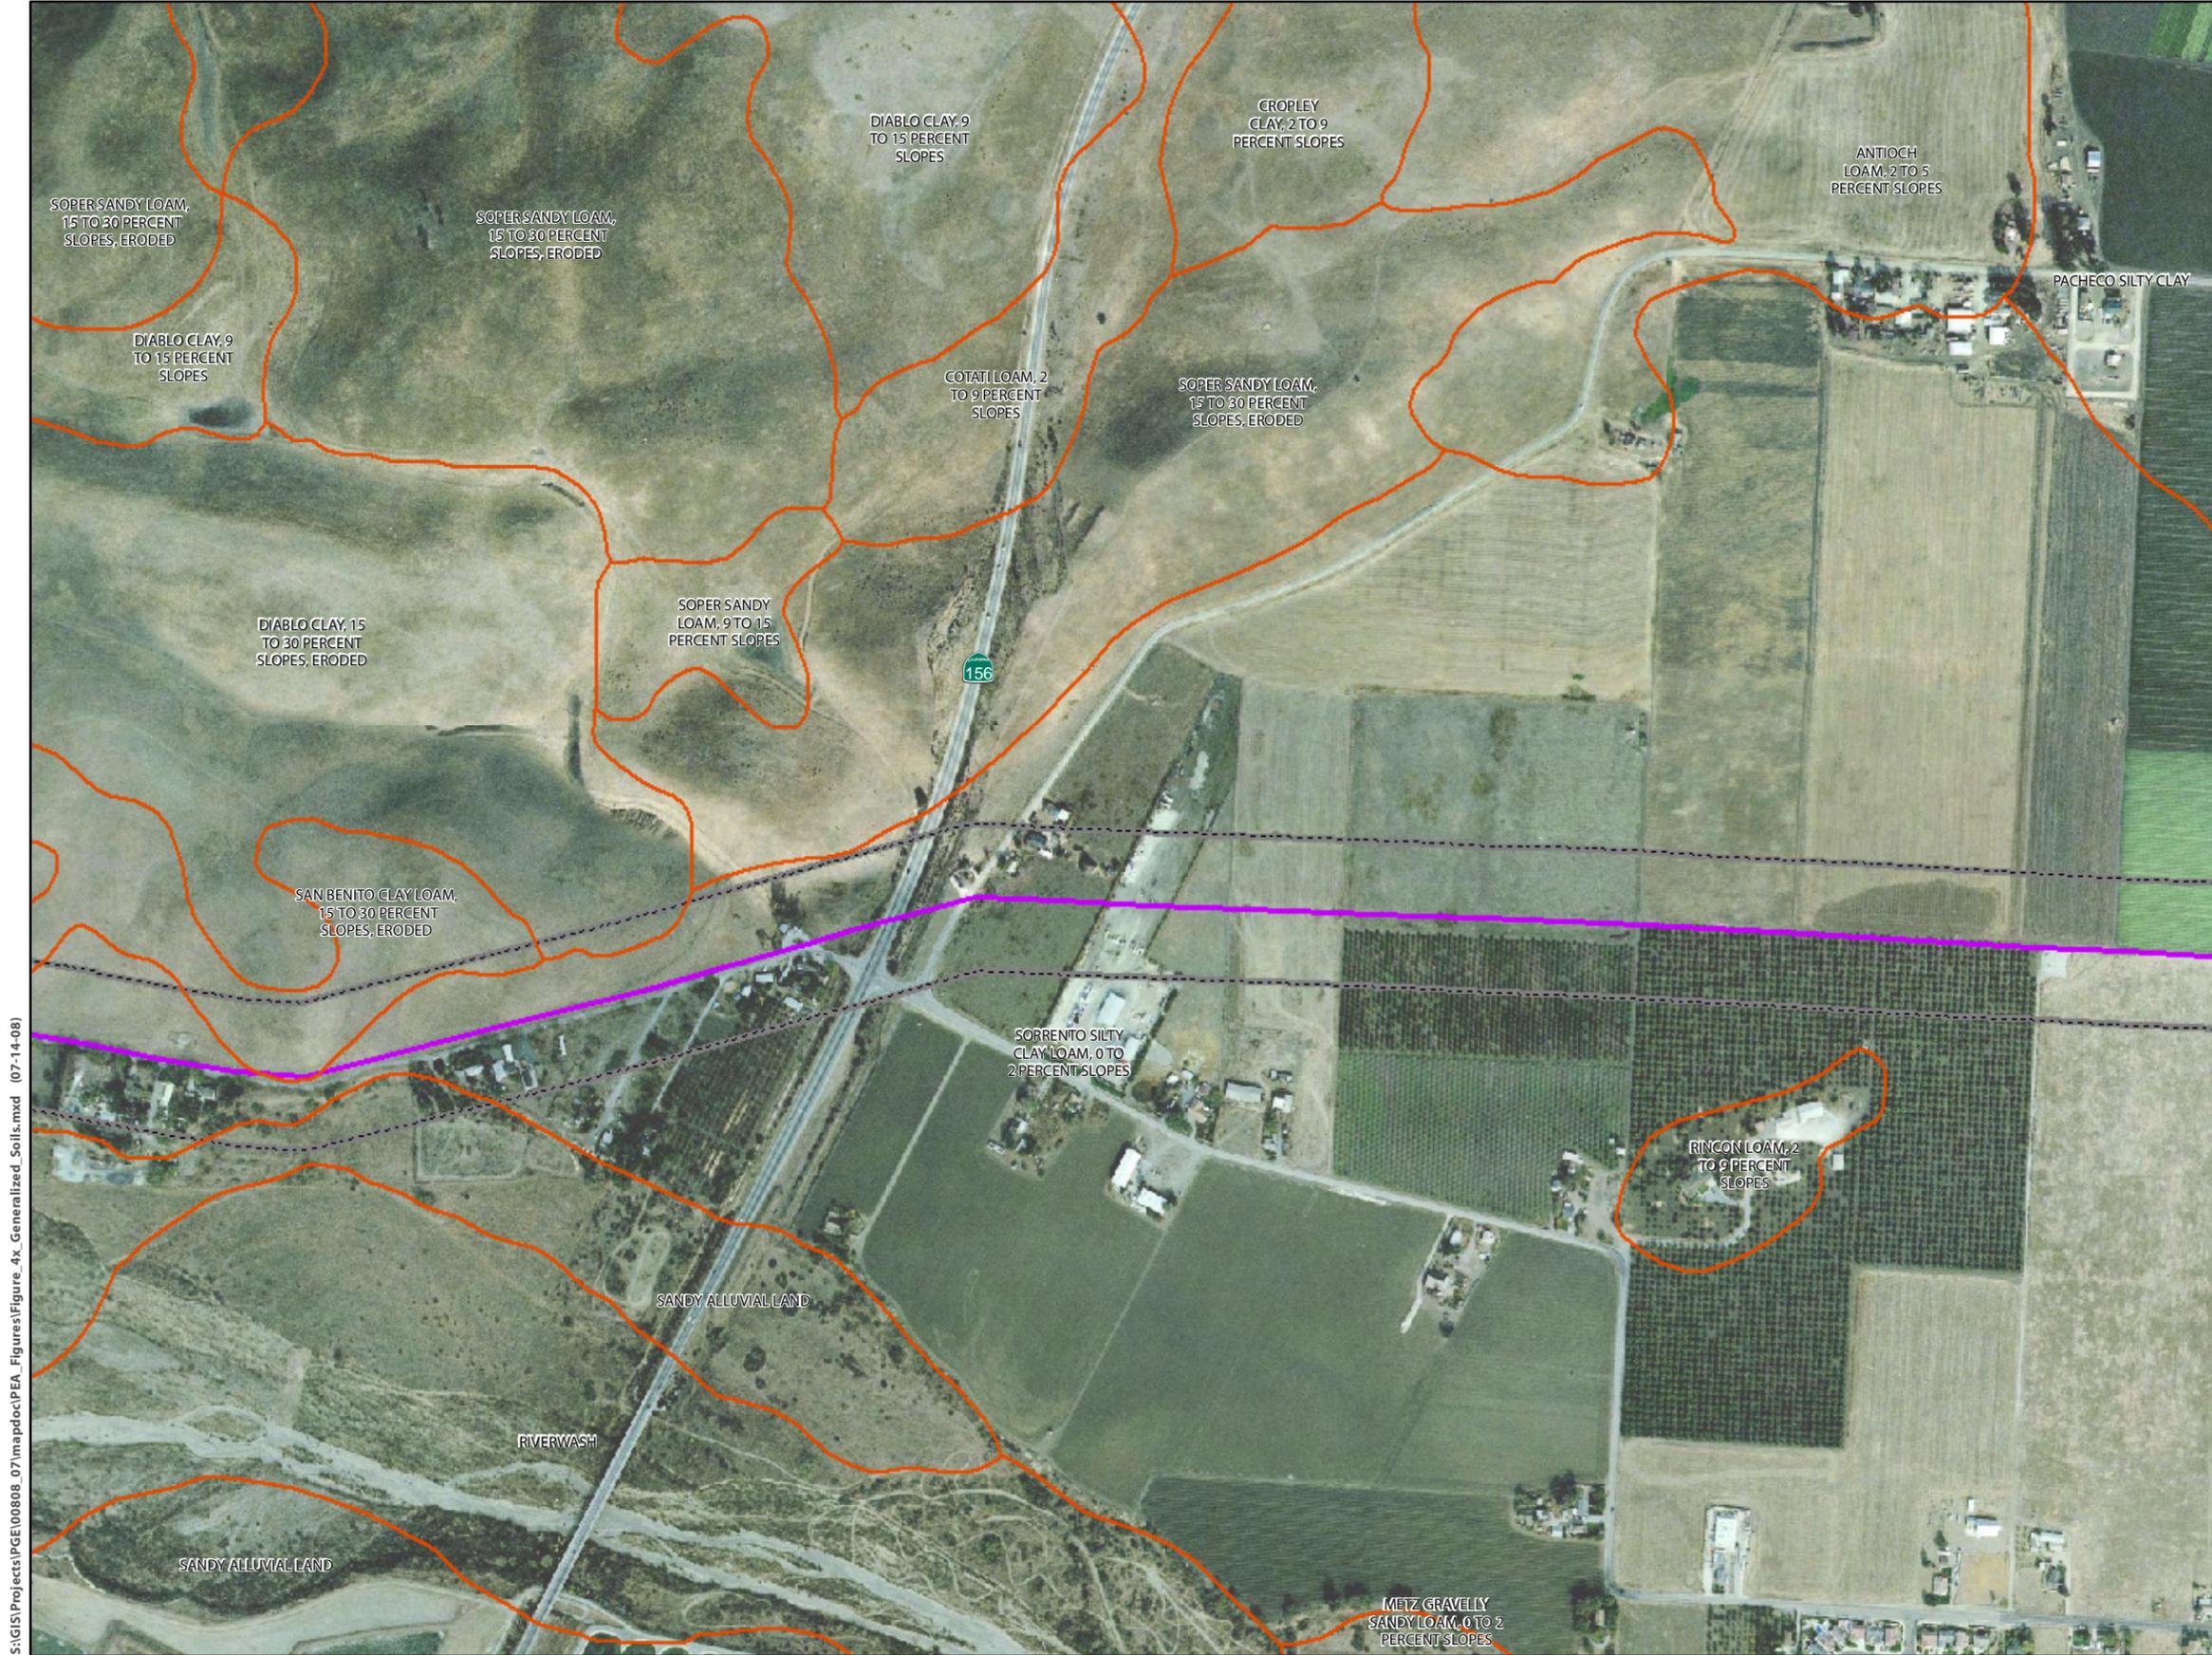


- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

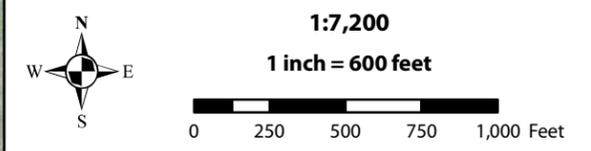


Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.

S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

S:\GIS\Projects\PE\100808_07\mapdoc\PEA_Figures\Figure_4x_Generalized_Soils.mxd (07-14-08)

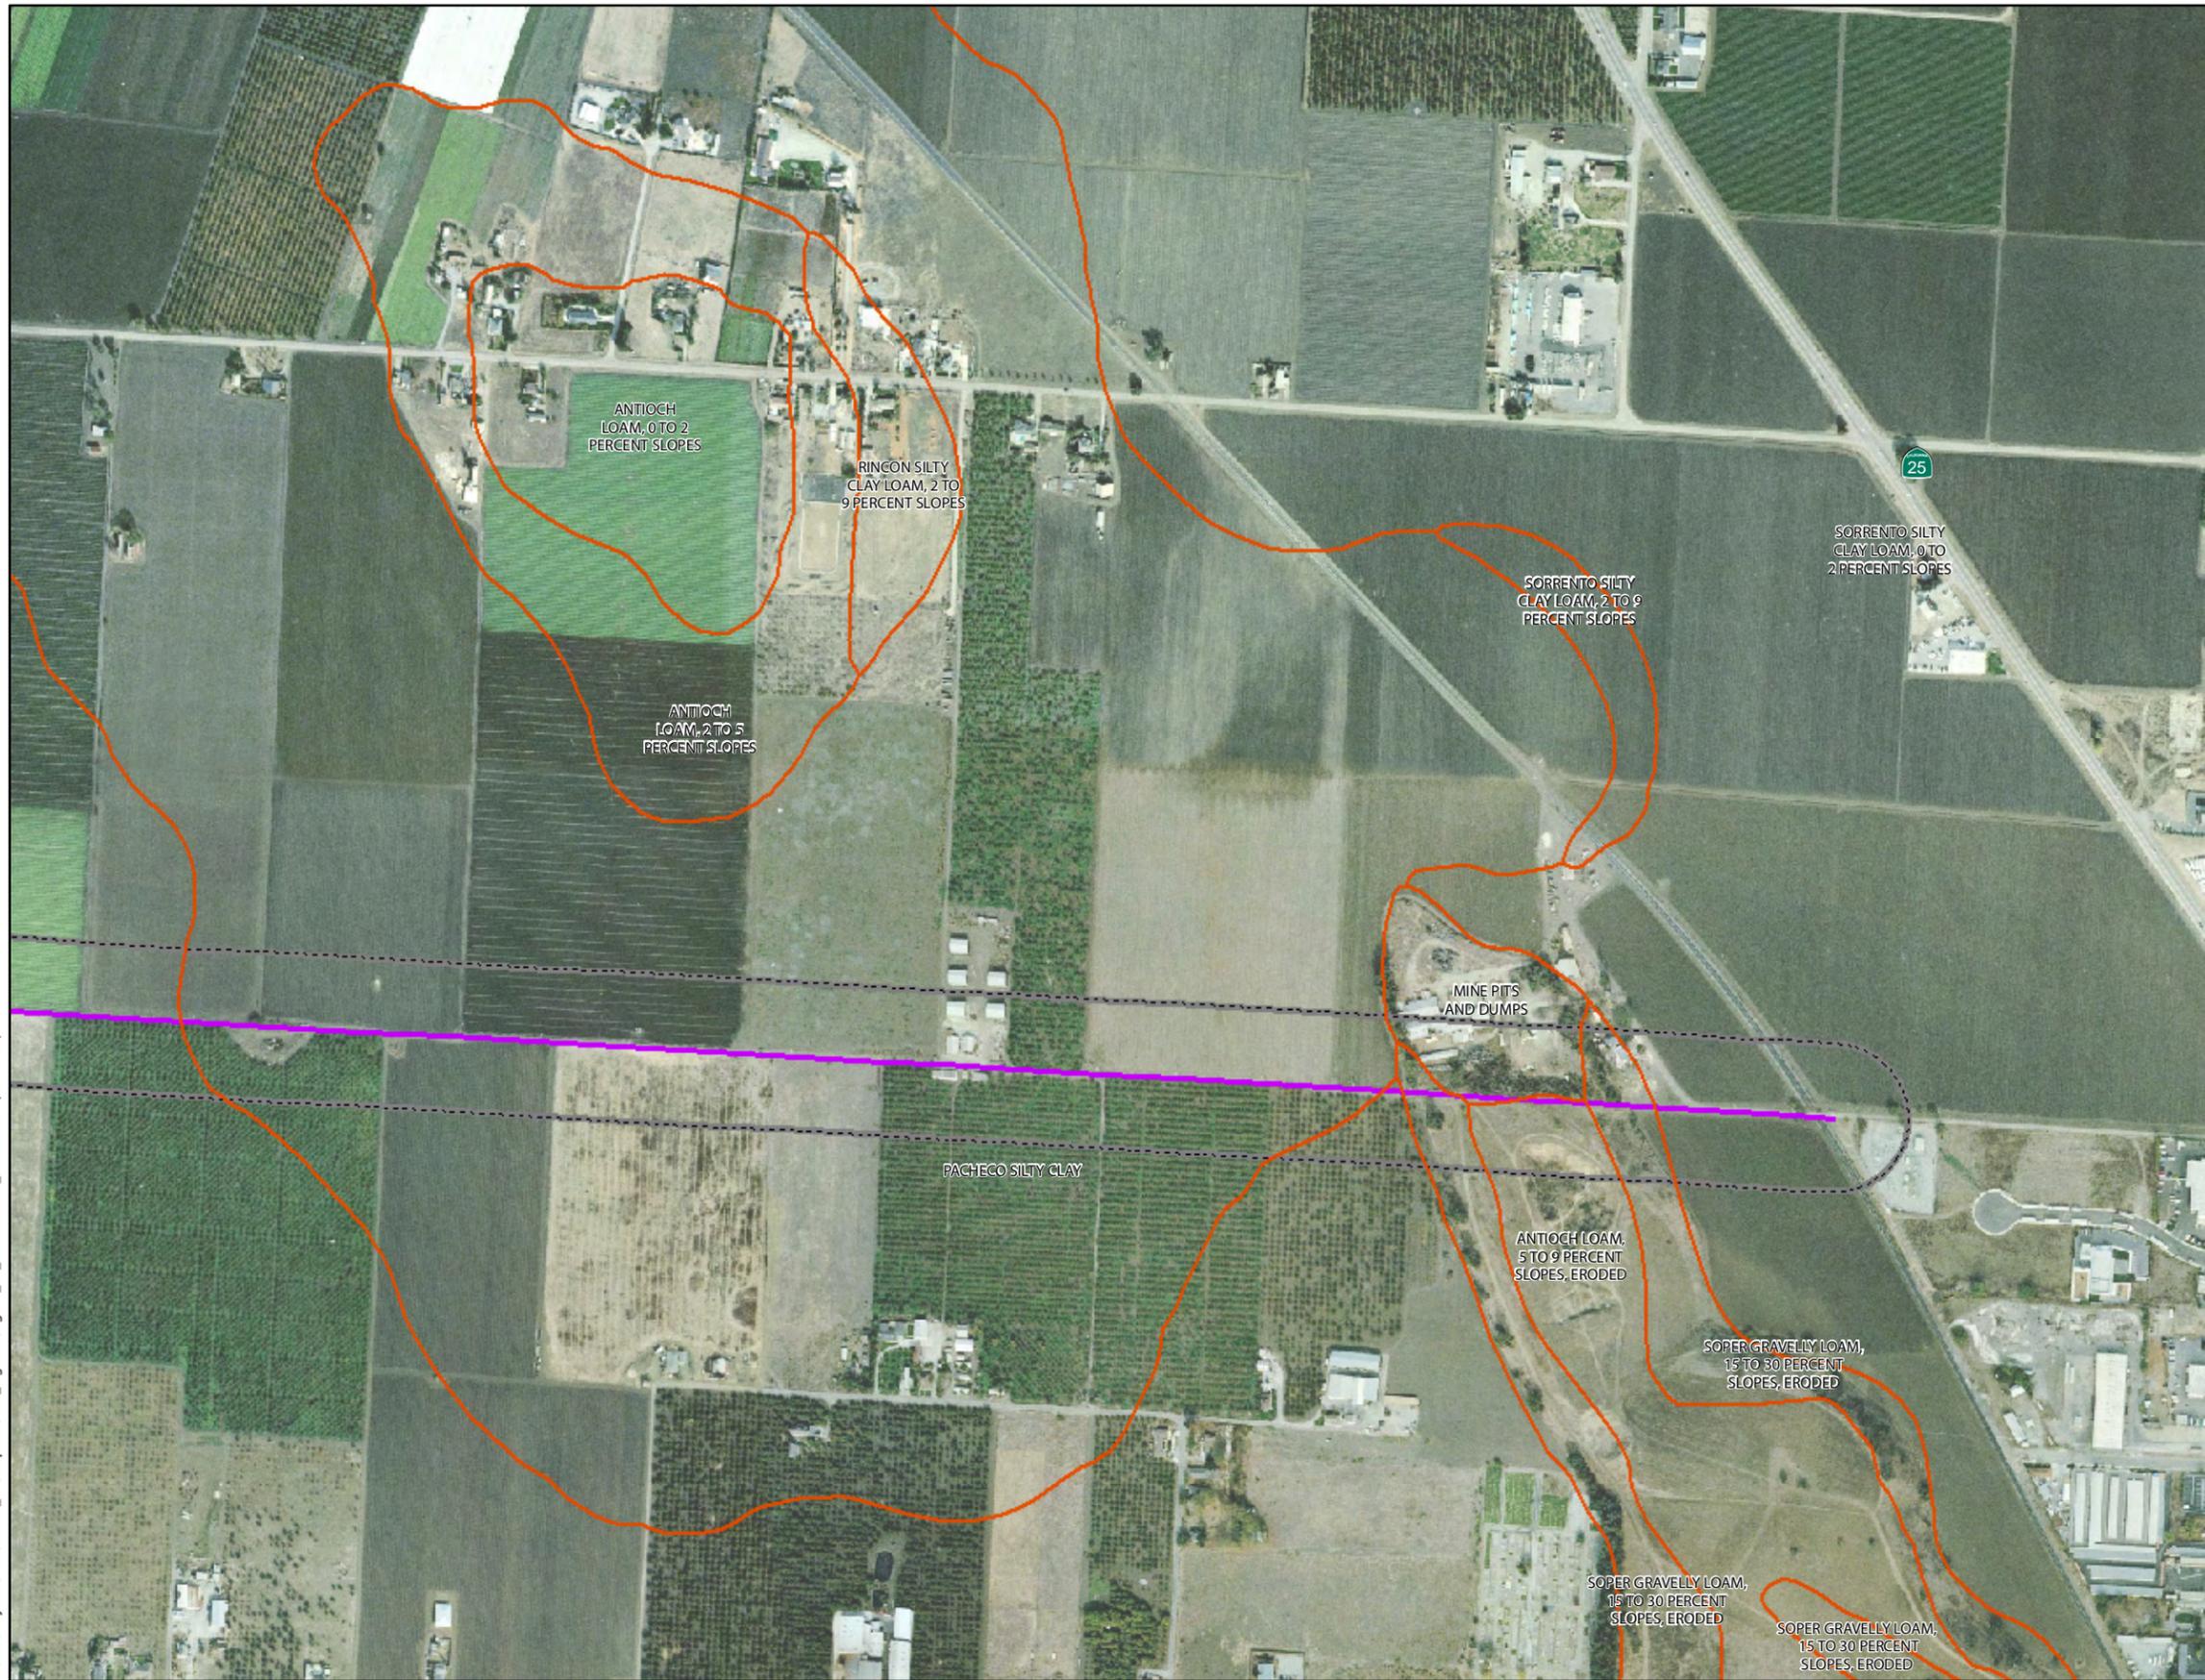

- Soils
- Hollister Pole Segment
- Hollister Tower Segment
- Proposed River Crossing

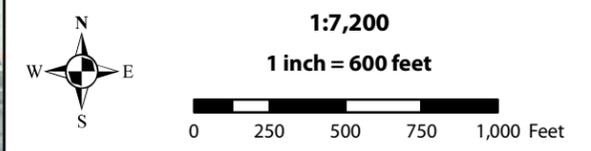

Data Sources: NRCS, ICF Jones & Stokes 2008, PG&E, 2008
 Preliminary and subject to change based on California Public Utilities requirements, final engineering, and other factors.