

PACIFICORP'S
APPLICATION TO CONSTRUCT
YREKA-WEED TRANSMISSION LINE UPGRADE PROJECT
CPUC A.05-12-011

Final Mitigated Negative Declaration
SCH #: 2006092006

Prepared for:
California Public Utilities Commission

October 2006



PACIFICORP'S
APPLICATION TO CONSTRUCT
YREKA-WEED TRANSMISSION LINE UPGRADE PROJECT
CPUC A.05-12-011

Final Mitigated Negative Declaration
SCH #: 2006092006

Prepared for:
California Public Utilities Commission
505 Van Ness Avenue
San Francisco, CA 94102

October 2006

225 Bush Street
Suite 1700
San Francisco, CA 94104
415.896.0000
www.esassoc.com

Los Angeles

Oakland

Orlando

Petaluma

Portland

Sacramento

Seattle

Tampa

205439



**PUBLIC UTILITIES COMMISSION
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3298**



To: Interested Parties

From: John Boccio, Environmental Project Manager

**Subject: NOTICE OF AVAILABILITY OF A FINAL MITIGATED NEGATIVE DECLARATION –
PacifiCorp’s Yreka-Weed Transmission Line Upgrade Project (A.05-12-011)
SCH# 2006092006**

Date: October 17, 2006

The California Public Utilities Commission (CPUC) has prepared a Final Mitigated Negative Declaration (Final MND) under the California Environmental Quality Act (CEQA) for consideration of PacifiCorp’s Application to Construct the Yreka-Weed Transmission Line Upgrade Project (A.05-12-011). The Final MND details the Proposed Project and Weed Segment, evaluates and describes its potential environmental impacts, identifies those impacts that could be significant, and presents mitigation measures to avoid or minimize these impacts.

Description of the Proposed Project. PacifiCorp, in its CPUC application (A.05-12-011), filed on December 13, 2005, seeks a Permit to Construct (PTC) approximately 18.6 miles of 115 kilovolt (kV) single-circuit transmission line between the Yreka and Weed Junction substations pursuant to CPUC General Order (GO) 131-D. Also included in this CEQA review, although not included as part of PacifiCorp’s original application, is a planned rebuilding of the Weed Substation and upgrade of approximately 1.5 miles of single-circuit 69 kV transmission line to a double-circuit 115 kV transmission line (collectively called the Weed Segment) which was added to the CEQA review by order of Commissioner Brown in his “Ruling Regarding Piecemealing and Substations,” filed June 5, 2006.

The objective of the Proposed Project is to improve reliability by increasing transmission capacity in the Yreka-Weed area in order to continue safe and reliable electric service to customers in the area, and to meet contractual obligations. The objective of the Weed Segment is to handle increased load and to provide transmission capacity.

Contents of the Final MND. The Final MND consists of three chapters plus and Appendices. Chapter 1 contains an introduction to the Final MND, including descriptions of the CEQA and public review processes and an overview of the comments received on the Draft MND. Chapter 2 contains the comments on the Draft MND as well as CPUC’s responses to the comments. Chapter 3 contains revisions to the Mitigation Monitoring, Reporting, and Compliance Program.

CPUC Actions After Final MND Publication. There is no comment period following issuance of the Final MND. The CPUC will determine the adequacy of the Final MND, and, if adequate, would adopt the document as compliant with CEQA. The CPUC would issue a Decision on the Application, which would be announced and published concurrent with a scheduled CPUC Meeting. After the Commission makes the decision on the Application, a Notice of Determination would be mailed to the State Clearinghouse within 5 days of the Decision. Within 30 days after the Decision is issued by the CPUC, parties can apply for rehearing. For further information on the CPUC’s decision-making process, call the CPUC Public Advisor at (415) 703-2074.

**PACIFICORP'S APPLICATION TO CONSTRUCT YREKA-WEED TRANSMISSION LINE UPGRADE PROJECT
INFORMATION REPOSITORIES**

Availability of Final MND. Copies of the Final MND are available for review at the Yreka Branch and Weed Branch of the Siskiyou County Library (see addresses below), and on the project website: <http://www.yreka-weed.com>. Library hours are available at www.snowcrest.net/siskiyoulibrary/branches.html or by calling the libraries. Hard copies or CD copies of the Final MND may be requested by telephone at (415) 962-8421 or by e-mail at yreka-weed@esassoc.com.

Yreka Branch Library
719 4th Street
Yreka, CA 96097
(530) 841-4175

Weed Branch Library
708 South Davis
Weed, CA 96094
(530) 938-4769

Map of the Proposed Project Location:

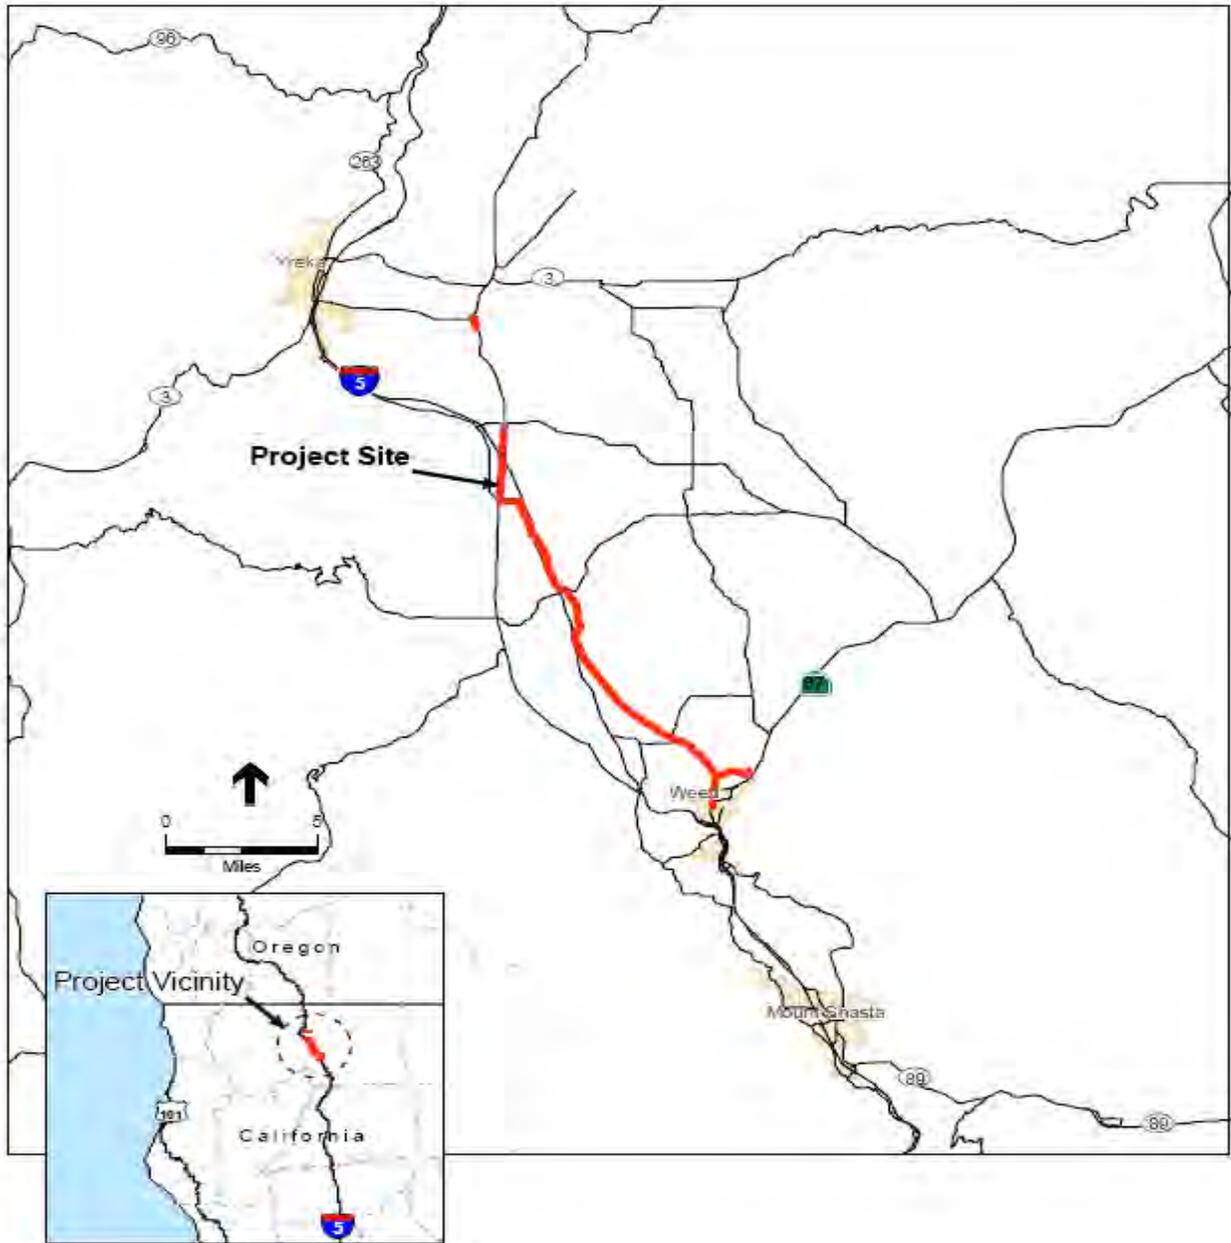


TABLE OF CONTENTS

PacifiCorp’s Yreka–Weed Transmission Line Upgrade Project (A.05-12-011) Final Mitigated Negative Declaration

	<u>Page</u>
1. Introduction	1-1
1.1 CEQA Process.....	1-1
1.2 Public Review Process	1-2
1.3 Comments on the Draft Mitigated Negative Declaration	1-2
2. Comments on the Draft Mitigated Negative Declaration	2-1
2.1 Introduction	2-1
2.2 List of Comment Letters Received.....	2-1
2.3 Responses to Comments	2-2
2.4 Public Meeting Comments and Responses	2-2
3. Mitigation, Monitoring, Reporting and Compliance Program	3-1
3.1 Summary of Revisions.....	3-1
3.2 Revised Table of Mitigations.....	3-1
 Appendices	
A. PacifiCorp’s Yreka–Weed Transmission Line Upgrade Project (A.05-12-011) Draft Mitigated Negative Declaration (provided on CD) ¹	

¹ See inside of back cover.