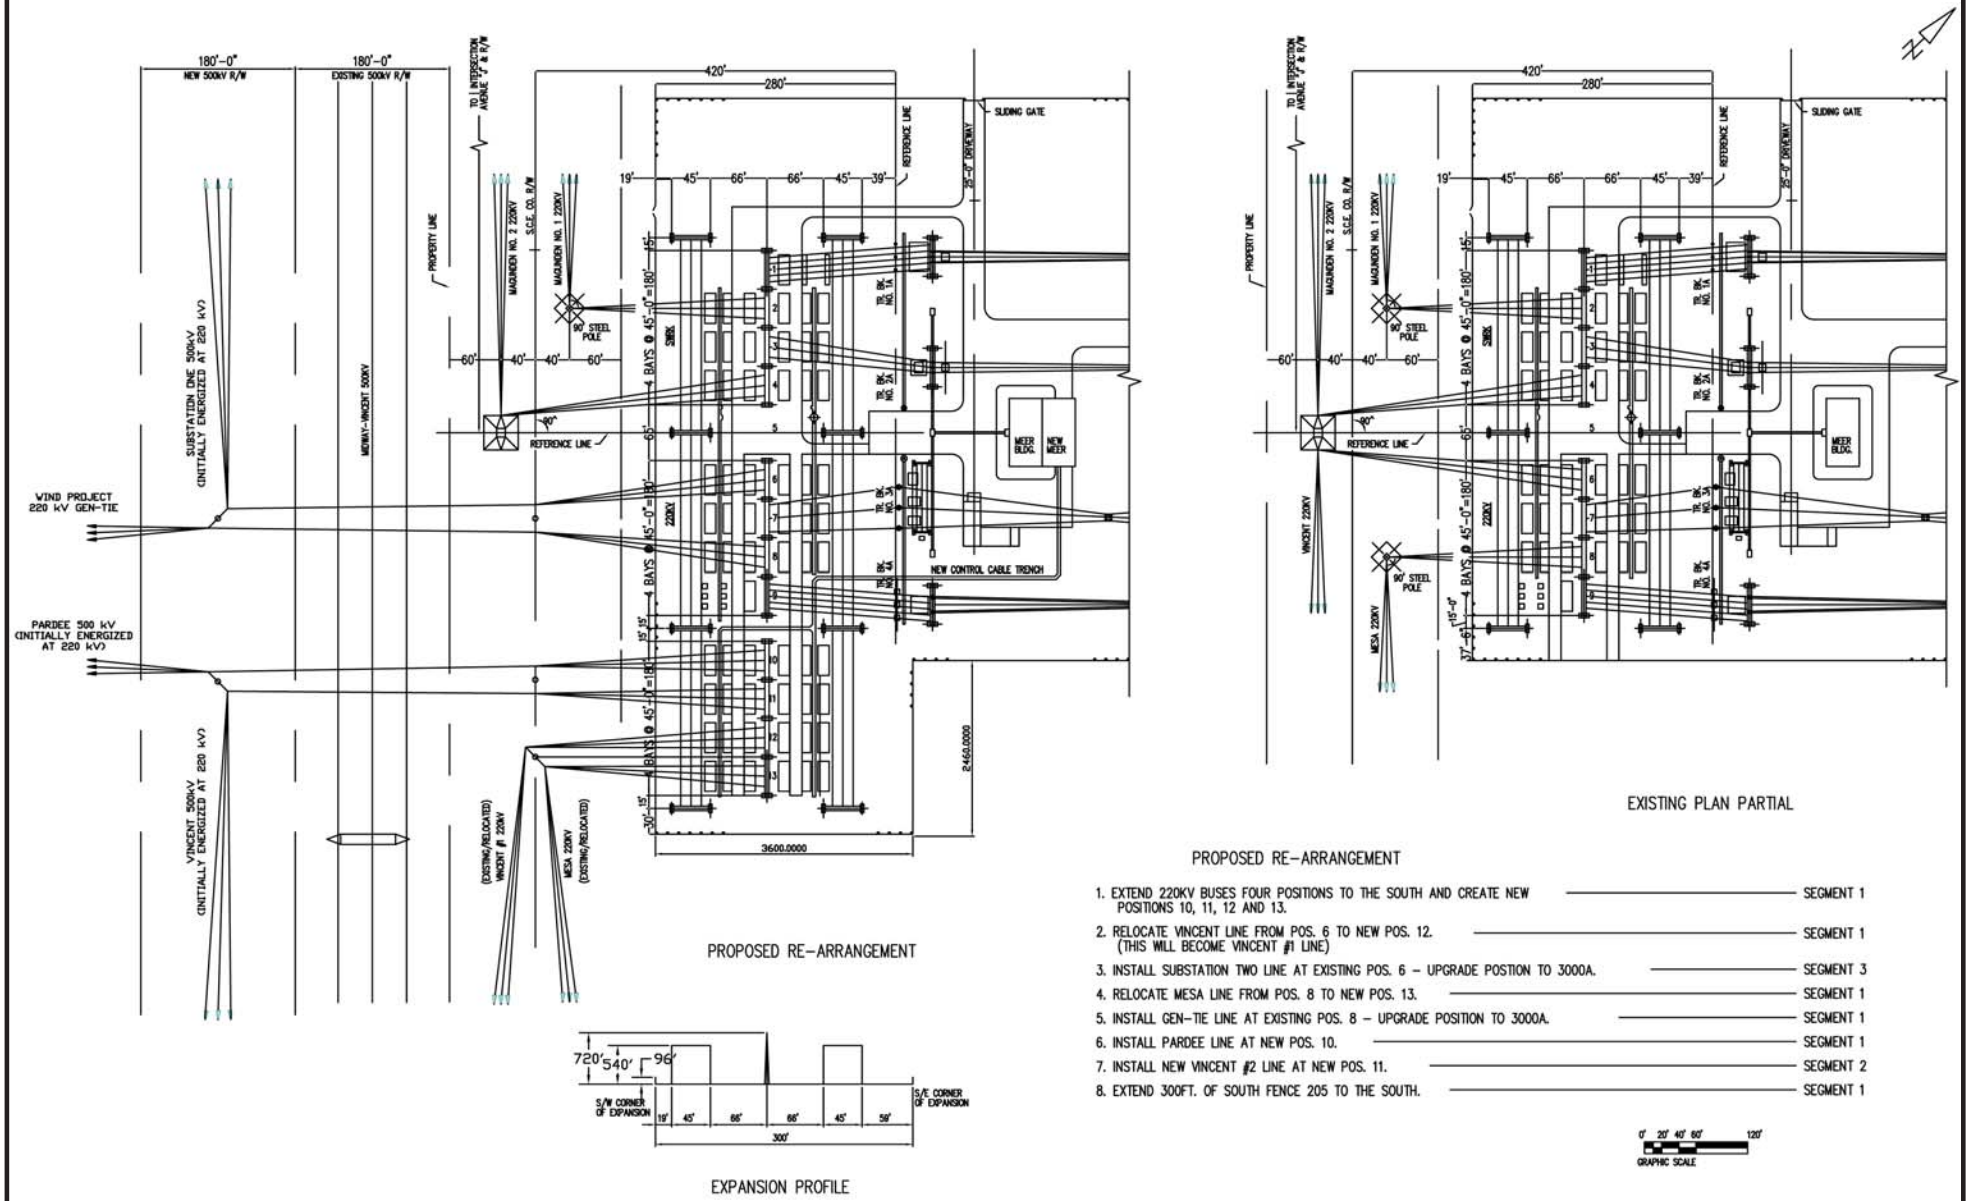

PROPOSED RE-ARRANGEMENT

1. EXTEND 220KV BUSES FOUR POSITIONS TO THE SOUTH AND CREATE NEW POSITIONS 10, 11, 12 AND 13. — SEGMENT 1
2. RELOCATE VINCENT LINE FROM POS. 6 TO NEW POS. 12. (THIS WILL BECOME VINCENT #1 LINE) — SEGMENT 1
3. INSTALL SUBSTATION TWO LINE AT EXISTING POS. 6 – UPGRADE POSTION TO 3000A. — SEGMENT 3
4. RELOCATE MESA LINE FROM POS. 8 TO NEW POS. 13. — SEGMENT 1
5. INSTALL GEN-TIE LINE AT EXISTING POS. 8 – UPGRADE POSITION TO 3000A. — SEGMENT 1
6. INSTALL PARDEE LINE AT NEW POS. 10. — SEGMENT 1
7. INSTALL NEW VINCENT #2 LINE AT NEW POS. 11. — SEGMENT 2
8. EXTEND 300FT. OF SOUTH FENCE 205 TO THE SOUTH. — SEGMENT 1

Source: SCE, 2005.

Figure B.2-28

Antelope Substation Plot Plan Detailing Proposed Modification