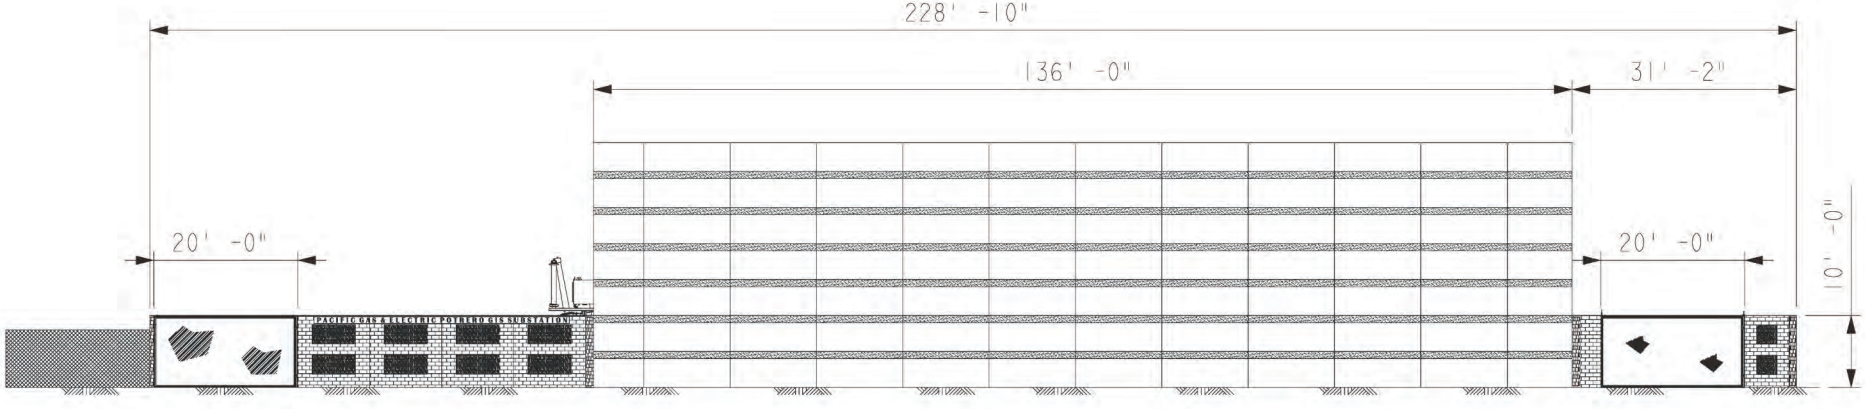

Source: PG&E, 2013b.

Figure 4-15c

Revised Potrero 230 kV Switchyard North Elevation