



Existing 220 kV Configuration

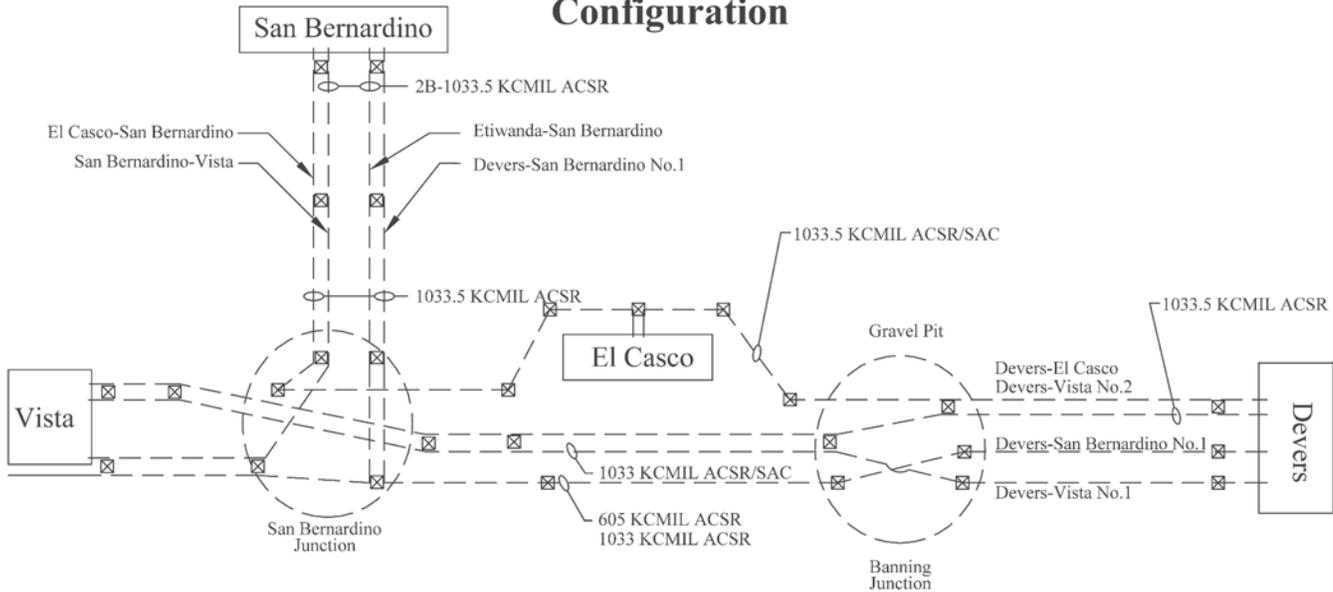

LEGEND

- Single Circuit Tower
- Double Circuit Tower
- Under-Crossing
- Existing Conductor
- New Conductor

Proposed 220 kV Configuration

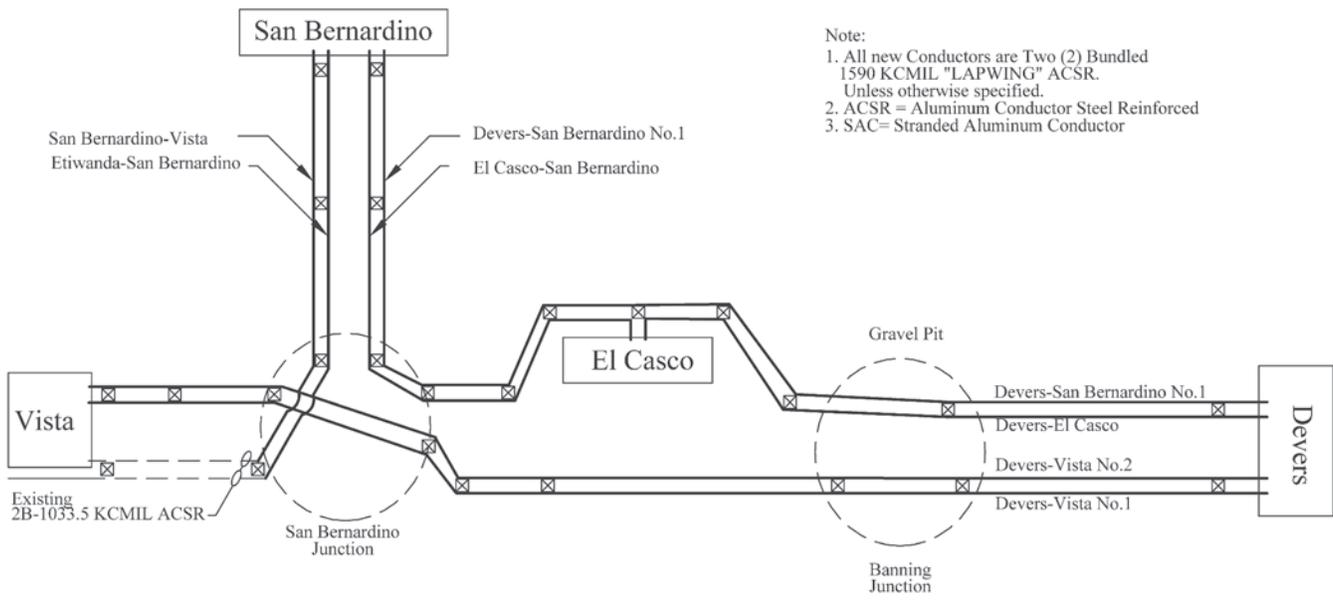

Note:
 1. All new Conductors are Two (2) Bundled 1590 KCMIL "LAPWING" ACSR. Unless otherwise specified.
 2. ACSR = Aluminum Conductor Steel Reinforced
 3. SAC= Stranded Aluminum Conductor

Not to Scale

Source: SCE, 2013.

West of Devers Upgrade Project

Figure B-8
**Existing and Proposed
 220 kV Configuration**