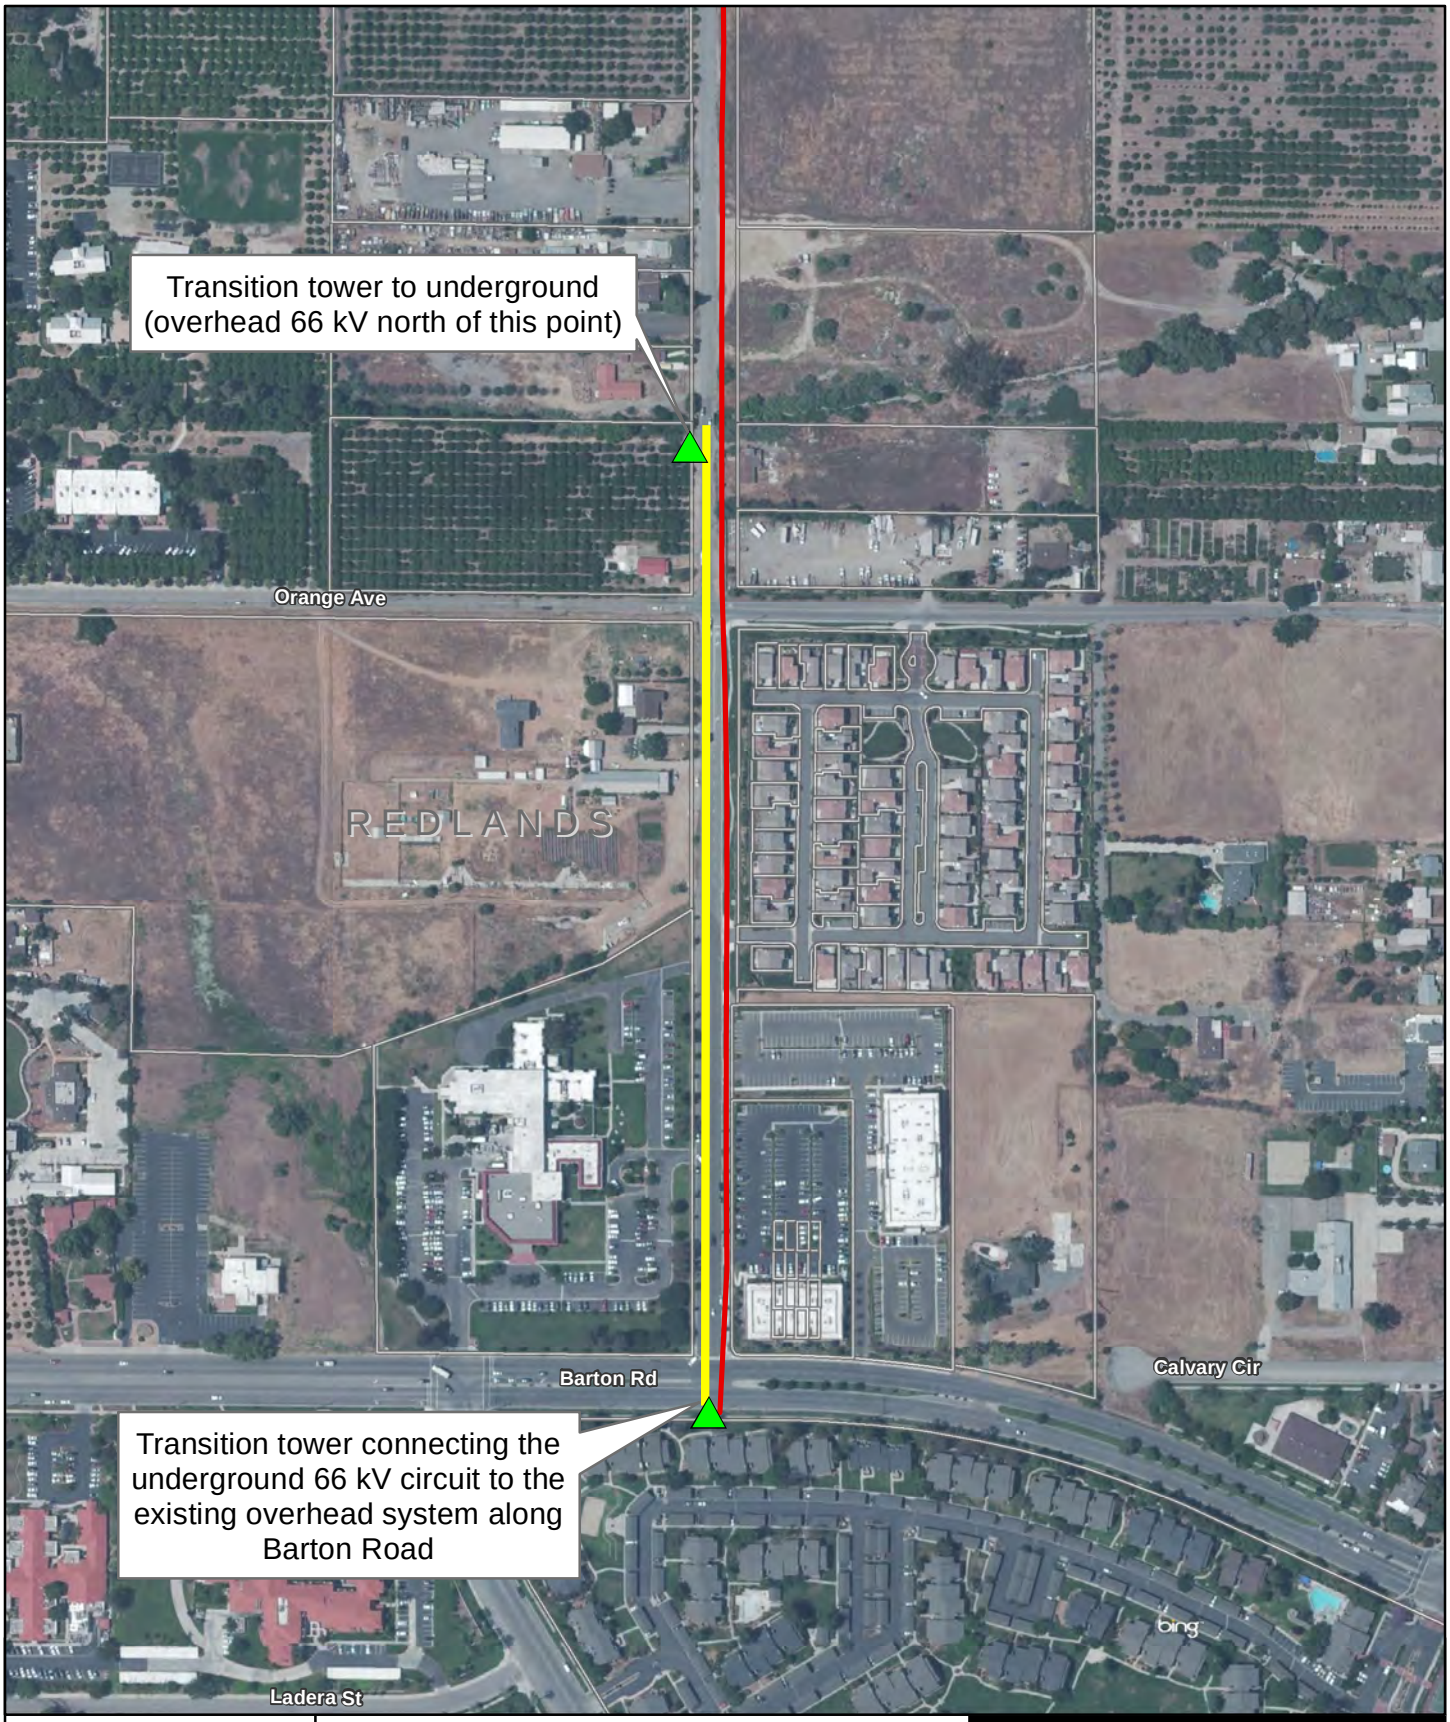

Sources: SCE 2014

N
W E
S

0 100 200 400 Feet

Transition Structures
Underground Segment
Proposed 66 kV Subtransmission Route
Parcels

West of Devers Upgrade Project

Figure C-4
Iowa Street 66 kV Underground Alternative