



### Existing 220 kV Configuration

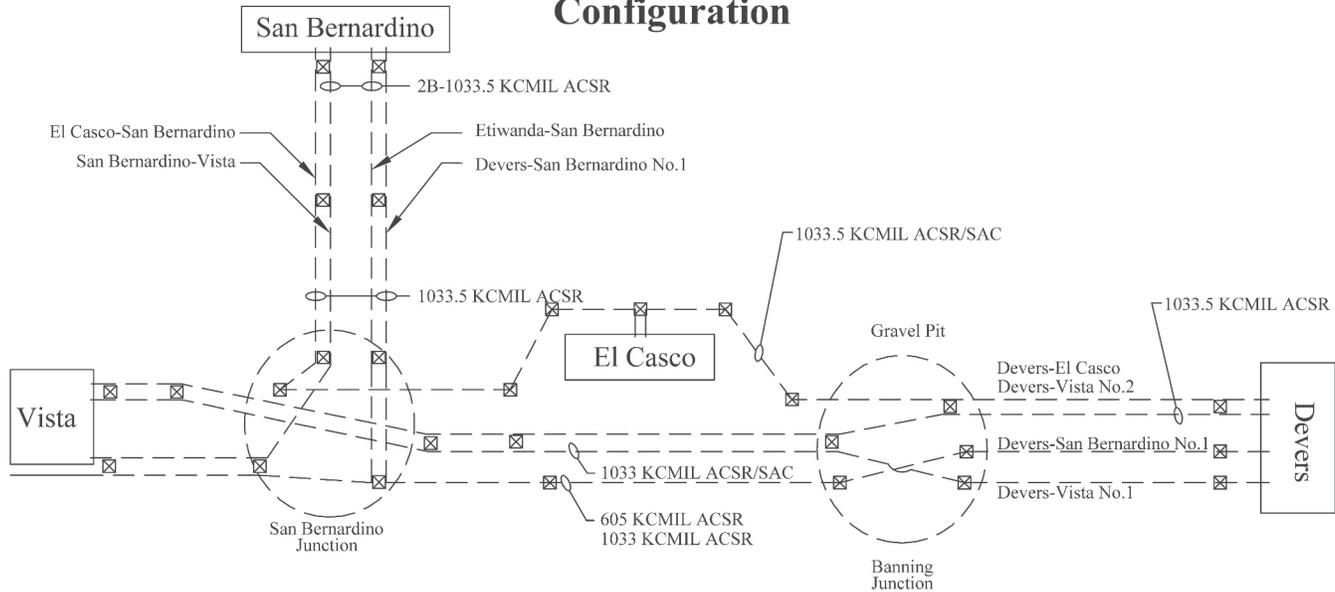

**LEGEND**

- Single Circuit Tower
- Double Circuit Tower
- Under-Crossing
- Existing Conductor
- New Conductor

### Proposed 220 kV Configuration

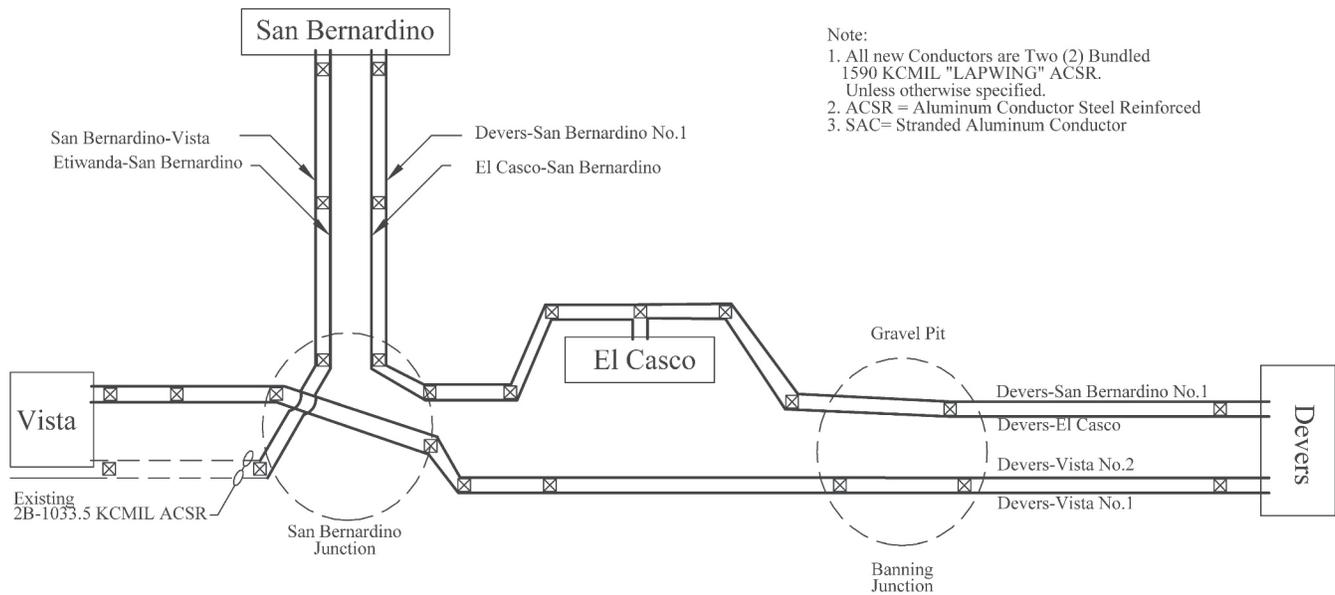

Note:  
 1. All new Conductors are Two (2) Bundled 1590 KCMIL "LAPWING" ACSR. Unless otherwise specified.  
 2. ACSR = Aluminum Conductor Steel Reinforced  
 3. SAC= Stranded Aluminum Conductor

Not to Scale

Source: SCE, 2013.

West of Devers Upgrade Project

Figure B-8  
**Existing and Proposed  
 220 kV Configuration**