
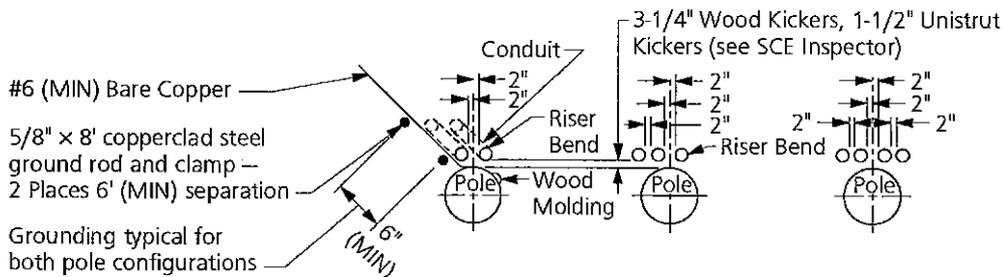


CD 161 Pole Riser Bend for Risers on Kicker Blocks

Scope CD 161.1 Pole Riser Bend for Risers on Kicker Blocks

Figure CD-25: Pole Riser Bend for Risers on Kicker Blocks

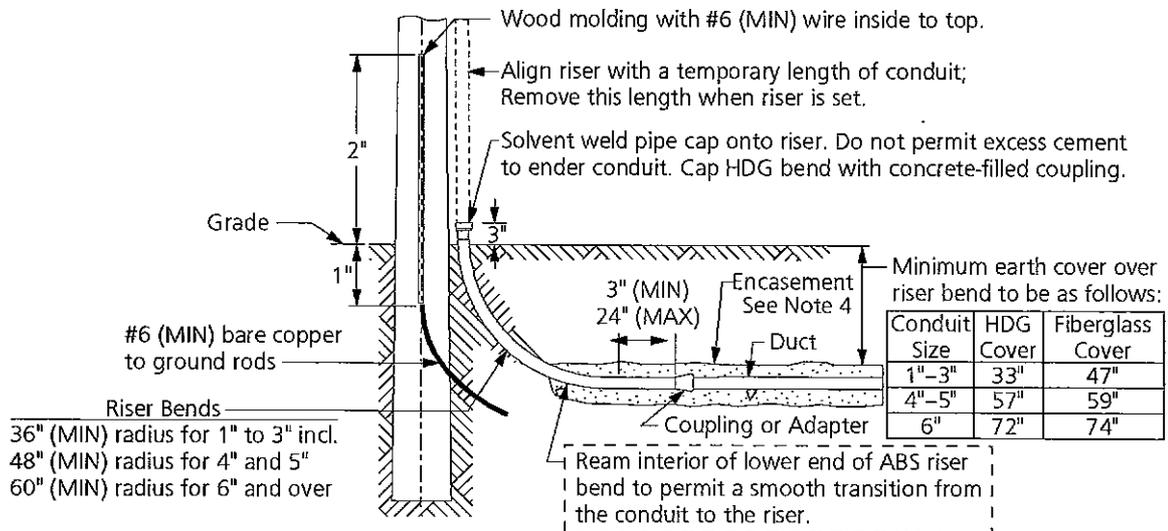

Riser Conduit Spacing Diagram (At Base of Pole)

Notes:

1. Approved riser bend materials and sizes are shown on the following table.

Table CD-6: Approved Riser Bend Materials and Sizes – Risers on Kicker Blocks

Material	Size							
	1"	1-1/2"	2"	2-1/2"	3"	4"	5"	6"
ABS	-	-	-	X	X	X	X	-
Fiberglass	-	-	-	-	X	X	X	X ^{a/}
HDG	X	X	X	X	X	X	X	X ^{a/}

^{a/} Six-inch HDG or Fiberglass riser bend will be used when specified on the working drawing. See AC 702 for grounding HDG riser bends.

— For Reference Only

Approved

PHH

Pole Riser Bend for Risers on Kicker Blocks

Underground Structures Standards

► SCE Public ◀

Effective Date

10-29-2004

UGS

CD 161

Page CD-51