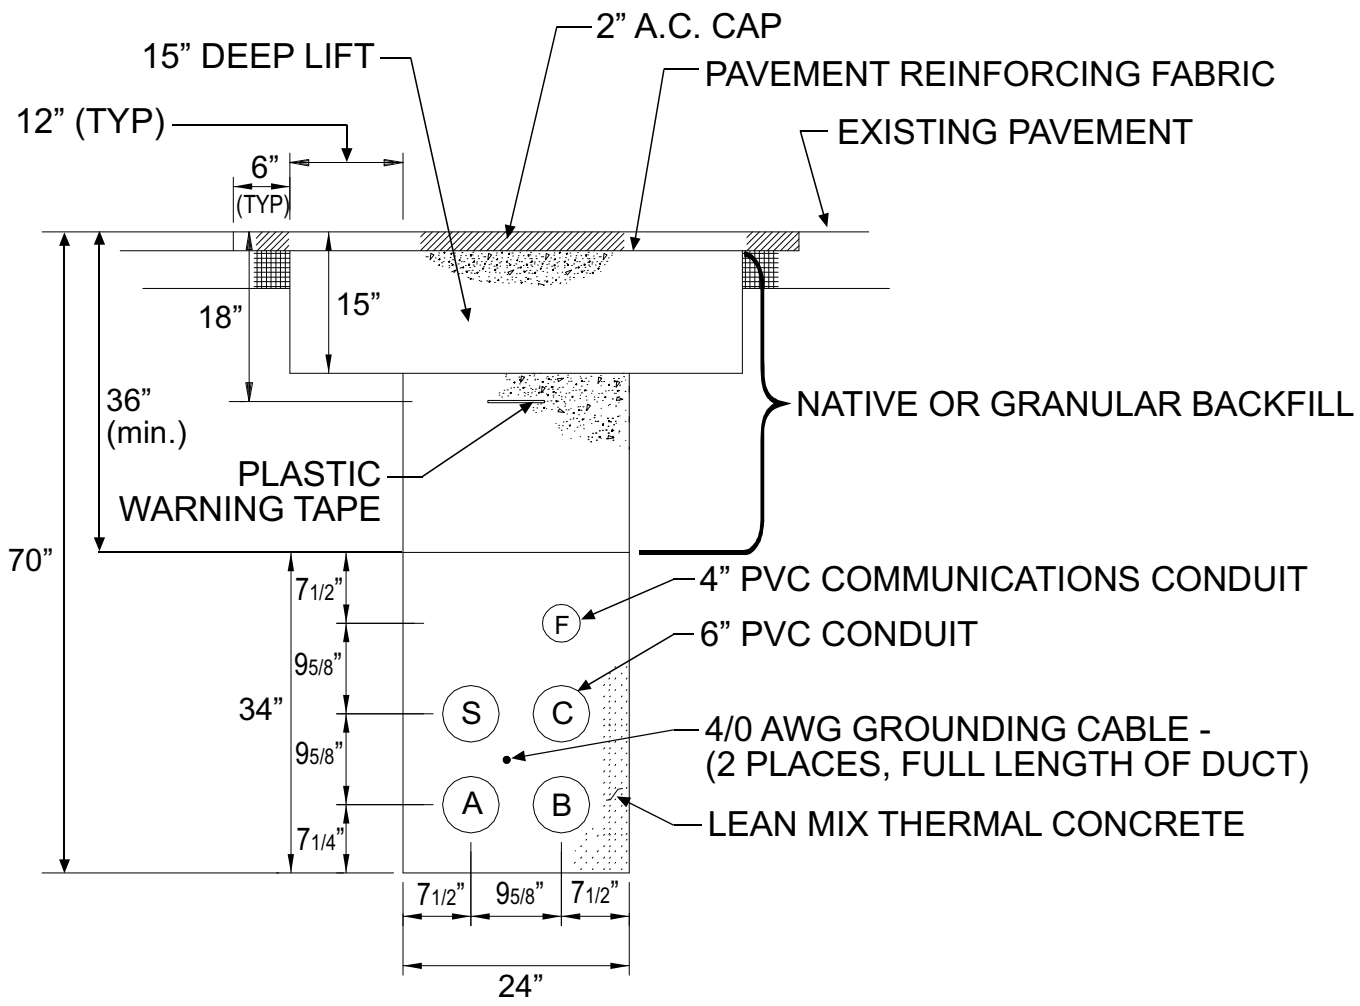

Source: CH2MHILL

Jefferson-Martin 230 kV Transmission Line Project

Figure B-9

Typical Duct Bank Installation of 230 kV Single-Circuit Solid Dielectric Cable

Aspen Environmental Group