

**BEFORE THE PUBLIC UTILITIES COMMISSION
OF THE STATE OF CALIFORNIA**

Order Instituting Rulemaking to Examine
Electric Utility De-Energization of Power
Lines in Dangerous Conditions.

Rulemaking 18-12-005
(Filed December 13, 2018)

**LIBERTY UTILITIES (CALPECO ELECTRIC) LLC'S (U 933-E)
PUBLIC SAFETY POWER SHUTOFF POST-EVENT REPORT FOR
SEPTEMBER 12, 2026 EVENT**

Jordan Parrillo
Manager, Rates & Regulatory Affairs
Liberty Utilities (CalPeco Electric) LLC
701 National Avenue, Tahoe Vista, CA 96148
Telephone: (530) 721-7818
Jordan.Parrillo@libertyutilities.com

Dated: September 25, 2026

**BEFORE THE PUBLIC UTILITIES COMMISSION
OF THE STATE OF CALIFORNIA**

Order Instituting Rulemaking to Examine
Electric Utility De-Energization of Power
Lines in Dangerous Conditions.

Rulemaking 18-12-005
(Filed December 13, 2018)

**LIBERTY UTILITIES (CALPECO ELECTRIC) LLC’S (U 933-E)
PUBLIC SAFETY POWER SHUTOFF POST-EVENT REPORT FOR
SEPTEMBER 12, 2026 EVENT**

Liberty Utilities (CalPeco Electric) LLC (“Liberty”) hereby submits its Public Safety Power Shutoff (“PSPS”) 2025 Post-Event Report pursuant to Commission Decision 21-06-034 in Phase Three of R.18-12-005.

In compliance with California Public Utilities Commission Public Safety Power Shutoff (“PSPS”) Order Instituting Rulemaking Phase 1 Decision (D.) 19-05-042, Phase 2 D.20-05-051, Phase 3 D.21-06-034 and PSPS Order Instituting Investigation D.21-06-014, Liberty Utilities (CalPeco Electric) LLC (“Liberty”) hereby submits this report regarding the PSPS event that occurred in Liberty’s service territory on November 5, 2025. In accordance with D.19-05-042 and D.21-06-014, this report is being distributed to the service lists for the following Commission rulemaking proceedings: R.18-10-007 and R.18-12-005 as well as all affected local and county public safety partners.

Liberty hereby provides the following link to access and download the report and attachments (geodatabase files and Excel workbook) to its PSPS Post-Event Report: [Liberty Post-Event Report on September 12 2026 Potential PSPS Event.pdf](#).

Respectfully submitted,

/s/ Jordan Parrillo

Jordan Parrillo
Manager, Rates & Regulatory Affairs
Liberty Utilities (CalPeco Electric) LLC
701 National Avenue, Tahoe Vista, CA 96148
Telephone: (530) 721-7818
Jordan.Parrillo@libertyutilities.com

Dated: September 25, 2026

Attachment
Public Safety Power Shutoff Post-Event Report, September 12, 2026



Liberty Utilities (CalPeco Electric) LLC
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
Fax: 530-544-4811

September 25, 2026

Leslie Palmer, Director
Safety and Enforcement Division
California Public Utilities Commission
505 Van Ness Avenue
San Francisco, CA 94102

**Re: Liberty Post-Event Report on Potential Public Safety Power Shutoff (“PSPS”) Event
on September 12, 2026**

Dear Director Palmer:

Liberty Utilities (CalPeco Electric) LLC (“Liberty”) respectfully submits the attached report regarding its potential PSPS event on September 12, 2026, in compliance with PSPS Post-Event Reporting requirements in Resolution ESRB-8 and California Public Utilities Commission (“CPUC”) Decision (“D.”) 19-05-042, D.20-05-051, D.21-06-014 and D.21-06-034. This report has been verified by an officer of Liberty in accordance with Rule 1.11 of the Commission’s Rules of Practice and Procedure.

Sincerely,

A handwritten signature in black ink, appearing to read 'Jordan Parrillo', is written over a light gray rectangular background.

Jordan Parrillo
Manager, Regulatory Affairs
Liberty

cc: ESRB_ComplianceFilings@cpuc.ca.gov
Ronald DeMayo, Ronald.DeMayo@cpuc.ca.gov
Anthony Noll, Anthony.Noll@cpuc.ca.gov

**Liberty Utilities (CalPeco Electric) LLC
Public Safety Power Shutoff (“PSPS”) Post-Event Reporting for
September 12, 2026, Potential PPS Event**

**Submitted to:
California Public Utilities Commission
Director of the Safety and Enforcement Division
September 25, 2026**

Table of Contents

1	Executive Summary	5
2	Decision-Making Process	8
3	Description of the Event	18
4	Damage and Hazards to Overhead Facilities	21
5	Notifications	22
6	Local and State Public Safety Partner Engagement	27
7	Complaints and Claims	30
8	Power Restoration	31
9	Community Resource Centers	32
10	Mitigations to Reduce Impact to Customers	36
11	Lessons Learned from this Event	37
12	Other Relevant Information	38
13	Officer Verification	39
14	Appendix A – Customer Notifications	1
15	Appendix B – Public Safety Partner Notifications	2
16	Appendix C – CPUC Notifications	3
17	Appendix D – Local and State Public Safety Partner Engagement	4
18	Appendix E - PSPS Event Data Workbook (Excel File)	5



Liberty Utilities (CalPeco Electric) LLC
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
Fax: 530-544-4811

Introduction

Liberty Utilities (CalPeco Electric) LLC ("Liberty") submits this post-event report in compliance with California Public Utilities Commission's PSPS post event requirements, including Resolution ESRB-8 and California Public Utilities Commission ("CPUC") Decision ("D.") 19-05-042, D.20-05-051, D.21-06-014 and D.21-06-034.¹

This report addresses the event that started on September 9, 2026, when Liberty activated its Public Safety Power Shutoff ("PSPS") Incident Management Team ("IMT") to monitor the forecasted extreme weather conditions and ended on September 12, 2026, when the IMT was demobilized after the decision to cancel the de-energization of all impacted customers. The potential PSPS event could have impacted 1,663 customers within the Verdi (CA) area in Sierra County, the Floriston area in Nevada County, the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) areas in Alpine County and the Topaz, Coleville, and Walker areas in Mono County. All customers were notified of the potential PSPS event and of the cancellation of the potential PSPS event according to the minimum notification requirements in D.19-05-042. Additionally, Liberty notified its Public Safety Partner ("PSPs") and coordinated with Community Based Organizations ("CBOs") throughout the event. This report explains Liberty's decision to call, sustain, and conclude the potential de-energization event without ultimately de-energizing any customers, and provides detailed information to facilitate the Commission's evaluation of Liberty's compliance with applicable PSPS guidelines.

Liberty recognizes that de-energization and the potential for de-energization pose significant challenges and hardships for customers and the public safety partners that provide services to the affected communities. As such, Liberty's decision to activate its PSPS protocol for this event is based on the consideration of multiple factors explained in Section 2 of this report, including wildfire risk modeling indicating a likelihood of fire spread and a high difficulty of suppression if an ignition occurred during the initially forecasted conditions.

Liberty is committed to continuously improving its PSPS processes and welcomes input from customers, public safety partners, community representatives, and local governments on ways to minimize the impact of PSPS events.

¹ This PSPS post-event report is based on the information and data available as of the submission of the report. Liberty continues to gather, analyze, and validate some of the underlying data, and will supplement this report with updated information, as needed.

1 Executive Summary

1.1 Brief description of the PSPS event starting from the time when the utility's Emergency Operation Center is activated until service to all customers have been restored.

On September 8, 2026 at 1500 hours, Liberty held its weekly fire season weather briefing and identified forecast conditions to monitor that could increase the high fire risk for the MULLER1296, TPZ1202, CAL2501 and WSH201 circuits in Liberty's service territory. On September 9, 2026, at 1400 hours, Liberty's fire science experts met again to assess the identified conditions. The conditions included forecasted high wind gusts and low relative humidity for the Verdi (CA) area in Sierra County, the Floriston area in Nevada County, the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) areas in Alpine County and the Topaz, Coleville, and Walker areas in Mono County. The fuel moisture levels of vegetation in the impacted areas were also critically low. Together, Liberty recognized that these conditions created an elevated fire-weather environment. These conditions were initially forecasted to begin on September 12, 2026 at 0900 hours and the potential PSPS event could have impacted 1,663 customers.

In response to these forecasted conditions, on September 9, 2026, at 1500 hours, Liberty activated its dedicated PSPS Incident Management Team ("IMT") to monitor the forecasted extreme weather conditions in the aforementioned areas and manage the event. On September 9, 2026, around 1900 hours and approximately 62 hours prior to the anticipated weather event, Liberty began sending notifications of the potential PSPS to Public Safety Partners ("PSPs"), Critical Facilities and Infrastructure ("CFI") customers and all other customers in scope and began coordinating with Community Based Organizations ("CBOs") in the potentially impacted areas. The IMT continued to closely monitor the forecasted conditions and Liberty continued to notify impacted partners and customers throughout the event.

Due to improved weather conditions throughout the event, Liberty ultimately cancelled the September 12, 2026 potential PSPS event without de-energizing any customers. On September 11, 2026, Liberty received a weather briefing at 1330 hours indicating that critical fire weather conditions were no longer forecasted to reach PSPS thresholds for the Verdi (CA) and Floriston areas. Following its September 11, 2026 IMT meeting at 1530 hours, Liberty notified the 165 customers in those areas and public safety partners that the potential PSPS event was cancelled. The IMT continued to closely monitor conditions in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas. On September 12, 2026, Liberty received a weather briefing at 0630 hours indicating that critical fire weather conditions were no longer forecasted to reach PSPS thresholds in those aforementioned areas either. Liberty's IMT met promptly at 0700 hours and subsequently Liberty notified the 1,498 customers in those areas and public safety partners that the potential PSPS event was cancelled.

Liberty's IMT de-mobilized on September 12, 2026, at approximately 0900 hours, although its operations and vegetation management teams continued to closely monitor conditions in its service territory.

- 1.2 A table including the maximum numbers of customers notified and actually deenergized; number of counties de-energized; number of tribes de-energized; number of Medical Baseline customers de-energized; number of transmission and distribution circuits de- energized; damage/hazard count; number of critical facilities and infrastructure de-energized. Hazards are conditions discovered during restoration patrolling or operations that might have caused damages or posed an electrical arcing or ignition risk had PSPS not been executed.


Table 1-1: PSPS Event Summary

Total Customers			De-energized				Number of Circuits			Damage/ Hazard Count
PSPS Notified	De- energized	Cancelled	MBL Customers	Number of Counties	Number of Tribes	Critical Facilities and Infrastructure	Transmission De-energized	Distribution Circuits in Scope	Distribution Circuits De- energized	
1,663	0	1,663	0	0	0	0	0	4	0	0

1.3 A PDF map depicting the de-energized area(s).

The map below depicts the areas in Alpine County, Mono County, Nevada County and Sierra County that were monitored and potentially impacted by the September 12, 2026 PSPS event. Ultimately, no areas were de-energized during the event.

Figure 1-1: Map of Monitored Liberty Areas, September 12, 2026 Potential PSPS Event

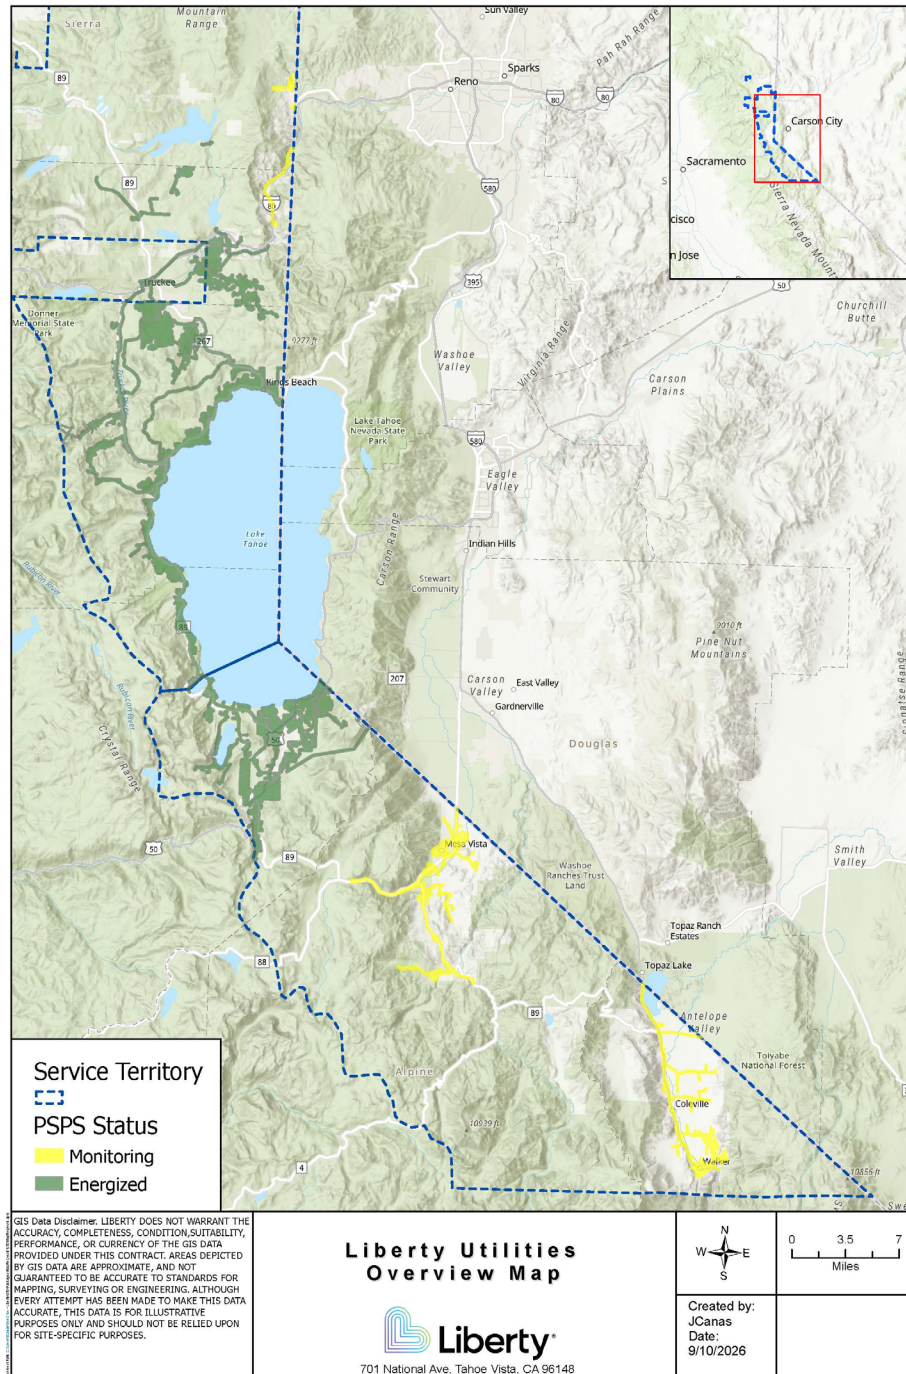

2 Decision-Making Process

- 2.1 A table showing factors considered in the decision to shut off power for each circuit de-energized, including sustained and gust wind speeds, temperature, humidity, and moisture in the vicinity of the de-energized circuits.

Not applicable. Liberty did not de-energize any circuits during the September 12, 2026 potential PSPS event.

Table 2-1: Factors Considered in Decision to De-Energize

Circuit De-energized	Sustained Wind Speed (mph)	Gust Wind Speed (mph)	Relative Humidity (%)	FFWI	Live Woody Fuel Moisture	1000hr Fuel Moisture (%)	Temperature (°F)
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

- 2.2 Decision criteria and detailed thresholds leading to de-energization including the latest forecasted weather parameters versus actual weather. Also include a PSPS decision-making diagram(s)/flowchart(s) or equivalent along with narrative description.

Earlier forecasts indicated the potential for widespread critical fire weather conditions across the service territory. As the event approached, successive forecast updates reduced the expected severity of the wind event. Observed weather on September 12, 2026 confirmed this trend, with sustained wind speeds generally remaining below critical thresholds and only isolated locations experiencing gusts above 40 mph. Given the improved forecast confidence and observed conditions, Liberty determined that protective equipment device settings provided sufficient risk mitigation without requiring customer de-energization.

While Liberty did not de-energize any circuits during the September 12, 2026 potential PSPS event, Liberty provides its decision criteria and thresholds leading to the decision to notify its customers of the potential PSPS event and the ultimate decision to not de-energize any customers during the event. Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index ("CRI"). Liberty utilizes the CRI when assessing the potential need for de-energization. The CRI is a forecastable estimate of risk from utility caused fires using forecast wind gusts to estimate the potential of a power line starting a fire and flame length, which is then used to evaluate how severe that fire could become. It is cast in terms of a percentage of zone-specific thresholds and is intended to be used as a screening criterion, rather than an explicit threshold. When CRI is forecast to approach 100% of that threshold, additional factors are considered to determine whether proactive de-energization is appropriate. Table 2-2 provides a general overview of Liberty's weather monitoring criteria.


Table 2-2: Fire Weather Monitoring

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Decision-making diagram:

A CRI near 100% of the zone-specific screening threshold, or other elevated risk, prompts closer review. Figure 2-1 summarizes how updated forecasts, fuel and system conditions, and available mitigations guide the decision. A CRI below 100% does not, by itself, rule out a PSPS.

Figure 2-1: Forecast-informed PSPS decision diagram

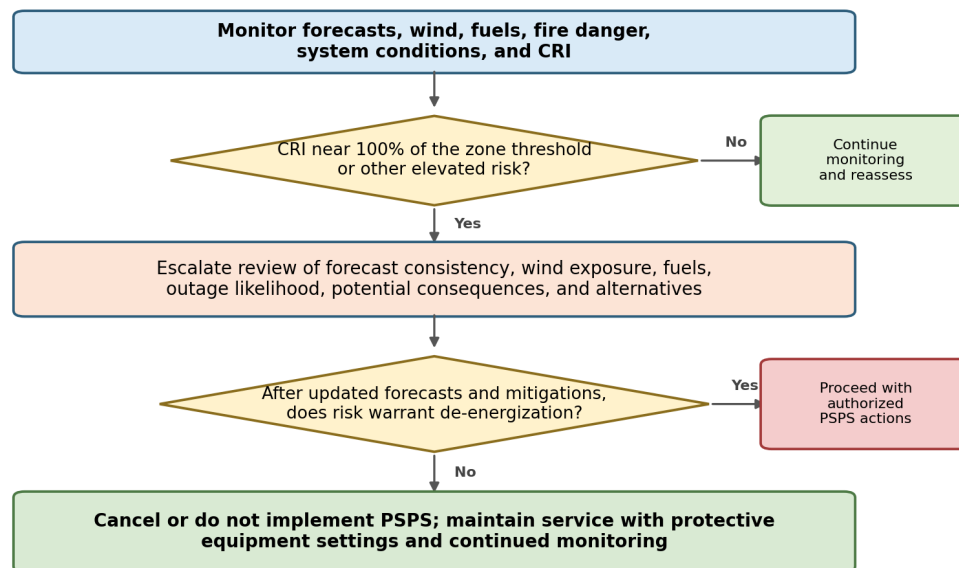

Fuel conditions:

Liberty conducts weekly fuel moisture sampling throughout the fire season to assess the condition of representative fuels across its service territory and evaluate how receptive they are to burning and their potential influence on fire behavior. These data support the calculation and interpretation of key fire danger indices, including the Energy Release Component (“ERC”), Spread Component (“SC”), Burn Index (“BI”), and Ignition Component (“IC”), providing additional insight into wildfire risk and fire potential.

Dry fuels remained a concern throughout the event. September 7 samples showed conditions favorable to ignition and rapid fire spread, with high resistance to control should ignition occur. Table 2-3 summarizes fuel moisture at the two sampling sites nearest the subject circuits. At Topaz, sagebrush fuel moisture was 71% and 1,000-hour dead fuel moisture was 5%, both close to record lows. Fuel moisture was higher at Verdi: 117% for sagebrush and 7% for 1,000-hour dead fuels. Even so, the large Hawk, Bug, Fred, and Stallion fires in August heightened concern near Verdi and the CAL2501 and WSH201 circuits. The Floriston Fire occurred in the same area on September 16, 2026, four days after the potential PSPS event.

Table 2-3: Recent Fuel Moisture Sampling Results

Fuel Moisture Sampling Site	Date of Sample	Circuits	Live woody fuel %	1,000 hour fuel %	ERC(Y) percentile	Spread Component	Burn Index	Ignition Component
Topaz	9/7/26	MULLER1296 TPZ1202	71	5	83	2	29	10
Verdi	9/7/26	CAL2501 WSH201	117	7	80	2	23	6

Forecast evolution:

Figure 2-2 shows the September 12 CRI forecasts from cycles issued September 8–12. Table 2-4 lists the values for each circuit and cycle.

The September 8 18Z cycle had the highest September 12 CRI among the forecasts shown: 135% of the screening threshold in MULLER1296, 126% in TOPAZ1202, 109% in CAL2501, and 54% in WSH201. Values above the threshold in three circuits prompted concern and evaluation of a potential PSPS. The WSH201 circuit was included as in scope for this potential PSPS event because it is sourced from the CAL2501 circuit.

Forecast CRI generally declined after that cycle, although some updates showed brief increases. By September 10 00Z, the highest value across the four circuits was 65%. It rose to 81% at 12Z before falling again. The highest value was 51% at September 12 06Z and 48% at 12Z, the last cycle shown. All four circuits were below the 100% screening level in these September 12 updates.

Figure 2-2: Evolution of September 12, 2026 CRI Forecast

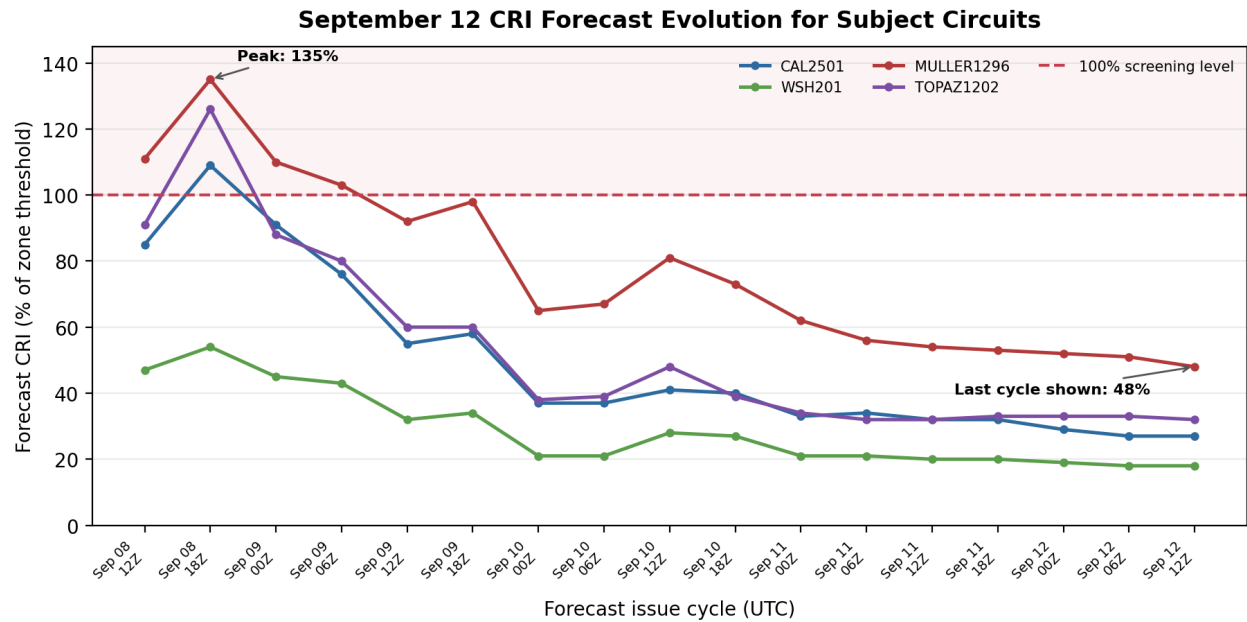


Table 2-4: September 12, 2026 CRI by forecast cycle (% of zone threshold)

Forecast cycle (UTC)	CAL2501	WSH201	MULLER1296	TOPAZ1202	Highest
09/08/26 12Z	85	47	111	91	111
09/08/26 18Z	109	54	135	126	135
09/09/26 00Z	91	45	110	88	110
09/09/26 06Z	76	43	103	80	103
09/09/26 12Z	55	32	92	60	92
09/09/26 18Z	58	34	98	60	98
09/10/26 00Z	37	21	65	38	65
09/10/26 06Z	37	21	67	39	67
09/10/26 12Z	41	28	81	48	81
09/10/26 18Z	40	27	73	39	73
09/11/26 00Z	33	21	62	34	62
09/11/26 06Z	34	21	56	32	56
09/11/26 12Z	32	20	54	32	54
09/11/26 18Z	32	20	53	33	53
09/12/26 00Z	29	19	52	33	52
09/12/26 06Z	27	18	51	33	51
09/12/26 12Z	27	18	48	32	48

Forecasted weather versus actual weather:

Observed weather conditions on September 12 confirmed the high-resolution forecasts. While isolated stations recorded wind gusts exceeding 40 mph, most locations experienced sustained winds generally between 18 and 29 mph, and the anticipated widespread, prolonged high-wind event did not materialize.

Tables 2-5 through 2-8 compare the four models with observations at seven stations. They use the September 12, 2026, 06Z cycle, corresponding to 2300 hours PDT on September 11, and cover the 24 hours beginning at midnight PDT on September 12. Forecast cycle times are in UTC; the times of the forecast and observed weather are in PDT. The tables compare daily maximum wind gusts, wind speeds, and temperatures, and daily minimum relative humidity. Forecast and observed extrema may occur at different times, so differences between them are not hourly forecast errors. Stations LIB05, LIB06, and LIB26 provide Topaz-area context. LIB03, LIB25, and LIB28 are associated with MULLER1296. Finally, LIB21 is associated with WSH201.

Observed peak gusts on September 12 (Table 2-4) ranged from 29 mph at Walker to 43 mph at Park Ranch. NBM overpredicted the peak at four stations and underpredicted it at three. Its largest overprediction was at Walker: 43 mph forecast versus 29 mph observed. HRRR underpredicted peak gusts at all seven stations. The 3 km NAM overpredicted them at Walker and Eastside Lane and underpredicted them at the other five. Euro forecasts were below the observed peaks at Park Ranch, Woodfords, and Emigrant Trail, above them at Walker, Markleeville, and Floriston, and equal to the rounded peak at Eastside Lane.

Table 2-5: Maximum 20-foot wind gust (mph)

Station and location	Observed	NBM	HRRR	3 km NAM	ECMWF / Euro
LIB05 Park Ranch	43	40	31	31	27
LIB06 Walker	29	43	28	33	34
LIB26 Eastside Lane	34	36	25	35	34
LIB03 Woodfords	40	44	30	33	34
LIB25 Emigrant Trail	39	43	31	31	34
LIB28 Markleeville	38	36	26	31	44
LIB21 Floriston	35	30	28	32	44

Maximum observed sustained wind speeds (Table 2-5) ranged from 18 to 29 mph. At Floriston, all four models forecast lower maxima, ranging from 12 to 19 mph compared with 29 mph observed. These measurements describe conditions at the stations, not across entire circuits.

Table 2-6: Maximum 20-foot wind speed (mph)

Station and location	Observed	NBM	HRRR	3 km NAM	ECMWF / Euro
LIB05 Park Ranch	23	24	20	18	10
LIB06 Walker	21	28	16	14	11
LIB26 Eastside Lane	20	26	18	17	11
LIB03 Woodfords	23	28	21	18	12
LIB25 Emigrant Trail	26	26	22	18	12
LIB28 Markleeville	18	16	15	15	14
LIB21 Floriston	29	19	18	17	12

Observed minimum relative humidity ranged from 10% to 17%. NBM forecast higher minima at every station, by 2–8 percentage points. HRRR and Euro were each within 3 percentage points of observations at all seven stations. The 3 km NAM forecast 21% at Markleeville versus 14% observed, but 14% at Floriston versus 17% observed.

Observed maximum temperatures ranged from 77°F to 85°F. NBM forecasts were within 4°F of the observed maxima. Euro forecast lower maxima at every station, including 73°F at Walker and Eastside Lane, where both stations reached 83°F. HRRR and the 3 km NAM were closer at those locations, but both underpredicted the maximum at Floriston.

Table 2-7: Minimum relative humidity (%)

Station and location	Observed	NBM	HRRR	3 km NAM	ECMWF / Euro
LIB05 Park Ranch	12	15	12	16	9
LIB06 Walker	11	17	10	12	12
LIB26 Eastside Lane	10	14	11	13	12
LIB03 Woodfords	12	18	15	17	11
LIB25 Emigrant Trail	11	19	14	15	11
LIB28 Markleeville	14	16	15	21	12
LIB21 Floriston	17	22	18	14	16

Table 2-8: Maximum temperature (°F)

Station and location	Observed	NBM	HRRR	3 km NAM	ECMWF / Euro
LIB05 Park Ranch	85	84	83	82	81
LIB06 Walker	83	79	82	83	73
LIB26 Eastside Lane	83	81	82	79	73
LIB03 Woodfords	79	81	79	79	77
LIB25 Emigrant Trail	82	81	81	82	77
LIB28 Markleeville	78	78	79	76	72
LIB21 Floriston	77	77	73	72	71

Figures 2-3 and 2-4 show the Woodfords time series (MULLER1296). On September 12, humidity fell from morning into afternoon, while gusts increased through the afternoon into evening. Black plus signs mark observations. The legends identify NBM, HRRR, 3 km NAM, ECMWF, and the other models shown on the dashboard.

Figure 2-3: Woodfords wind gust forecasts and observations


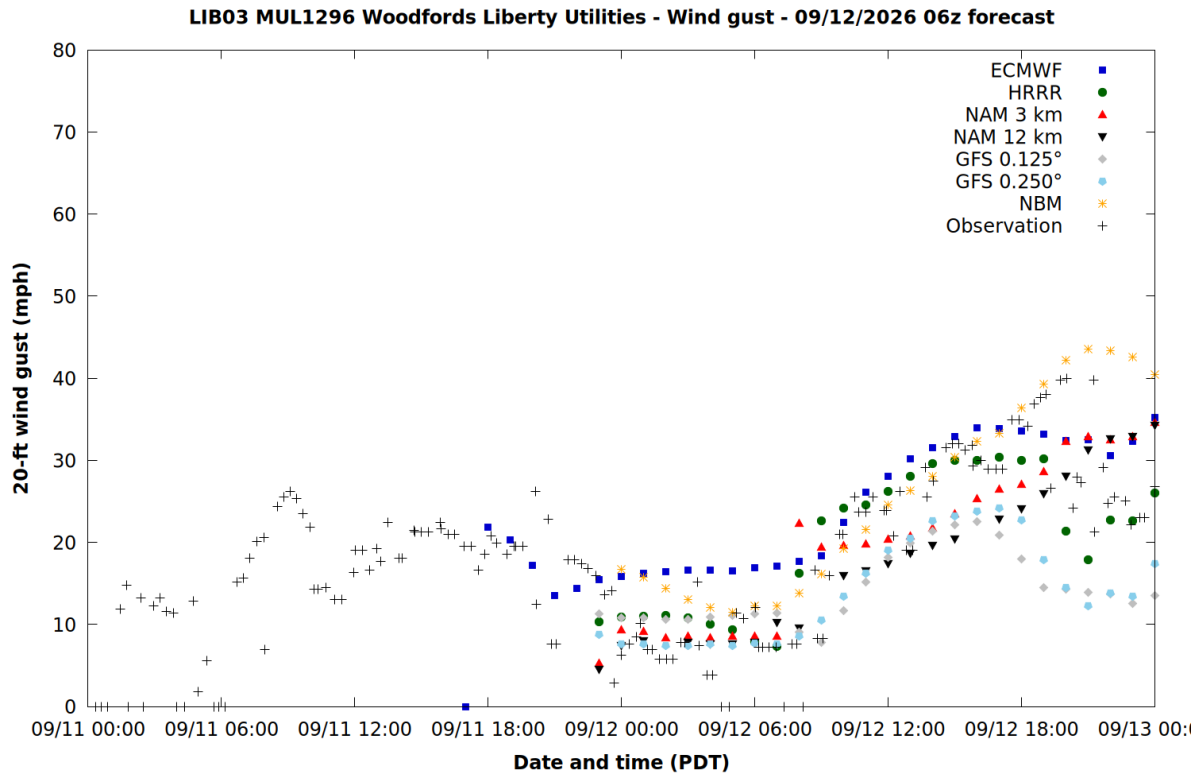


Figure 2-4: Woodfords relative humidity forecasts and observations

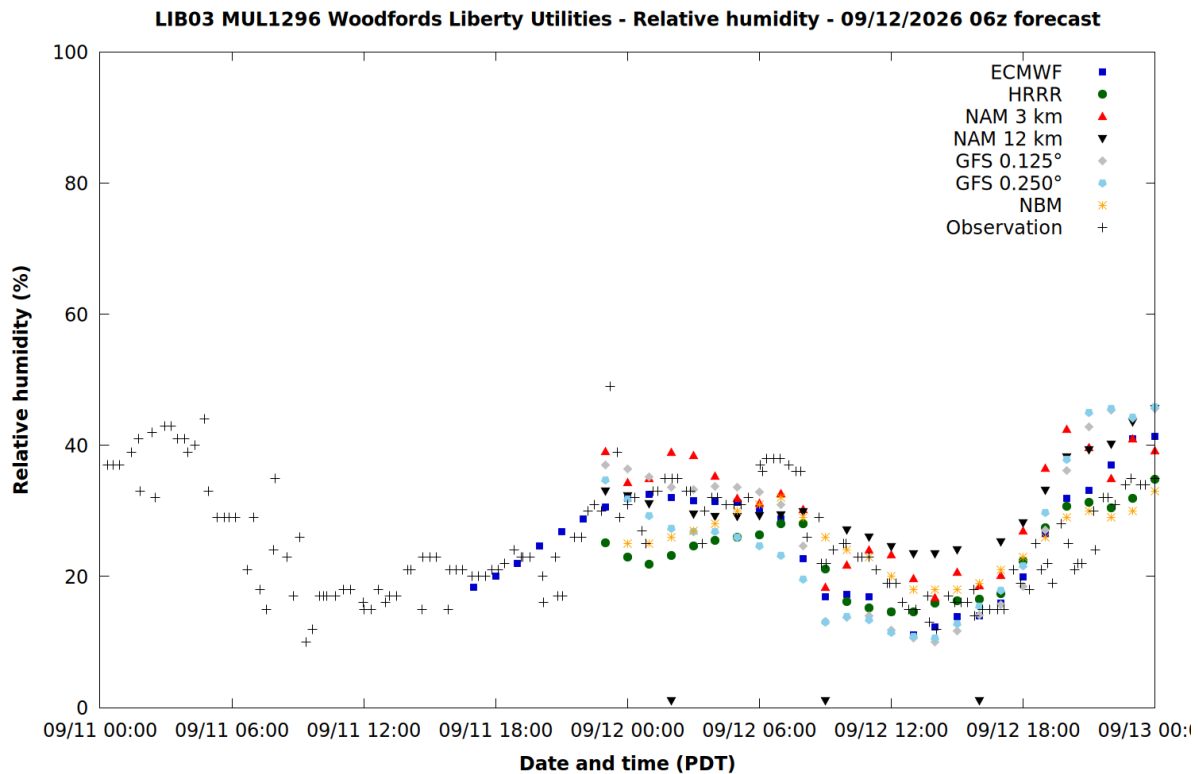

Based on the improved forecast confidence and observed field conditions, Liberty determined that wildfire risk could be effectively mitigated through implementation of protective equipment device settings, including fast-trip settings, while maintaining electric service. Accordingly, Liberty determined that the residual risk did not warrant implementation of a Public Safety Power Shutoff, thereby avoiding the potential public safety, reliability, and customer impacts associated with de-energization.

2.3 A thorough and detailed description of the quantitative and qualitative factors Liberty considered in calling, sustaining, or curtailing each de-energization event including any fire risk or PSPS risk modeling results, and a specification of the factors that led to the conclusion of the de-energization event.

The quantitative factors that were considered include forecast vs. actual weather conditions and field observations, as discussed above in Section 2.2. In addition, Section 2.4 below provides a discussion of quantitative risk modeling estimates that inform the decision to proactively de-energize or not.

2.4 An explanation of how the utility determined that the benefit of de-energization outweighed potential public safety risks, and analysis of the risks of de-energization against not de-energizing. The utility must identify and quantify customer, resident, and the general public risks and harms from de-energization and clearly explain risk models, risk assessment processes, and how the power disruptions to customers, residents, and the general public is weighed against the benefits of a proactive de-energization.

Liberty did not find that the benefits of de-energization outweighed potential public safety risks. Nevertheless, Liberty provides quantitative estimates from its risk model for the four primary circuits of concern on September 12.

Liberty shows three scenarios below using Liberty's risk model and forecasted wildfire conditions. The risk model estimates that if a wildfire had ignited on September 12 under the forecasted wildfire conditions, potential consequences ranged from \$14 million to \$106 million, with the highest potential consequences at Verdi on CAL2501.

Liberty's risk model relies on mitigation effectiveness parameters of 75% and 56% for PSPS and SRP/fast-trip, respectively (see Liberty 2027 Base WMP), so Liberty projects that a PSPS event could have reduced adverse wildfire outcomes to about \$3 million to \$27 million across the four circuits. Liberty's mitigation effectiveness of 75% is based on Liberty's lack of historical experience conducting PSPS events, but a higher 95% assumption does not materially change the conclusions below.

Proactive de-energization introduces public safety risk through outage program risk, which Liberty also quantifies in Table 2-9. This ranges from \$250,000 to \$3.3 million across the four circuits, and is primarily driven by customer counts at each circuit. Liberty coarsely estimates fast-trip/SRP outage program risk as five percent of PSPS outage program risk while Liberty is developing this portion of the risk model. This likely overstates outage program risk from fast-trip/SRP, but it is used as a conservative assumption.

Table 2-9: Estimated wildfire consequence and outage program risk for September 12

Circuit	Forecasted Wildfire Consequence (\$ Millions)			Estimated Outage Program Risk (\$ Millions)	
	No Mitigation	With PSPS (75% effective)	With Fast-Trip (56% effective)	PSPS	Fast-Trip
WSH201	14.1	3.5	6.2	0.36	0.02
TPZ1202	63.9	16.0	28.1	3.30	0.17
MULLER1296	83.5	20.9	36.7	2.58	0.13
CAL2501	106.2	26.6	46.7	0.25	0.01

Given the forecasted wildfire consequences and the forecasted outage program risk, Liberty then solves for the ignition probability that would set wildfire consequence and outage program risk equivalent. In other words, if Liberty projects the consequences of a wildfire to be \$100 million and the outage

program risk of de-energization to be \$250 thousand, how likely would a wildfire have to be such that the benefits of de-energization outweigh the outage and public safety risks?

Liberty estimates the breakeven ignition probabilities in Table 2-10, with the assumption that the decision hinges between calling a PSPS event vs. not calling a PSPS event but enabling fast-trip/SRP. For example, Liberty estimates that there would need to be an ignition likelihood of 26% or higher on TPZ1202 on September 12 to warrant the decision to proactively de-energize the circuit instead of leaving the circuit energized but enabling fast-trip/SRP. At CAL2501, the hinge point occurs at a much lower probability (approximately 1%) because forecasted wildfire conditions were higher (Table 2-9) and the relatively smaller customer base compared to TPZ1202 indicates lower outage program risk from de-energizing.

With these “breakeven” ignition probabilities estimated, Liberty can then compare them to ignition probabilities as estimated by Liberty’s risk model. If Liberty’s risk model suggests higher ignition probabilities than the “breakeven” probabilities, then a PSPS event may be warranted. However, it is worth underscoring that this approach does not represent a firm decision point on whether to proactively de-energize. In practice, the risk model may not accurately account for extreme tail risk during a potential PSPS event due to the limitations of wildfire simulation models and due to forecast uncertainty. Nevertheless, if the breakeven and estimated ignition probabilities are orders of magnitude apart, it can inform Liberty’s decision to de-energize or not.

As Table 2-10 shows, the ignition probabilities are two to three orders of magnitude different. Thus, from a risk modeling and quantitative perspective, the decision to not de-energize in favor of enabling fast-trip/SRP was appropriate.

Table 2-10: Estimated ignition probabilities

Circuit	Ignition Probability	
	Breakeven - PSPS vs. Fast-Trip	Risk Model Estimate
WSH201	12.9%	0.007%
TPZ1202	25.9%	0.174%
MULLER1296	15.5%	0.075%
CAL2501	1.2%	0.011%

2.5 Explanation of alternatives considered and evaluation of each alternative.

As discussed above, Liberty utilizes a PSPS as a last case resort. In this potential PSPS event, Liberty considered one potential alternate. Liberty considered the use of fast trip settings during the period of elevated fire danger. Fast trip settings adjust protective device sensitivity to operate more quickly during fault conditions, reducing the duration of electrical arcing that could lead to an ignition. This approach can lower wildfire ignition probability while allowing circuits to remain energized. The increased sensitivity of protective equipment devices carries a reliability concern of more frequent, extended, and unpredictable outages for which customers may not be adequately prepared.

3 Description of the Event


3.1 The summary of time, place, and duration of the event, broken down by phase if applicable.

As discussed in Section 1.1. above, this event encompassed Liberty's TPZ1202 circuit in Mono County, MULLER1296 circuit in Alpine County, CAL2501 circuit in Sierra County, and WSH201 circuit in Nevada County.

- On September 9, 2026, at 1400 hours, Liberty's fire science experts identified conditions that would increase the high fire risk for the MULLER1296, TPZ1202, CAL2501 and WSH201 circuits in Liberty's service territory. The conditions included forecasted high wind gusts and low relative humidity for the Verdi (CA) area in Sierra County, the Floriston area in Nevada County, the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) areas in Alpine County and the Topaz, Coleville, and Walker areas in Mono County. These conditions were initially forecasted to begin on September 12, 2026 at 0900 hours and the potential PSPS event could have impacted 1,663 customers.
- In response to these forecasted conditions, on September 9, 2026, at 1500 hours, Liberty activated its dedicated PSPS Incident Management Team ("IMT") to monitor the forecasted extreme weather conditions in the aforementioned areas and manage the event. On September 9, 2026, around 1900 hours and approximately 62 hours prior to the anticipated weather event, Liberty began sending notifications of the potential PSPS to Public Safety Partners ("PSPs"), Critical Facilities and Infrastructure ("CFI") customers and all other customers in scope and began coordinating with Community Based Organizations ("CBOs") in the potentially impacted areas. The IMT continued to closely monitor the forecasted conditions and Liberty continued to notify impacted partners and customers throughout the event.
- Due to improved weather conditions throughout the event, Liberty ultimately cancelled the September 12, 2026 potential PSPS event without de-energizing any customers. On September 11, 2026, Liberty received a weather briefing at 1330 hours indicating that critical fire weather conditions were no longer forecasted to reach PSPS thresholds for the Verdi (CA) and Floriston areas. Following its September 11, 2026 IMT meeting at 1530 hours, Liberty notified the 165 customers in those areas and public safety partners that the potential PSPS event was cancelled. The IMT continued to closely monitor conditions in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas. On September 12, 2026, Liberty received a weather briefing at 0630 hours indicating that critical fire weather conditions were no longer forecasted to reach PSPS thresholds in those aforementioned areas either. Liberty's IMT met promptly at 0700 hours and subsequently Liberty notified the 1,498 customers in those areas and public safety partners that the potential PSPS event was cancelled.
- Liberty's IMT de-mobilized on September 12, 2026, at approximately 0900 hours, although its operations and vegetation management teams continued to closely monitor conditions in its service territory.

Figure 3-1 shows the areas in Alpine County, Mono County, Nevada County and Sierra County that were monitored and potentially impacted by the September 12, 2026 PSPS event. Ultimately, no areas were de-energized during the event.

Figure 3-1: Map of Monitored Liberty Areas, September 12, 2026 Potential PSPS Event

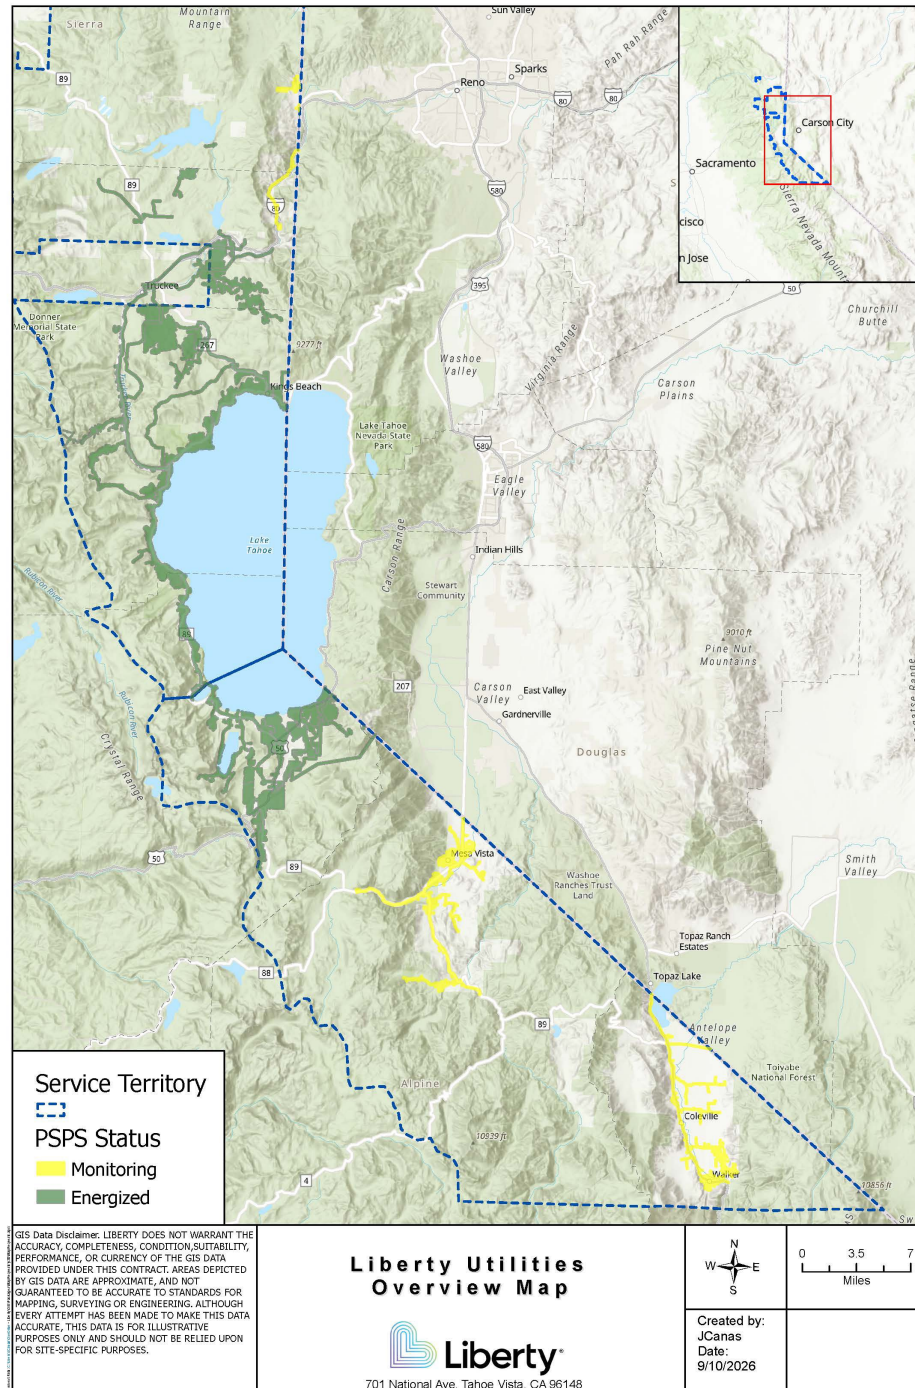

- 3.2 A zipped geodatabase file that includes PPS event polygons of de-energized areas. The file should include items that are required in Section 3.3.

Not applicable; Liberty did not de-energize any customers during this event.

- 3.3 A list of circuits de-energized, with the following information for each circuit. This information should be provided in both a PDF and excel spreadsheet.

Not applicable; Liberty did not de-energize any customers during this event.

4 Damage and Hazards to Overhead Facilities

- 4.1 Description of all found wind-related damages or hazards to the utility's overhead facilities in the areas where power is shut off.

Not applicable; no areas were de-energized during this event.

- 4.2 A table showing circuit name and structure identifier (if applicable) for each damage or hazard, county that each damage or hazard is located in, whether the damage or hazard is in a High Fire Threat District (HFTD) or non-HFTD and the type of damage/hazard.

Not applicable; no areas were de-energized during this event.

- 4.3 A zipped geodatabase file that includes the PSPS event damage and hazard points. The file should include fields that are in the table above.

Not applicable; no areas were de-energized during this event.

- 4.4 A PDF map identifying the location of each damage or hazard.

Not applicable; no areas were de-energized during this event.

5 Notifications

- 5.1 A description of the notice to public safety partners, local/tribal governments, paratransit agencies that may serve all the known transit or paratransit dependent persons that may need access to a community resource center, multi-family building account holders/building managers in the AFN community, and all customers, including the means by which utilities provide notice to customers of the locations/hours/services available for CRCs, and where to access electricity during the hours the CRC is closed.

Liberty understands that before and during a PSPS event, communication with impacted customers and other necessary parties is critical, so that if or when de-energization occurs, the event is as orderly and safe as possible. During this potential PSPS event, Liberty made significant effort to notify public safety partners, local/tribal governments, critical facilities and infrastructure, and customers in accordance with the minimum timelines set forth by the CPUC weather and other factors permitting.

In the customer notifications, Liberty directs potentially impacted customers to Liberty's website for information related to the location, hours and services available at the two available Community Resource Centers, and to Liberty's outage map to identify energized areas for power during hours when CRCs are closed. See Appendix A for notifications to customers. The notices and ongoing communications with customers directed customers to the [Liberty PSPS webpage](#) for real-time information related to CRCs.

In addition, as part of Liberty's PSPS notification process, all account holders including multi-family building account holders, received notices prior to de-energization.

See Appendix B for notifications to Public Safety Partners.

See Appendix C for notifications to the CPUC.

Please see the table below for a description of the types of notices provided during this event.

Table 5-1: Description of PSPS Notifications

Type of Notification	Recipients	Description
Initial Notice for PSPS Event	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Initial notification of potential PSPS event when circuits are first identified for potential de-energization. (72-48 hours in advance of potential de-energization)
	All customers	
Updated Notices for PSPS Event	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Updated notifications of potential PSPS event for circuits identified for potential de-energization. (48-24 hours and within 24 hours in advance of potential de-energization)
	All customers	
Event Cancelled/ Concluded	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Notification that the potential PSPS event has been cancelled and PSPS protocols are no longer enacted for this event. (Within two hours of the decision to cancel)
	All customers	

5.2 Notification timeline including prior to de-energization, initiation, restoration, and cancellation, if applicable. The timeline should include the required minimum timeline and approximate time notifications were sent.

Table 5-2: Notification Timeline for Liberty September 12, 2026 Potential PSPS Event (24:00 hours)

Event Order	Notification Type	Requirement Timeline	Notifications Sent To	Date Sent	Approximate Time Sent: Alpine County	Approximate Time Sent: Mono County	Approximate Time Sent: Nevada and Sierra Counties
Pre-De-energization (prior)	Initial Notice for PSPS Event	72-48 hours	PSP	09/09/2026	Refer to Table D-1		
		72-48 hours	CFI	09/09/2026	19:30		
		72-48 hours	MBL customers	09/09/2026	19:30		
		72-48 hours	All other affected customers	09/09/2026	19:30		
		72-48 hours	CalOES	09/09/2026 09/10/2026	18:54 (09/09/2026) 06:55 (09/10/2026)		
		72-48 hours	CPUC	09/09/2026	20:07		
	Updated Notice for PSPS Event	48-24 hours	PSP	09/10/2026	Refer to Table D-1		
		48-24 hours	CFI	09/10/2026	16:17	16:17	17:22
		48-24 hours	MBL customers	09/10/2026	16:17	16:17	N/A
		48-24 hours	All other affected customers	09/10/2026	16:17	16:17	17:22
		48-24 hours	CalOES	09/10/2026 09/11/2026	14:57 (09/10/2026) 06:55 (09/11/2026)		

Liberty Utilities (CalPeco Electric) LLC Post Event Report on September 12, 2026 Potential PSPS Event

Event Order	Notification Type	Requirement Timeline	Notifications Sent To	Date Sent	Approximate Time Sent: Alpine County	Approximate Time Sent: Mono County	Approximate Time Sent: Nevada and Sierra Counties
		48-24 hours	CPUC	09/10/2026	09:40		
	Updated Notice for PSPS Event	< 24 hours	PSP	09/11/2026	Refer to Table D-1		
		< 24 hours	CFI	09/11/2026	16:39	16:39	N/A
		< 24 hours	MBL customers	09/11/2026	16:39	16:39	N/A
		< 24 hours	All other affected customers	09/11/2026	16:39	16:39	N/A
		< 24 hours	CalOES	09/11/2026	14:14	14:14	14:14
		< 24 hours	CPUC	09/11/2026 9/11/2026	09:06 15:59	09:06 15:59	09:06 N/A
	Event Cancelled / Concluded	Within 2 hours of decision to cancel)	PSP	9/11/2026 9/12/2026	Refer to Table D-1		
		Within 2 hours of decision to cancel)	CFI	9/11/2026 9/12/2026	N/A 07:59	N/A 07:59	14:22 N/A
		Within 2 hours of decision to cancel)	MBL customers	9/11/2026 9/12/2026	N/A 07:59	N/A 07:59	14:22 N/A
		Within 2 hours of decision to cancel)	All other affected customers	9/11/2026 9/12/2026	N/A 07:59	N/A 07:59	14:22 N/A
		Within 2 hours of decision to cancel)	CalOES	9/11/2026 9/12/2026	N/A 07:00	N/A 07:00	14:14 07:00
		Within 2 hours of decision to cancel)	CPUC	9/11/2026 9/12/2026	N/A 07:38	N/A 07:38	15:59 N/A

5.3 For those customers where positive or affirmative notification was attempted, use the following template to report the accounting of the customers (which tariff and/or access and functional needs population designation), the number of notification attempts made, the timing of attempts, who made the notification attempt (utility or public safety partner) and the number of customers for whom positive notification was achieved. “Notification attempts made” and “Successful positive notification” must include the unique number of customer counts. When the actual notification attempts made is less than the number of customers that need positive notifications, the utilities must explain the reason. In addition, the utilities must explain the reason of any unsuccessful positive notifications.

See Table 5-3 for information regarding Liberty's communication attempts and positive notifications with medical baseline customers. Liberty affirmed notification with 16 of 18 medical baseline customers (“MBL”) potentially impacted by the September 12, 2026 potential PSPS event. For the two MBL customers that Liberty was not able to affirm notifications with, Liberty made three notification attempts, including through Onsolve, phone calls, and door knocks. Liberty left door hangers at the two customer locations where affirmation of notification was not received.

Table 5-3: Positive Notifications to MBL Customers

Category	Total Number of Customers	Timing of Attempts	Notification Attempts	Successful Positive Notification	Who Made the Notification
Medical Baseline	18	9/9/2026 at 1930 hours 9/10/2026 between 0839 hours and 0916 hours 09/12/2026 at 0759 hours	32	16 ²	Liberty

5.4 A copy or scripts of all notifications with a list of all languages that each type of notification was provided in, the timing of notifications, the methods of notifications and who made the notifications (the utility or local public safety partners).

Copies of all notifications are contained in Appendices A, B, and C. Liberty performed all primary customer notifications and encouraged public safety partners to amplify PSPS messages on their platforms as appropriate. Liberty offered all notifications in English and provides notifications in Spanish on its website. Liberty also provides links to PSPS materials in Spanish, French, German, Chinese, Vietnamese and Tagalog.

² Liberty left door hangers at the two customer locations where affirmation of notification was not received.

- 5.5 If the utility fails to provide notifications according to the minimum timelines set forth in D.19-05-042 and D.21-06-034, using the following template to report a breakdown of the notification failure and an explanation of what caused the failure.

Not applicable; Liberty is not aware of any notification failures during this event.

- 5.6 Explain how the utility will correct the notification failures.

Not applicable; Liberty is not aware of any notification failures during this event.

- 5.7 Enumerate and explain the cause of any false communications citing the sources of changing data.

Not applicable; Liberty is not aware of any false communications during this event.

6 Local and State Public Safety Partner Engagement

- 6.1 List the organization names of public safety partners including, but not limited to, local governments, tribal representatives, first responders and emergency management, and critical facilities and infrastructure the utility contacted prior to de-energization, the date and time on which they were contacted, and whether the areas affected by the de-energization are classified as Zone 1, Tier 2, or Tier 3 as per the definition in CPUC General Order 95, Rule 21.2-D.

The list of public safety partners contacted prior to de-energization is included as Table D-1 in Appendix D.

- 6.2 List the names of all entities invited to the utility's Emergency Operations Center for a PSPS event, the method used to make this invitation, and whether a different form of communication was preferred by any entity invited to the utility's emergency operation center.

Liberty did not invite external entities to its IMT meeting. Liberty remained in close daily contact with State and local public safety partners, as well as critical infrastructure entities, for the duration of this PSPS event to provide critical incident updates. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event.

Liberty held the State Executive Briefing on September 10, 2026, at 14:00 hours, and September 11, 2026, at 14:00 hours. Additionally, Liberty met daily with its neighboring utilities, NV Energy and Truckee Donner Public Utilities District, to coordinate regarding the potential PSPS event.

- 6.3 A statement verifying the availability to public safety partners of accurate and timely geospatial information, and real time updates to the GIS shapefiles in preparation for an imminent PSPS event and during a PSPS event.

After the EOC was activated, Liberty provided geospatial information and near real-time updates to public safety partners before and during the PSPS event through its Public Safety Partner Portal. Liberty notifications to PSPs included links to its PSP Portal.

- 6.4 A description and evaluation of engagement with local and state public safety partners in providing advanced outreach and notification during the PSPS event.

Liberty conducted daily outreach with State and local public safety partners, as well as critical infrastructure entities, prior to and for the duration of this PSPS event to provide critical incident updates and a forum for resolving issues. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event.

Liberty provided advanced outreach and notification to its local and state public safety partners (PSPs) during the PSPS event. As evidenced by the documentation provided in Appendix B – Notifications to PSPs, Liberty provided its PSPs the necessary updates regarding the event. As further evidence of its successful engagement with public safety partners, Liberty had successful communication with and received positive verbal feedback from NV Energy OES, Town of Truckee – Emergency Manager, Truckee

Airport General Manager, El Dorado County OES, Placer County OES, Sierra County OES, Alpine County OES, Plumas County OES, Nevada County OES, Mono County OES, Washoe Tribe – Emergency Manager, Alpine County Public Health, Truckee Donner PUD, Alpine County - Fire Chief, Alpine County Sheriff, Mono County EMS Chief, Mono County Sheriff, Alpine Valley Fire, US Forest Service, Cal Fire and Apple Valley Fire Protection District.

Importantly, Liberty met daily with its neighboring utilities, NV Energy and Truckee Donner Public Utilities District, to coordinate regarding the potential PSPS event. This coordination builds on successful relationships that have been developed and strengthened through regular utility coordination meetings throughout the year, occurring with increased frequency during fire season.

Additionally, Liberty submitted the required CalOES Notification forms via the State Dashboard beginning on September 9, 2026 at 18:54 hours. Liberty also notified the CPUC through email during each stage and relevant update of the potential PSPS event. Liberty will seek feedback from CalOES regarding this potential PSPS event at its next scheduled IOU Monthly meeting with CalOES.

Liberty will continue to assess its engagement with public safety partners during this potential PSPS event. This will include evaluating post-event feedback received during ad-hoc meetings and discussions with partners and direct feedback provided by partners. Liberty will consider the use of post-event surveys for public safety partners to provide feedback on future PSPS events.

6.5 Specific engagement with local communities regarding the notification and support provided to the AFN community.

Liberty engaged with local public safety partners, community-based organizations and local government throughout the PSPS event to assess support needs for AFN customers. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event. For this potential event, approximately 590 of the affected customers were identified as AFN with the majority being older adults or on one of Liberty's customer assistance programs. The public safety partners that provide support to the AFN community included Alpine County Health and Human Services and the Washoe Tribe. Liberty has a Memorandum of Understanding with the Washoe Tribe and has established a CRC location within close proximity to the AFN community in order to provide support. Additionally, Liberty understands that its Alpine County contacts support communications with vulnerable households, transportation arrangements if necessary, and collaboration with local sheriff departments. In Mono County, Liberty maintained communication with local public safety partners, Mono Health and Human Services, Mono County Public Health, the Mono County Medical Health Operational Area Coordinator, the Eastern Sierra VOAD, and the Eastern Sierra Transit Authority. The Eastern Sierra Transit Authority utilizes Dial-a-Ride for transportation in the Walker/Coleville area, and Liberty AFN Coordinator's contact information was shared with that driver in case specific needs arose. In Sierra County, Liberty engaged with Sierra County Health & Human Services, Sierra County Public Health, and FREED (the Independent Living Center serving Sierra County). FREED maintains a list of consumers of Independent Living Services in Sierra County and checked in their system to see if any of their consumers would be impacted by the PSPS event. In addition, Liberty's AFN Coordinator responded to questions from other CBOs in Sierra County (Incorporated Senior Citizens of Sierra County) about which areas would be impacted by the potential event. In addition, the AFN Coordinator was ready to escalate unmet AFN needs and link customers to resources.

6.6 Provide the following information on backup power (including mobile backup power) with the name and email address of a utility contact for customers for each of the following topics:

- a) Description of the backup generators available for critical facility and infrastructure customers before and during the PSPS.

There were no generator deployment requests for this activation.

- b) The capacity and estimated maximum duration of operation of the backup generators available for critical facility and infrastructure customers before and during the PSPS.

There were no generator deployment requests for this activation.

- c) The total number of backup generators provided to critical facility and infrastructure customer's site immediately before and during the PSPS.

None. There were no backup generator deployment requests for this activation.

- d) How the utility deployed this backup generation to the critical facility and infrastructure customer's site.

N/A.

- e) An explanation of how the utility prioritized how to distribute available backup generation.

N/A.

- f) Identify the critical facility and infrastructure customers that received backup generation.

N/A.

7 Complaints and Claims

7.1 The number and nature of complaints received as the result of the de-energization event and claims that are filed against the utility because of de-energization. The utility must completely report all the informal and formal complaints, meaning any expression of grief, pain, or dissatisfaction, from various sources, filed either with CPUC or received by the utility as a result of the PSPS event.

As of September 24, 2026, Liberty has received one informal complaint via email and one informal complaint via verbal communication related to the September 12, 2026 potential PSPS event. Both complaints were related to concerns about how a PSPS is called and whether the community impact is weighed in the decision-making.

Additionally, Liberty received six comments on its social media posts related to the September 12, 2026 potential PSPS event. Two comments were not relevant to the PSPS event and were regarding billing issues. Two comments stated that PSPS is for system maintenance and pole replacements and not for fire weather conditions. One comment stated that Liberty should underground its power lines. One comment stated that Liberty should use money to maintain its system versus padding profits.

Table 7-1: Count and Nature of Complaints Received

Nature of Complaints	Complaint Format	Number of Complaints
PSPS Criteria and Decision Making	Email	1
PSPS Criteria and Decision Making	Verbal	1
System Infrastructure	Social Media	4
Unrelated Billing Issues	Social Media	2

8 Power Restoration

8.1 A detailed explanation of the steps the utility took to restore power.

Not applicable; no facilities were de-energized during this event.

8.2 The timeline for power restoration, broken down by phase if applicable.

Not applicable; no facilities were de-energized during this event.

8.3 For any circuits that require more than 24 hours to restore, the utility shall explain why it was unable to restore each circuit within this timeframe, using the format below.

Not applicable; no facilities were de-energized during this event.

9 Community Resource Centers

9.1 Report information including the address of each location during a de-energization event, the location (in a building, a trailer, etc.), the assistance available at each location, the days, and hours that it was open, and attendance (i.e., number of visitors).

Table 9-1: Community Resource Centers

County	Site Name	Address	Operating Hours	Attendance	Site Type	Services and Amenities Provided
Alpine	Woodfords Community Center	25 Washo Blvd, Markleeville, CA 96120	11/05/2025, 8a.m.- 5p.m.	N/A	CRC - Building	Small portable device charging (for cell phone, laptop, and small medical devices), Wi-Fi, chairs, seasonal cooling, and heating, PSPS information, snacks, water, ice, ADA compliant restrooms.
Mono	Walker Community Center	442 Mule Deer Drive, Walker, CA 93517	11/05/2025, 8a.m.- 5p.m..	N/A	CRC - Building	Small portable device charging (for cell phone, laptop, and small medical devices), Wi-Fi, chairs, seasonal cooling, and heating, PSPS information, snacks, water, ice, ADA compliant restrooms.
Nevada	Truckee Tahoe Airport	10356 Truckee Airport Road, Truckee, CA 96161	11/05/2025, 8a.m.- 5p.m.	N/A	CRC - Building	Small portable device charging (for cell phone, laptop, and small medical devices), Wi-Fi, chairs, seasonal cooling, and heating, PSPS information, snacks, water, ice, ADA compliant restrooms.

9.2 Any deviations and explanations from the CRC requirement including operation hours, ADA accessibility, and equipment.

Liberty is not aware of any deviations from CRC requirements during this event.

9.3 A map identifying the location of each CRC and the de-energized areas.

Figure 9-1: Woodfords CRC for September 12, 2026 Potential PSPS Event



Figure 9-2: Walker CRC for September 12, 2026 Potential PSPS Event



Figure 9-3: Truckee Tahoe Airport CRC for September 12, 2026 Potential PSPS Event



10 Mitigations to Reduce Impact to Customers

10.1 Mitigation actions and impacts including: sectionalization devices, temporary generation, microgrids, permanent backup generation, transmission switching, covered conductor, and any other grid hardening that mitigated the impact of the event.

During the event, Liberty did not de-energize any customers on the potentially impacted circuits: MULLER1296, TPZ1202, CAL2501, and WSH201. Ultimately, all potentially impacted circuits were placed into Extreme Fire Mode, to enable fast trip settings, which maintained service to customers while reducing fire risk under elevated conditions.

Refer to Table 10-1 for grid hardening activities that Liberty has completed on the MULLER1296, TPZ1202, CAL2501, and WSH201 circuits from 2024 - present. Liberty also reduced the potential restoration time by strategically staging crews in the potentially affected PSPS areas to continuously patrol the circuits and address any hazards or failures found because of the weather conditions. Additionally, Liberty had additional contract crews staged to deploy to emergency situations beyond its normal staffing levels.

Table 10-1: Grid Hardening Activities Completed to Mitigate PSPS Impact

Circuit	Poles Installed	ELF Fuses Installed	Overhead Primary Conductor Replaced (ft.)	Overhead Secondary Conductor Replaced (ft.)	Composite Crossarms Installed	Transformers Installed
MULLER1296	268	48	61818	5828	328	60
TPZ1202	165	96	14108	1222	120	31
CAL2501	8	29	0	0	0	0
WSH201	0	10	0	230	2	1

11 Lessons Learned from this Event

11.1 Threshold analysis and the results of the utility's examination of whether its thresholds are adequate and correctly applied in the de-energized areas.

Liberty believes its CRI thresholds on the MULLER1296, TPZ1202, CAL2501 and WSH201 circuits are adequate and were correctly applied. Liberty will continue to evaluate its PSPS criteria and relevant fire weather variables as appropriate.

11.2 Any lessons learned that will lead to future improvement for the utility.

Table 11-1: Lessons Learned

Issue	Discussion	Resolution
PSPS Event Tracker	Liberty identified improvements to its in-event PSPS event tracker.	- Redesign the partner tab to capture regulatory fields and support transfer into post-event reporting. - Protect drop-down source cells.
Medical Baseline Customer ("MBL") Post-Cancellation Notification	Liberty attempted to receive positive affirmation of its event cancellation notification to MBL customers; subsequent to previous positive affirmation attempts and door hangers regarding the potential for a PSPS event.	Add positive affirmation attempts following-up on cancellation notification for MBL customers to the PSPS Playbook and notification checklist.
Community Resource Centers ("CRCs")	CRC lead protocol, CRC staffing, and CRC coverage.	- Designate the CRC lead and define facility, vendor, staffing, partner, and stand-down contacts. - Expand the trained staffing roster and provide role-based orientation. - Assess Verdi, Kings Beach, and Turtle Rock CRC options.
Virtual Hub and Tool Training	Liberty utilized a Microsoft Teams virtual hub for its IMT.	Provide off-season role-based training on Hub, channels, meetings, tracker, storage, and archiving.
Regulatory Mailbox	Define when Liberty's Regulatory team is copied on notifications; intended to streamline post-event reporting.	Consider the use of a Regulatory PSPS email to utilize during PSPS events.
Complaint Tracking	Complaint tab in the PSPS event tab was not updated in real-time; follow-up required for post-event reporting.	Clarify timing, ownership, and post-event use of complaint data.

12 Other Relevant Information

Liberty does not have any other relevant information to share at this time.

13 Officer Verification

I am an officer of the applicant corporation herein and am authorized to make this verification on its behalf. I am informed and believe that the matters stated in this foregoing document are true.

I declare under penalty of perjury that the foregoing is true and correct. Executed on this 25th of September, 2026 in Tahoe, California.

A handwritten signature in black ink, appearing to read "E. Schwarzrock", is positioned above a horizontal line.

Eric Schwarzrock
President, California



Liberty Utilities (CalPeco Electric) LLC
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
Fax: 530-544-4811

14 Appendix A – Customer Notifications

Appendix A – Customer Notifications

September 9, 2026

Stage 1: Potential PSPS (72 Hours)

The following message was shared on Liberty’s website at 18:30 on 9/9/2026:

September 9, 2026 update:

Liberty may implement a Public Safety Power Shutoff (PSPS) for [THESE AREAS](#) Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire on or about Saturday, September 12, 2026, at about 9 a.m. The estimated time of restoration is Sunday, September 13 at about 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers from 8 a.m.-10 p.m. throughout the duration of the event, starting at 8 a.m. on Saturday at the:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA

When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.

What Do I Need to Know?

- Power is expected to be shut off on or about Saturday, September 12, 2026, at about 9 a.m. The estimated time of restoration is Sunday, September 13 at about 9:00 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,663 customers will be impacted.
- Public safety partners were contacted on Wednesday, September 9 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Community Resource Centers (CRC) are being activated. The CRCs will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.

- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our [Community Resource Centers](#) from 8 a.m. - 10 p.m. at the:
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA
 - When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

The following website alert was shared on Liberty's website at 18:30 on 9/9/26:

Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for Liberty's customers in the Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas on Saturday, September 12, at around 9:00 a.m. The estimated time of restoration is Sunday, September 13 at around 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, the Walker Community Center or 442 Mule Deer Drive, Walker, CA from 8 a.m. - 10 p.m. throughout the duration of the event, starting at 8:00 a.m. on Saturday, September 12. When CRCs are closed, you can use the outage map to identify energized areas for power. [DETAILS](#)

The following message was distributed via social media channels (Facebook and X) at 18:30 on 9/9/2026:



Liberty may implement a Public Safety Power Shutoff (PSPS) for the Verdi(CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire.

Customers are encouraged to plan for an extended power shutoff that will likely begin around 9:00 a.m. on Saturday, September 12. The estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, from 8am-10pm throughout the duration of the event, starting at 8:00am on Saturday if they are unable to secure necessary alternative power. When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/...>

Further details can be found on our webpage: <https://california.libertyutilities.com/.../public-safety...> La página web de Liberty está en español See less



Customers are encouraged to **visit our Community Resource Centers (CRCs)** from 8 a.m. throughout the duration of the Public Safety Power Shutoff (PSPS) starting at 8 a.m. on Saturday, September 12.

Woodfords Community Center
96 Washoe Blvd.
Markleeville, CA

Walker Community Center
442 Mule Deer Drive
Walker, CA

At the CRCs, you can access:

- Water
- Activities for kids (coloring books, etc.)
- Device charging



www.libertyenergyandwater.com

1-800-782-2506

The following talking points were distributed to staff for customer communications at 18:30 on 9/9/2026:

- Liberty may implement a Public Safety Power Shutoff (PSPS) for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire.
 - Map Here: [Overview MonitoringMap PSPS 20260909.pdf](#)
 - Expected start of PSPS outage: Saturday, September 12, at 9:00 a.m.
 - Estimated time of restoration: Sunday, September 13 at 9:00 a.m.
 - Number of customers potentially impacted: Approximately 1,663
 - Customers are encouraged to visit one of our Community Resource Centers starting on Saturday, September 12 from 8 a.m. -10 p.m. at:
 1. Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA
 2. Walker Community Center, 442 Mule Deer Drive, Walker, CA
 - Further details can be found on our webpage:
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>
 - Website translated into Spanish by clicking on the top right button.
-

The following script was provided to staff for Medical Baseline customer communications at 18:30 on 9/9/2026:

Good afternoon, my name is <<insert>> and I'm calling from Liberty with an important update regarding the possibility of an extended power outage, or Public Safety Power Shutoff. Can you please verify your account? [Verify according to Customer Service standards]

- Our records show that you or a member of your household is enrolled in our medical baseline program or may have special medical needs that require electric service. Can you confirm that information?
- Liberty is alerting our medically dependent customers of the possibility that we may implement a Public Safety Power Shutoff as early as Saturday, September 12 at 9 a.m. for some portions of our service area, including your neighborhood.
- Are you familiar with what a Public Safety Power Shutoff is?

- A PSPS is a tool used to prevent wildfires used by utilities as a last resort. During a PSPS, Liberty may temporarily shut off power to your property to keep you and your community safe. The estimated time of restoration is Sunday, September 13 at 9:00 a.m. If the Public Safety Power Shutoff does occur, power may be temporarily interrupted for at least 24 hours (or longer), so we are asking our medical baseline customers to plan accordingly in case you need to secure alternative power or relocate for medical needs.
- At this point, it has not yet been determined whether a Public Safety Power Shutoff will occur. However, since it is a possibility, we wanted to give you advanced notice due to your medical needs.
- Our goal is to determine in the next 48 hours whether a Public Safety Power Shutoff will be necessary.
- Going forward throughout this event, you will receive notifications through our automated system that texts, calls, and emails the contact information on file. As a medical customer, it's important that you confirm you received the notification. Here's how:
 - **Text:** Reply with the number 1; **Email:** click the link in the email; **Phone:** press 1 at the end of the call
 - [If the customer reports not receiving notification, please confirm all contact information is correct and direct them to add 866-609-8026 and liberty@notifications.onsolve.com to their safe contacts list]
- If a Public Safety Power Shutoff is going to be activated, we will post that information to our website at www.LibertyUtilities.com and our social media accounts. You can also find preparedness information, PSPS videos, and outage tips on our website.
- During Public Safety Power Shutoffs, Community Resource Centers will be available to provide water, information, and device charging stations starting on Saturday, September 12 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. When CRCs are closed, you can use the outage map on our website to identify energized areas for power.
 - The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA
 - The Walker Community Center, 442 Mule Deer Drive, Walker, CA.
- [If customer reports needing emergency assistance, instruct them to **call 9-1-1** directly]

- I'd like to personally thank you for being a Liberty customer. We appreciate your understanding as we work to keep the community safe.
- [Record the required call details in the MBL Contact Tracker and document any complaints received in Complaint Tracker]
- <<Close Call>>

#

Voicemail:

- This is Liberty calling to notify you of the possibility of an extended power outage, or Public Safety Power Shutoff in your area as early as Saturday, September 12 at 9:00 a.m. Due to your account status, without confirmation of notification receipt, we may send staff to the service address in Liberty's records to contact you. Please call Liberty back at 1-800-782-2506 to confirm receipt of this notification and for more information.

The following message was distributed via email to all customers at 19:30 on 9/9/2026:



ATTENTION Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker Area Customers

Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for [THESE](#) areas (**Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers**) on **Saturday, September 12 at about 9 a.m.** The estimated time of restoration is 9 a.m. on Sunday, September 13. Customers are encouraged to visit our Community Resource Centers from 8 a.m.-10 p.m. throughout the duration of the event, starting at 8 a.m. on Saturday at the:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.

[View CRC details](#)

A Public Safety Power Shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where conditions present an increased wildfire risk. The practice of de-energization is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

How to Prepare for a PSPS

Below are resources in multiple languages to help you understand, prepare for, and endure a PSPS event. [Here is the website with PSPS information in multiple languages.](#)

Debido a las condiciones climáticas extremas, se puede implementar un corte de energía de seguridad pública (PSPS) para **ESTAS ÁREAS (Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville y el área de Walker)** en o alrededor del **sábado 12 de septiembre alrededor de las 9 a. m.** La hora estimada de restablecimiento es las 9 a. m. del domingo 13 de septiembre. Se recomienda a los clientes que visiten nuestros Centros de Recursos Comunitarios de 8 a. m. a 10 p. m. durante la duración del evento, comenzando a las 8 a. m. del sábado en el:

- Centro Comunitario de Woodfords, 96 Washoe Blvd, Markleeville, CA
- Centro Comunitario de Walker, 442 Mule Deer Drive, Walker, CA

Un corte de energía de seguridad pública (PSPS) es un procedimiento de seguridad utilizado por las empresas eléctricas para apagar proactivamente la energía cuando y donde las condiciones presentan un mayor riesgo de incendios forestales. La práctica de la de energización es apoyada por la Comisión de Servicios Públicos de California (CPUC) como una mejor práctica de seguridad.

Cómo prepararse para un PSPS

A continuación se presentan recursos en varios idiomas para ayudarlo a comprender, prepararse y soportar un evento PSPS.

Resources in Other Languages

PSPS Fact Sheet

English

Español

Français

Deutsch

中国人

Tiếng Việt

Tagalog

PSPS Preparation

English

Español

Français

Deutsch

中国人

Tiếng Việt

Tagalog



The following message was distributed via Onsolve to impacted customers in Coleville, Walker, Topaz, Woodfords, Markleeville, Verdi, and Floriston at 19:40 on 9/9/2026:

Email:

This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for your area on Saturday, September 12, at or around 9:00 a.m. The estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers starting on Saturday, September 12 from 8 a.m. -10 p.m. at the:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>. La página web de Liberty está en español.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) will likely be implemented for your area on Saturday, 9/12, at or around 9:00 a.m. The estimated time of restoration is Sunday, 9/13 at 9:00 a.m.

2. Customers are encouraged to visit our Community Resource Center at Woodfords Community Center, 96 Washoe Blvd or the Walker Community Center, 442 Mule Deer Drive on Saturday, 9/12 from 8 a.m. - 10 p.m. When CRCs are closed, you can use the outage map to identify energized areas for power. Details of PSPS can on our website. La página web de Liberty está en español

The following media release was shared with the public at 19:00 on 9/9/2026:



Media Release

FOR IMMEDIATE RELEASE:

Wednesday, September 9, 2026

Contact: Alison Vai

____ (562) 385-0194

Liberty Alerts Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker Area Customers of Potential Public Safety Power Shutoff Due to Extreme Weather Conditions that Increase the Risk of a Potential Wildfire.

Tahoe, California – Liberty Utilities (Liberty) has notified its Verdi, Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers that it may implement a Public Safety Power Shutoff (PSPS) on Saturday, September 12 at 9:00 a.m. to reduce wildfire risk and promote the safety of the community during the anticipated extreme weather conditions. The estimated time of restoration is 9 a.m. on Sunday, September 13. Please see the impacted areas as detailed in the map attached.

The State of California grants authority to Liberty to implement a PSPS in high-risk areas when extreme weather conditions present a clear danger to public safety.

Customers are encouraged to visit one of our three Community Resource Centers from 8am–10pm throughout the duration of the event starting at 8:00am on Saturday.

- The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA
- Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>



"We understand power outages are never convenient for customers, and we appreciate the community's cooperation as we consider these measures to keep the area safe from wildfires," said Eric Schwarzrock, President, CA Electric.

The following are proactive measures you can take to keep you and your family safe:

- Create an emergency kit that includes, but is not limited to, flashlights, first aid supplies, and local maps. Consult [Ready.gov](https://www.ready.gov) for additional emergency kit necessities.
- Plan for medical needs that may be impacted by a power shutoff, including medications that need refrigeration or devices that require power. Please [register](#) any energy-related medical needs by calling 1-800-782-2506.
- Store nonperishable foods and water to support your family for a minimum of 48 hours.
- For additional information and real-time updates, please visit libertyutilities.com or follow us on Facebook (@LibertyUtilitiesLT) and X (@LibertyUtil_CA).

If a PSPS is implemented, Liberty will activate the community resource centers listed above to provide customers with essential resources and an opportunity to speak directly with customer care representatives throughout the event.

About Liberty

Liberty is committed to providing safe and reliable natural gas, water, and electricity distribution services to over one million customer connections, including those in California. Liberty's utility operations are primarily located in the United States, with distribution operations including Arizona, Arkansas, Georgia, Illinois, Iowa, Kansas, Massachusetts, Missouri, New Hampshire, New York, Oklahoma, and Texas, as well as utilities in Bermuda, Chile, and New Brunswick, Canada. For more information, please visit www.libertyenergyandwater.com.

September 10, 2026

Stage 2a: Imminent PSPS (48-24 hours)

The following message was distributed via social media channels (Facebook and X) at 08:15 on 9/10/2026:



Liberty Utilities - Tahoe

6 days ago · 🌐

...


Liberty may implement a Public Safety Power Shutoff (PSPS) for the Verdi(CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire.

Customers are encouraged to plan for an extended power shutoff that will likely begin around 9:00 a.m. on Saturday, September 12. The estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, from 8 a.m.- 10 p.m. throughout the duration of the event, starting at 8:00am on Saturday if they are unable to secure necessary alternative power. When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/...>

Further details can be found on our webpage: <https://california.libertyutilities.com/.../public-safety....> La página web de Liberty está en español [See less](#)

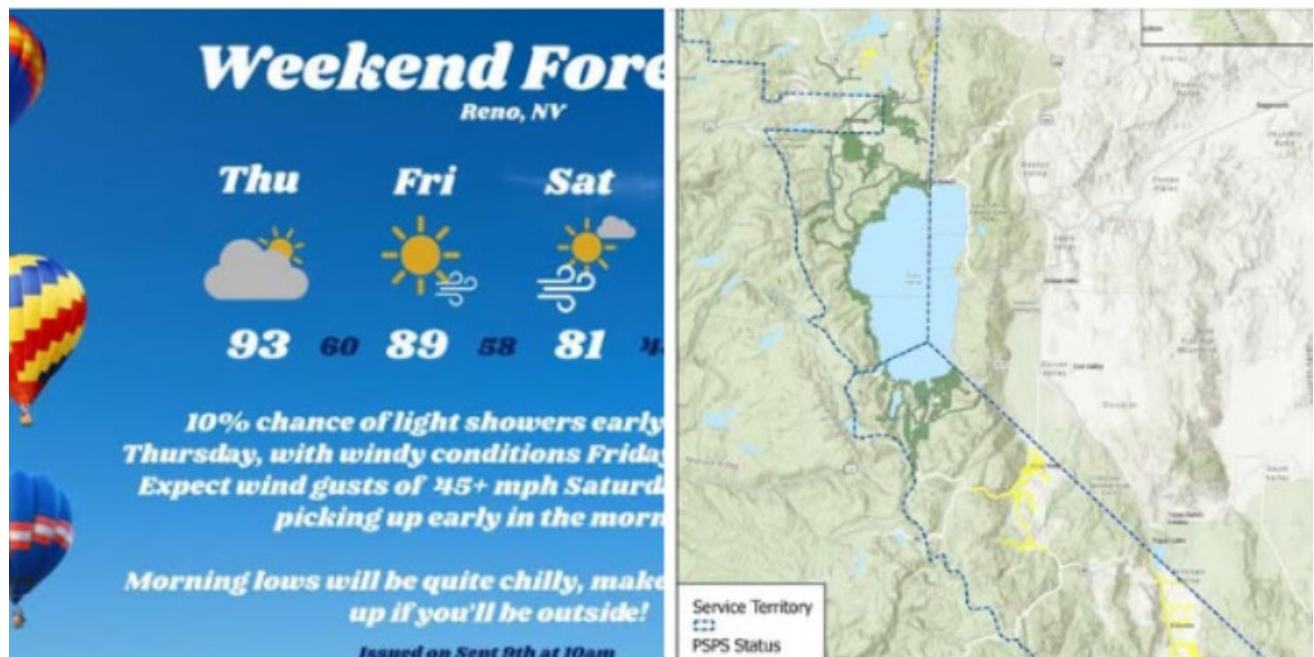

The following message was shared on Liberty's website at 12:20 on 9/10/2026:

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

The CRI uses forecast wind gusts to estimate the potential of a power line starting a fire and flame length, which is then used to evaluate how severe that fire could become. When wildfire

risk is high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Risk Indicator	What We Monitor	Why It Matters
Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

The following message was distributed via social media channels (Facebook and X) at 14:00 on 9/10/2026:



Liberty Utilities - Tahoe

6 days ago · 🌐

...

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://vist.ly/5hz2f> See less

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

The following Community Resource Center flyer was distributed at 15:50 on 9/10/2026:

Public Safety Power Shutoff

Saturday, September 12, 2026



About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

- **Communities impacted:** Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker
- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,663 customers may be impacted by Liberty's potential PSPS



- **Three Community Resource Centers** will be open from 8 am - 10 pm throughout the duration of the event, starting at 8:00 am on Saturday, September 12.

Customers will be messaged directly throughout the event with updates. To update your contact information, please call 1-800-782-2506.



Visit our Community Resource Centers

Saturday, September 12, 2026 potential PSPS event

Customers are encouraged to **visit our Community Resource Centers (CRC)** from **8 a.m. – 10 p.m.** throughout the duration of the Public Safety Power Shutoff (PSPS) event, starting at 8 a.m. on Saturday, September 12.



Woodfords Community Center

96 Washoe Blvd.
Markleeville, CA



Truckee Tahoe Airport

10356 Truckee Airport Rd.
Truckee, CA



Walker Community Center

442 Mule Deer Drive
Walker, CA

At our CRCs, you can access:

- Information about the PSPS event
- Wi-fi
- Snacks
- Water
- Activities for kids (coloring books, games)
- Device charging



www.libertyenergyandwater.com

1-800-782-2506

The following message was shared on Liberty's website at 15:50 on 9/10/2026:

Liberty may implement a Public Safety Power Shutoff (PSPS) for [THESE AREAS](#) Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire **on or about Saturday, September 12, 2026, at about 9 a.m.** The estimated time of restoration is Sunday, September 13 at about 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers from 8 a.m.-10 p.m. throughout the duration of the event, starting at 8 a.m. on Saturday at the:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA

When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.

What Do I Need to Know?

- Power is expected to be shut off on or about Saturday, September 12, 2026, at about 9 a.m. The estimated time of restoration is Sunday, September 13 at about 9:00 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,663 customers will be impacted.
- Public safety partners were contacted on Wednesday, September 9 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Community Resource Centers (CRC) are being activated. The CRCs will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our [Community Resource Centers](#) from 8 a.m. - 10 p.m. at the:
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA
 - Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA
- When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.

- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

The following message was distributed via Onsolve to impacted customers in Coleville, Walker, Topaz, Woodfords, and Markleeville at 16:17 on 9/10/2026:

Email:

This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of wildfire, a potential Public Safety Power Shutoff (PSPS) may be implemented for your area on Saturday, September 12, at or around 9:00 a.m. The estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers starting on Saturday, September 12 from 8 a.m. -10 p.m. at the:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>. La página web de Liberty está en español.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of wildfire, a potential Public Safety Power Shutoff (PSPS) may be implemented for your area on Saturday, 9/12, at or around 9:00 a.m. The estimated time of restoration is Sunday, 9/13 at 9:00 a.m.

2. Customers are encouraged to visit our Community Resource Center at Woodfords Community Center, 96 Washoe Blvd or the Walker Community Center, 442 Mule Deer Drive on Saturday, 9/12 from 8 a.m. - 10 p.m. When CRCs are closed, you can use the outage map to identify energized areas for power. Details of PSPS can on our website. La página web de Liberty está en español

The following message was distributed via social media channels (Facebook and X) at 16:30 on 9/10/2026:



Liberty Utilities - Tahoe

5 days ago ·

...

Liberty may implement a Public Safety Power Shutoff (PSPS) for the Verdi(CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers due to extreme weather conditions that increase the risk of a potential wildfire.

Customers are encouraged to plan for an extended power shutoff that will likely begin around 9:00 a.m. on Saturday, September 12. The estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at 1)the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, 2)the Walker Community Center, 442 Mule Deer Drive, Walker, CA, or 3)the Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA from 8am-10pm throughout the duration of the event, starting at 8:00am on Saturday if they are unable to secure necessary alternative power.

When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/...>

Further details can be found on our webpage: <https://california.libertyutilities.com/.../public-safety...> La página web de Liberty está en español See less

Damaging Winds

Saturday

Risk Level: 4/5
Major

National Weather Service | Reno, NV

Hazards:

- **High Wind Watch** in effect for the Reno-Carson-Minden area & Mono county from 11 AM Saturday - 2 AM Sunday.
- **Wind Advisory** in effect for the Greater Lake Tahoe Area, W NV Basin and Range, NE CA, and N Washoe county from 11 AM Saturday - 2 AM Sunday.

Key Messages:

- Widespread west/southwest wind gusts of 45+ mph with wind gusts of 55-65 mph for wind prone locations along US-395/I-580. Ridgetops gusting over 80 mph.
- Wave heights 1-3 feet on Lake Tahoe and Pyramid Lake.
- Prepare for possible power outages.
- Secure outdoor furniture and loose objects.

Impacts:

- Blowing dust
- Difficult travel for high profile vehicles
- Bumpy flights and turbulence

Service Territory
PSPS Status

Visit our Community Resource Centers
Saturday, September 12, 2026 potential PSPS event

Customers are encouraged to visit our Community Resource Centers (CRC) from 8 a.m. - 10 p.m. throughout the duration of the Public Safety Power Shutoff (PSPS) event, starting at 8 a.m. on Saturday, September 12.

Woodfords Community Center	Truckee Tahoe Airport	Walker Community Center
96 Washoe Blvd. Markleeville, CA	10356 Truckee Airport Rd. Truckee, CA	442 Mule Deer Drive Walker, CA

At our CRCs, you can access:

- Information about the PSPS event
- Wi-Fi
- Snacks
- Water
- Activities for kids (coloring books, games)
- Device charging



The following talking points were updated and distributed to staff for customer communications at 16:30 on 9/10/2026:

- Liberty may implement a Public Safety Power Shutoff (PSPS) for **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** area customers due to extreme weather conditions that increase the risk of a potential wildfire.
- **Map** Here: [Overview MonitoringMap PSPS 20260909.pdf](#)
- **Expected start of PSPS outage:** Saturday, September 12, at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Number of customers potentially impacted:** Approximately 1,663
- Customers are encouraged to visit one of our **Community Resource Centers** starting on Saturday, September 12 from 8 a.m. -10 p.m. at:
 1. Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA
 2. Walker Community Center, 442 Mule Deer Drive, Walker, CA
 3. Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA
- Further details can be found on our webpage:
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>
- Website translated into Spanish by clicking on the top right button.

The following script was updated and provided to staff for Medical Baseline customer communications at 16:30 on 9/10/2026:

- Good afternoon, my name is <<insert>> and I'm calling from Liberty with an important update regarding the possibility of an extended power outage, or Public Safety Power Shutoff. Can you please verify your account? [Verify according to Customer Service standards]

- Our records show that you or a member of your household is enrolled in our medical baseline program or may have special medical needs that require electric service. Can you confirm that information?
- Liberty is alerting our medically dependent customers of the possibility that we may implement a Public Safety Power Shutoff as early as Saturday, September 12 at 9 a.m. for some portions of our service area, including your neighborhood.
- Are you familiar with what a Public Safety Power Shutoff is?
- A PSPS is a tool used to prevent wildfires used by utilities as a last resort. During a PSPS, Liberty may temporarily shut off power to your property to keep you and your community safe. The estimated time of restoration is Sunday, September 13 at 9:00 a.m. If the Public Safety Power Shutoff does occur, power may be temporarily interrupted for at least 24 hours (or longer), so we are asking our medical baseline customers to plan accordingly in case you need to secure alternative power or relocate for medical needs.
- At this point, it has not yet been determined whether a Public Safety Power Shutoff will occur. However, since it is a possibility, we wanted to give you advanced notice due to your medical needs.
- Our goal is to determine in the next 48 hours whether a Public Safety Power Shutoff will be necessary.
- Going forward throughout this event, you will receive notifications through our automated system that texts, calls, and emails the contact information on file. As a medical customer, it's important that you confirm you received the notification. Here's how:
 - **Text:** Reply with the number 1; **Email:** click the link in the email; **Phone:** press 1 at the end of the call
 - [If the customer reports not receiving notification, please confirm all contact information is correct and direct them to add 866-609-8026 and liberty@notifications.onsolve.com to their safe contacts list]
- If a Public Safety Power Shutoff is going to be activated, we will post that information to our website at www.LibertyUtilities.com and our social media accounts. You can also find preparedness information, PSPS videos, and outage tips on our website.
- During Public Safety Power Shutoffs, Community Resource Centers will be available to provide water, information, and device charging stations starting on Saturday,

September 12 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. When CRCs are closed, you can use the outage map on our website to identify energized areas for power.

- The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA
- The Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA
- [If customer reports needing emergency assistance, instruct them to **call 9-1-1** directly]
- I'd like to personally thank you for being a Liberty customer. We appreciate your understanding as we work to keep the community safe.
- [Record the required call details in the MBL Contact Tracker and document any complaints received in Complaint Tracker]
- <<Close Call>>

###

Voicemail:

- This is Liberty calling to notify you of the possibility of an extended power outage, or Public Safety Power Shutoff in your area as early as Saturday, September 12 at 9:00 a.m. Due to your account status, without confirmation of notification receipt, we may send staff to the service address in Liberty's records to contact you. Please call Liberty back at 1-800-782-2506 to confirm receipt of this notification and for more information.

The following message was distributed via Onsolve to impacted customers in Verdi and Floriston at 17:22 on 9/10/2026:

Email:

This is an updated alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of wildfire, we continue to monitor for a Public Safety Power Shutoff (PSPS) for your area on Saturday, September 12, at or around 9:00 a.m. Based on recent weather reports, a PSPS is less likely but still possible.

If a PSPS is determined to be necessary, the estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers starting on Saturday, September 12 from 8 a.m. -10 p.m. at the:

- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA

When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>. La página web de Liberty está en español.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an updated alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of wildfire, we continue to monitor for a Public Safety Power Shutoff for your area on Saturday, 9/12, around 9:00 a.m. Based on recent weather reports, a PSPS is less likely but still possible. If a PSPS is determined, the estimated time of restoration is Sunday, 9/13 at 9:00 a.m.

2. Customers are encouraged to visit our Community Resource Center at Truckee Tahoe Airport, 10356 Truckee Airport Rd, Saturday, 9/12 from 8 a.m. -10 p.m. When CRCs are closed, you can use the outage map to identify energized areas for power. Details of PSPS can on our website. La página web de Liberty está en español

September 11, 2026

Stage 2b: Imminent (Within 24 hours)

The following message was distributed via social media channels (Facebook and X) at 9:24 on 9/11/2026:



Liberty Utilities - Tahoe

5 days ago · 🌐

...

At Liberty, the safety of our customers and communities is our top priority. A public safety power shutoff (PSPS) is a last-resort safety procedure used to proactively turn off power when and where conditions present an increased wildfire risk. Use our tips to prepare for a potential PSPS.

For more information and tips: <https://vist.ly/5i5fn> See less

Tips to Help You Prepare for a PSPS:

- Confirm your contact information to receive outage and emergency updates.
- Plan for medical needs that may be impacted by a loss of power. If you depend on medications that need refrigeration or medical devices that require power, please notify our office by calling 1-800-782-2506.
- Create an emergency kit composed of items such as flashlights, batteries, first aid supplies, non-perishable food, and water.
- Keep your cell phones and other electronic devices fully charged.
- Keep a full tank of gas and cash on hand for emergency purchases.



The following message was added to Liberty's website on 9/11/2026 at 16:00:

September 11, 2026, 4:00 p.m. update:

In light of improved fire weather conditions, the **Public Safety Power Shutoff (PSPS) has been canceled** for Liberty customers in the **Verdi (CA) and Floriston communities**. Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

However, due to extreme weather conditions that increase the risk of wildfire, **we continue to monitor for a Public Safety Power Shutoff (PSPS) for THESE AREAS** 📍 **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** customers on **Saturday, September 12 at or around 10:00 a.m.** Based on recent weather reports, a PSPS is less likely but still possible. If a PSPS is determined to be necessary, the estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers from 8am-10pm throughout the duration of the event, starting at 8:00am on Saturday, at:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center, 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the [outage map](#) to identify energized areas for power.

The following message was distributed via Onsolve to impacted customers in Coleville, Walker, Topaz, Woodfords and Markleeville at 16:39 on 9/11/2026:

Email:

This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of a potential wildfire, we continue to monitor for a Public Safety Power Shutoff (PSPS) for your area on Saturday, September 12, at or around 10:00 a.m. Based on recent weather reports, a PSPS is less likely but still possible.

If a PSPS is determined to be necessary, the estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center 442 Mule Deer Drive, Walker, CA starting on Saturday, September 12 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. When CRCs are closed, you can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html> . La página web de Liberty está en español

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty Utilities. Due to extreme weather conditions that increase the risk of a potential wildfire, we continue to monitor for a Public Safety Power Shutoff (PSPS) for your area on Saturday, 9/12 at 10:00 a.m. Based on recent weather reports, a PSPS is less likely but still possible. If a PSPS is determined, the estimated time of restoration is Sunday, 9/13 at 9:00 a.m.

2. Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center 442 Mule Deer Drive, Walker, CA, starting on Saturday, 9/12 from 8 a.m. -10 p.m. When CRCs are closed, you can use the outage map to identify energized areas for power. Details of the PSPS can be found on our website. La página web de Liberty está en español

The following message was distributed via social media channels (Facebook and X) at 16:30 on 9/11/2026:



Liberty Utilities - Tahoe

4 days ago · 🌐

...

Due to extreme weather conditions that increase the risk of wildfire, we continue to monitor for a Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers on Saturday, September 12 at or around 10:00 a.m. Based on recent weather reports, a PSPS is less likely but still possible.

If a PSPS is determined to be necessary, the estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers from 8 a.m.- 10 p.m. throughout the duration of the event, starting at 8:00am on Saturday, at:


- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center, 442 Mule Deer Drive, Walker, CA

When CRCs are closed, you can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/...>

Further details can be found on our webpage: <https://california.libertyutilities.com/.../public-safety...>

La página web de Liberty está en español [See less](#)

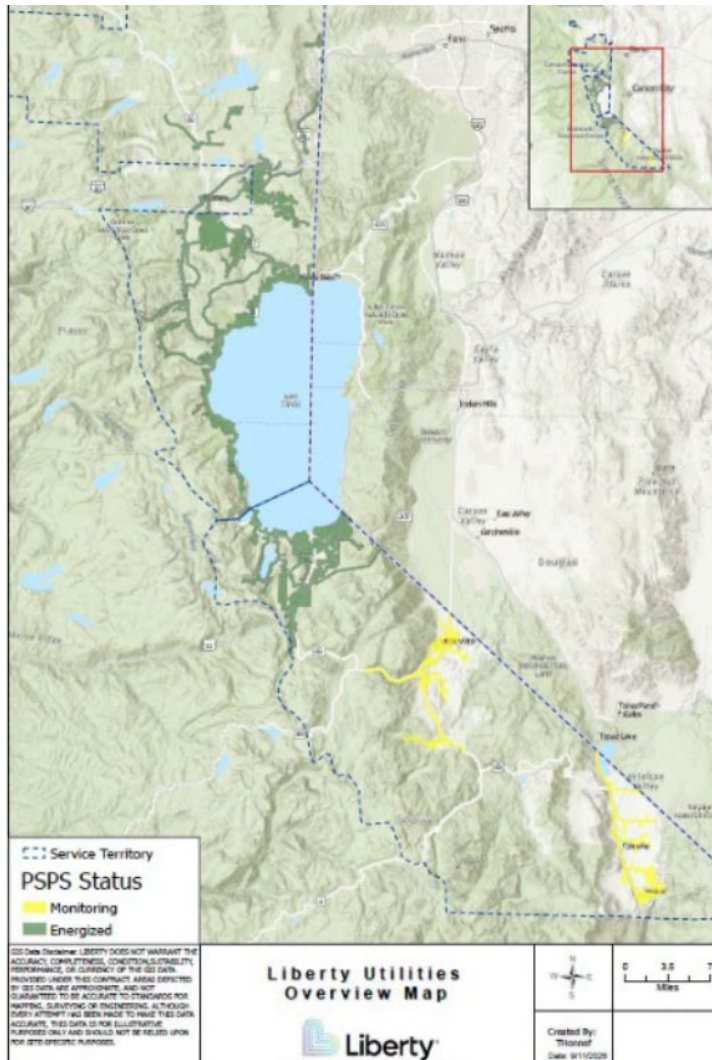

The following website alert was shared on Liberty’s website at 16:30 on 9/11/2026:

Due to extreme weather conditions that increase the risk of a potential wildfire, we continue to monitor for a Public Safety Power Shutoff (PSPS) for Liberty’s customers in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas on or about Saturday, September 12, 2026, at 10 a.m. Based on recent weather reports, a PSPS is less likely but still possible. If a PSPS is determined to be necessary, the estimated time of restoration is Sunday, September 13 at 9:00 a.m.

Customers are encouraged to visit our Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, from 8 a.m. - 10 p.m. throughout the duration of the event,

starting at 8:00 a.m. on Saturday, September 12, if they are unable to secure necessary alternative power. [DETAILS](#)

The following talking points were updated and distributed to staff for customer communications at 16:30 on 9/11/2026:

- Due to evolving weather conditions and real-time on-site observations, Liberty has **canceled the Public Safety Power Shutoff (PSPS) event** for customers in the **Verdi (CA) and Floriston** communities at this time.
 - However, Liberty may still implement a PSPS for **Topaz, Coleville, and Walker** customers due to extreme weather conditions that increase the risk of a potential wildfire.
 - **Map Here:**
 - **Expected start of PSPS outage:** Saturday, September 12, at 10:00 a.m.
 - **Estimated time of restoration:** Sunday, September 13 at about 9:00 a.m.
 - **Expected duration of PSPS outage:** About 23 hours
 - **Number of customers potentially impacted:** Approximately 1,535
 - Customers are encouraged to visit our **Community Resource Centers** at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA or at the Walker Community Center 442 Mule Deer Drive, Walker, CA, starting on Saturday, September 12 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power.
 - Further details can be found on our webpage:
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>
 - Website can be translated into Spanish by clicking on the button in the upper right.
-

September 11 and 12, 2026

Stage 5: PSPS Canceled

The following message was distributed via Onsolve to impacted customers in Verdi and Floriston at 16:22 on 9/11/2026:

Email

This is an important alert from your electric provider, Liberty. The Public Safety Power Shutoff (PSPS) considered for your area is **no longer planned** in light of improved fire weather conditions.

Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

If you are experiencing non-PSPS outage issues, please contact Liberty so crews can be dispatched to investigate and safely restore service.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [Twitter](#) (@LibertyUtil_CA) or visit our website at libertyutilities.com. La página web de Liberty está en español

Phone/Text

This is an important alert from your electric provider, Liberty. The Public Safety Power Shutoff (PSPS) considered for your area is **no longer planned** in light of improved fire weather conditions. Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

La página web de Liberty está en español

The following message was distributed via social media channels (Facebook and X) at 16:30 on 9/11/2026:



Liberty Utilities - Tahoe

4 days ago · 🌐

...

In light of improved fire weather conditions, there will be no planned Public Safety Power Shutoff (PSPS) for Liberty customers in the Verdi (CA) and Floriston communities.

Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

Any customers experiencing non-PSPS outage issues are asked to contact Liberty so crews can be dispatched to investigate and safely restore service. [See less](#)



The following website alert was shared on Liberty's website at 16:30 on 9/11/2026:

In light of improved fire weather conditions, the Public Safety Power Shutoff (PSPS) is no longer planned for Liberty customers in the Verdi (CA) and Floriston communities. Liberty will continue to monitor the situation. [DETAILS](#)

The following media release was shared with the public at 16:30 on 9/11/2026:



Media Release

FOR IMMEDIATE RELEASE:

Contact: Alison Vai

Friday, Sept. 11, 2026

(562) 385-0194

Liberty Cancels Public Safety Power Shutoff (PSPS) for Verdi (CA) and Floriston Customers, Alerts Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker Area Customers of Potential PSPS Due to Extreme Weather Conditions that Increase the Risk of a Potential Wildfire.

Tahoe, California – Liberty Utilities (Liberty) has notified its **Verdi (CA) and Floriston** customers that the Public Safety Power Shutoff (PSPS) event has been **canceled** at this time due to evolving weather conditions and real-time on-site observations.

However, Liberty may still implement a PSPS event for its **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers** on **Saturday, September 12 at 10:00 a.m.** to reduce wildfire risk and promote the safety of the community during the anticipated extreme weather conditions. If a PSPS is implemented, the estimated time of restoration is Sunday, September 13 at about 9:00 a.m. Please see the impacted areas as detailed in the map attached.

The State of California grants authority to Liberty to implement a PSPS in high-risk areas when extreme weather conditions present a clear danger to public safety.

Customers are encouraged to visit Liberty's Community Resource Centers at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, starting at 8:00am on Saturday, if they are unable to secure the necessary alternative power. Both CRCs will remain open from 8am-10pm throughout the duration of the event. When CRCs are closed, customers can use the outage map to identify energized areas for power. <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

"We understand power outages are never convenient for customers, and we appreciate the community's cooperation as we consider these measures to keep the area safe from wildfires," said Eric Schwarzrock, President, CA Electric.

The following are proactive measures you can take to keep you and your family safe:

- Create an emergency kit that includes, but is not limited to, flashlights, first aid supplies, and local maps. Consult Ready.gov for additional emergency kit necessities.
- Plan for medical needs that may be impacted by a power shutoff, including medications that need refrigeration or devices that require power. Please register any energy-related medical needs by calling 1-800-782-2506.



- Store nonperishable foods and water to support your family for a minimum of 48 hours.
- For additional information and real-time updates, please visit libertyutilities.com or follow us on Facebook ([@LibertyUtilitiesLT](https://www.facebook.com/LibertyUtilitiesLT)) and X ([@LibertyUtil_CA](https://twitter.com/LibertyUtil_CA)).

If a PSPS is implemented for the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas, Liberty will activate the community resource centers listed above to provide customers with essential resources and an opportunity to speak directly with customer care representatives throughout the event.

About Liberty

Liberty is committed to providing safe and reliable natural gas, water, and electricity distribution services to over one million customer connections, including those in California. Liberty's utility operations are primarily located in the United States, with distribution operations including Arizona, Arkansas, Georgia, Illinois, Iowa, Kansas, Massachusetts, Missouri, New Hampshire, New York, Oklahoma, and Texas, as well as utilities in Bermuda, Chile, and New Brunswick, Canada. For more information, please visit www.libertyenergyandwater.com.

The following website alert was shared on Liberty's website at 07:45 on 9/12/2026:

In light of improved weather conditions, the Public Safety Power Shutoff (PSPS) is no longer planned for Liberty customers. At this time, we do not anticipate the need to proactively shut off power to any part of our service area. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation. Liberty will continue to monitor the situation.

The following message was distributed via social media channels (Facebook and X) at 07:45 on 9/12/2026:



Liberty Utilities - Tahoe

4 days ago · 🌐

...

In light of improved fire weather conditions, there will be no planned Public Safety Power Shutoff (PSPS) for Liberty customers in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker communities.

At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

Any customers experiencing non-PSPS outage issues are asked to contact Liberty so crews can be dispatched to investigate and safely restore service. [See less](#)



The following media release was shared with the public at 07:45 on 9/12/2026:

An update from Liberty.

Liberty has canceled the warning of a Public Safety Power Shutoff, (also referred to as a PSPS), due to improved conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

The following message was distributed via Onsolve to impacted customers in Verdi and Floriston at 07:45 on 9/12/2026:

Email

This is an important alert from your electric provider, Liberty. The Public Safety Power Shutoff (PSPS) considered for your area is **no longer planned** in light of improved fire weather conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

If you are experiencing non-PSPS outage issues, please contact Liberty so crews can be dispatched to investigate and safely restore service.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [Twitter](#) (@LibertyUtil_CA) or visit our website at libertyutilities.com. La página web de Liberty está en español

Phone/Text

This is an important alert from your electric provider, Liberty. The Public Safety Power Shutoff (PSPS) considered for your area is **no longer planned** in light of improved fire weather conditions. Liberty will continue to monitor the situation. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

La página web de Liberty está en español

15 Appendix B – Public Safety Partner Notifications

Appendix B: Notifications to PSPs

MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers  Summarize this email



Anne Rarick

To: LeTina Vanetti, jshiltz@sierracounty.ca.gov, lmcgee@sierracounty.ca.gov



Reply



Reply all



Forward



Print



Share



Wed 9/9/2026 6:47 PM



Overview_MonitoringMap_PSP...

2 MB

Hello Sierra County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please don't hesitate to reach out with any questions or concerns. I will send updates throughout the event.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148



Reply



Reply all



Forward

MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers Summarize this email



Anne Rarick

To: teri.gilbert-eisenga@washoetribe.us; edobyns@alpinecountyca.gov



 Reply

 Reply all

 Forward



 PDF



 ...

Wed 9/9/2026 7:00 PM

 Overview_MonitoringMap_PSP...
2 MB

 MullerMonitoringMap_PSPS_20...
2 MB

2 attachments (4 MB)  Save all to OneDrive - Liberty  Download all

Hello Alpine County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached that may be required due to extreme weather conditions that increase the risk of a potential wildfire.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please don't hesitate to reach out with any questions or concerns. I will send updates throughout the event.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148

 Reply

 Reply all

 Forward

MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers  Summarize this email



Anne Rarick



Reply



Reply all



Forward



Print



Calendar

To: Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; wwood@rollingstart.com; aphilips@csssolutions.org; jchtka@estransit.com Wed 9/9/2025 7:00 PM

You forwarded this message on Wed 9/9/2025 7:04 PM

[View conversation](#)



Overview_MonitoringMap_PSP...
2 MB



TopazMonitoringMap_PSPS_20...
2 MB

2 attachments (4 MB)  Save all to OneDrive - Liberty  Download all

Hello Mono County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached that may be required due to extreme weather conditions that increase the risk of a potential wildfire.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergysandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please don't hesitate to reach out with any questions or concerns. I will send updates throughout the event.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148

 Reply

 Reply all

 Forward

MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers  Summarize this email



Anne Rarick

To: MHOAC@mono.ca.gov



Reply



Reply all



Forward



Print



Calendar

Wed 9/9/2026 7:04 PM

You forwarded this message on Thu 9/10/2026 11:41 AM

[View conversation](#)



Overview_MonitoringMap_PSP...
2 MB



TopazMonitoringMap_PSPS_20...
2 MB

2 attachments (4 MB)  Save all to OneDrive - Liberty  Download all

Hello Mono County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached that may be required due to extreme weather conditions that increase the risk of a potential wildfire.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please don't hesitate to reach out with any questions or concerns. I will send updates throughout the event.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148



Reply



Forward



MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers Summarize this email



Anne Rarick

To: LeTina Vanetti; Jamie Shiltz <jshiltz@sierracounty.ca.gov>; Imcgee@sierracounty.ca.gov; Yinnon Hiller <yinnon@freed.org>

Thu 9/10/2026 6:28 PM



2 attachments (3 MB)  Save all to OneDrive - Liberty  Download all

Hello Sierra County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate three Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Tahoe Truckee Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines.	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations.	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators.	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings.	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Anne Rarick
To: Teri Gilbert-Eisenga <teri.gilbert-eisenga@washoetribe.us>; edobyns@alpinecountycalifornia.gov; cory.baird@washoetribe.us
Thu 9/10/2026 5:34 PM

- PSPS.CRC Flyer 9-12-2026.pdf 955 KB
- MullerMonitoringMap_PSPS_20... 2 MB

2 attachments (3 MB) Save all to OneDrive - Liberty Download all

Hello Alpine County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- Expected duration of PSPS outage:** About 24 hours
- Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Tahoe Truckee Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI). Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequences to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from firecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)
P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com
701 National Ave, South Lake Tahoe, California 96148

WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley),Topaz, Coleville, and Walker area customers

To: MHOAC@mono.ca.gov <mhoac@mono.ca.gov>; Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; +3 others Thu 9/10/2025 6:35 PM

PSPS.CRC Flyer 9-12-2026.pdf965 KB

TopazMonitoringMap_PSPS_20...2 MB

2 attachments (3 MB) Save all to OneDrive - Liberty Download all

Hello Mono County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- Expected start of PSPS outage: Saturday, September 12 at 9:00 a.m.
- Estimated time of restoration: Sunday, September 13 at 9:00 a.m.
- Expected duration of PSPS outage: About 24 hours
- Number of customers potentially impacted: Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate three Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Tahoe Truckee Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility line likelihood and consequences to calculate the wildfire risk near Liberty's power lines.	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations.	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators.	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings.	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)
P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com
701 National Ave, South Lake Tahoe, California 96148

Reply

Reply all

Forward

MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers Summarize this email

Anne Rarick
To: LeTina Vanetti <lvannetti@sierracounty.ca.gov>; Jamie Shiltz <jshiltz@sierracounty.ca.gov>; Imcgee@sierracounty.ca.gov; Yinnon Hiller <yinnon@freed.org>
Thu 9/10/2025 6:28 PM

 PPS.CRC Flyer 9-12-2026.pdf 965 KB
 CAL2501_WSH201_Monitoring... 2 MB

2 attachments (3 MB)  Save all to OneDrive - Liberty  Download all

Hello Sierra County partners,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate three Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Tahoe Truckee Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly

Thank you,

Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers and Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers Summarize this email



Anne Rarick

To: Teri Gilbert-Eisenga <teri.gilbert-eisenga@washoetribe.us>; edobyns@alpinecountycalifornia.gov; cory.baird@washoetribe.us

Fri 9/11/2025 5:07 PM

You forwarded this message on Fri 9/11/2025 5:10 PM

[View conversation](#)

 MullerTopazMonitoringMapV2...
2 MB

Hello Alpine County partners,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached that **may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148

Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers and Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers  Summarize this email



Anne Rarick

To: Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cathy Young <cyoung@mono.ca.gov>; mhoac@mono.ca.gov; jchtk@estransit.com; +2 others

Fri 9/11/2026 5:10 PM

 MullerTopazMonitoringMapV2...
2 MB

Hello Mono County partners,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148

FW: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Summarize this email

Anne Rarick

To: Teri Gilbert-Eisenga <teri.gilbert-eisenga@washoetribe.us>; edobyns@alpinecountyca.gov; cory.baird@washoetribe.us

Sat 9/12/2026 8:24 AM

Good morning Alpine County partners,

An update from Liberty.

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)
P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com
701 National Ave, South Lake Tahoe, California 96148

Reply Reply all Forward

undo redo respond share track zoom move quick steps save

Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Summarize this email

Anne Rarick

To: Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cathy Young <cyoung@mono.ca.gov>; mhoac@mono.ca.gov; jchtkia@estranst.com; +2 others

Sat 9/12/2026 8:22 AM

You forwarded this message on Sat 9/12/2026 8:24 AM

View conversation

Good morning Mono County partners,

An update from Liberty.

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Take care,

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)
P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com
701 National Ave, South Lake Tahoe, California 96148

Reply Reply all Forward

Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers and Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers  Summarize this email



Anne Rarick

To: ylinnon@freed.org; Jamie Shiltz <jshiltz@sierracounty.ca.gov>; lmcgee@sierracounty.ca.gov; LeTina Vanetti

  Reply  Reply all  Forward    

Fri 9/11/2026 5:03 PM

You forwarded this message on Fri 9/11/2026 5:07 PM

[View conversation](#)

 MullerTopazMonitoringMapV2...
2 MB

Hello Sierra County partners,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Anne Rarick | Liberty Utilities (California) | Lead, Community Outreach (AFN)

P: (530) 807-7852 E: Anne.Rarick@libertyutilities.com

701 National Ave, South Lake Tahoe, California 96148

From: [Matt Newberry](#)
To: bob.giargiari@evrange.com; [Carl Pancutt](#)
Subject: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Thursday, September 10, 2026 8:44:00 PM
Attachments: [image001.png](#)
[PSPS and CRC Flyer 9-12-2026.pdf](#)
[Overview MonitoringMapV2_PSPS_20260909.pdf](#)

Good evening,

Liberty continues to track incoming weather and fire conditions that may impact one of your service locations that may require Liberty to institute a proactive power shutoff. I'll pass along information as we learn more.

This is an important update from the local electric provider, Liberty. Please be advised of the continued potential for a Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA
- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to

identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
Bcc: [Bill Roderick \(broderick@alpineschoolsca.gov\)](#); [Eric Forsman \(eforsman@alpineschoolsca.gov\)](#); [Heidi Torix \(htorix@esUSD.org\)](#); [Shane Gleason](#); [Alex Keeble-Toll](#); [Hardy Bullock](#); [Lila Heuer \(lheuer@sierracounty.ca.gov\)](#); [John Peters](#); [Sandra Moberly](#); [Debbie Bush \(scottndeb1951@outlook.com\)](#); [Robert Duffield](#); [geoff.ellis@washoe-tribe.us](#); [Steven Cruz@washoe-tribe.us](#); [Ken Quiner](#); [Angela Slais](#); [David Griffith \(dgriffith.9@gmail.com\)](#); [Ethan Gray](#); [JT Chevallier \(jchevallier@alpinecountyca.gov\)](#); [Paul Washam](#); [Rick Johnson](#); [Sam Booth](#); [Taylor Green](#); [Tom Minder](#)
Subject: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Thursday, September 10, 2026 8:35:00 PM
Attachments: [image001.png](#)
[PSPS and CRC Flyer 9-12-2026.pdf](#)
[Overview MonitoringMapV2 PSPS 20260909.pdf](#)

Good evening,

Liberty continues to track incoming weather and fire conditions - at this time, there are no significant updates. I'll pass along information as we learn more.

This is an important update from the local electric provider, Liberty. Please be advised of the continued potential for a Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA
- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and

Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
Bcc: [Bill Roderick \(broderick@alpineschoolsca.gov\)](#); [Eric Forsman \(eforsman@alpineschoolsca.gov\)](#); [Heidi Torix \(htorix@esUSD.org\)](#); [Shane Gleason](#); [John Peters](#); [Sandra Moberly](#); [Debbie Bush \(scottndeb1951@outlook.com\)](#); ["geoff.ellis@washoeTribes.us"](#); ["Steven.Cruz@washoeTribes.us"](#); [Ken Quiner](#); [Angela Slais](#); [David Griffith \(dgriffith.9@gmail.com\)](#); [Ethan Gray](#); [JT Chevallier \(jchevallier@alpinecountyca.gov\)](#); [Paul Washam](#); [Rick Johnson](#); [Sam Booth](#); [Taylor Green](#); [Tom Minder](#); [carl.pancutt@evrange.com](#); [bob.giargiari@evrange.com](#)
Subject: WARNING: Potential Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers
Date: Friday, September 11, 2026 5:34:00 PM
Attachments: [image001.png](#)

Good afternoon,

There remains the potential for Public Safety Power Shutoff (PSPS) event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Due to evolving weather conditions and real-time on-site observations, the PSPS event has been canceled for Liberty customers in the Verdi (CA) and Floriston communities at this time.*

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know (please not updated time estimates):

- ***Expected start of PSPS outage:** Saturday, September 12 at **10:00 a.m.**
- **Estimated time of restoration:** Sunday, September 13 at about **9:00 a.m.**
- **Expected duration of PSPS outage:** About **23 hours**
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Steven Cruz](#); [Geoff Ellis Woodfords Community](#)
Cc: [Ken Quiner](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 7:33:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening, Community Council.

Sharing the information that was sent by Liberty this evening to customers in impacted areas. I know that you are also working directly with other members of our team, including Anne Rarick and John Nalder – I'm reaching out to be another Liberty contact if you need anything.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: ["jheuer@sierracounty.ca.gov"](mailto:jheuer@sierracounty.ca.gov)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:59:28 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening, Supervisor Heuer.

I'm writing to share information that was sent by Liberty this evening to customers in impacted areas including Verdi. Please reach me directly if I can be of assistance with this notice or the Liberty PSPS process.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and

communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Hardy Bullock](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:52:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening, Hardy.

I'm writing to share information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [John Peters](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 7:14:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening, John.

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Sandra Moberly](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 7:13:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening, Sandra.

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire

website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Heidi Torix \(htorix@esusd.org\)](#); [Shane Gleason](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:49:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening Heidi and Shane,

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire

website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Bill Roderick](#); [Eric Forsman \(eforsman@alpineschoolsca.gov\)](mailto:eforsman@alpineschoolsca.gov)
Cc: [Joe Daly](#)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:48:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening Bill and Eric,

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [David Griffith \(dgriffith.9@gmail.com\)](mailto:dgriffith.9@gmail.com)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:46:00 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening David,

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire

website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
To: [Sam Booth](#); [JT Chevallier \(jchevallier@alpinecountyca.gov\)](mailto:jchevallier@alpinecountyca.gov)
Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Wednesday, September 9, 2026 6:43:08 PM
Attachments: [Overview MonitoringMap PSPS 20260909.pdf](#)
[image001.png](#)

Good evening Sam and JT,

Sharing information that was sent by Liberty this evening to customers in impacted areas.

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire

website can be switched to Spanish translation in the top right hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
Bcc: [Robert Duffield](#); [Lila Heuer \(lheuer@sierracounty.ca.gov\)](mailto:lheuer@sierracounty.ca.gov); [Alex Keeble-Toll](#); [Hardy Bullock](#)
Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers
Date: Friday, September 11, 2026 5:39:00 PM
Attachments: [image001.png](#)

Good afternoon,

Due to evolving weather conditions and real-time on-site observations, the **PSPS event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that because **there is still a potential Public Safety Power Shutoff (PSPS) event** for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, communications about PSPS for these customers may still be visible in your communities.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Matt Newberry](#)
Bcc: [Bill Roderick \(broderick@alpineschoolsca.gov\)](#); [Eric Forsman \(eforsman@alpineschoolsca.gov\)](#); [Heidi Torix \(htorix@esUSD.org\)](#); [Shane Gleason](#); [John Peters](#); [Sandra Moberly](#); [Debbie Bush \(scottndeb1951@outlook.com\)](#); ["geoff.ellis@washoeTribe.us"](#); ["Steven.Cruz@washoeTribe.us"](#); [Ken Quiner](#); ["Angela Slais"](#); ["David Griffith \(dgriffith.9@gmail.com\)"](#); ["Ethan Gray"](#); ["JT Chevallier \(jchevallier@alpinecountyca.gov\)"](#); ["Paul Washam"](#); ["Rick Johnson"](#); ["Sam Booth"](#); ["Taylor Green"](#); ["Tom Minder"](#); ["carl.pancutt@evrange.com"](#); [bob.giardiari@evrange.com](#); ["tminder@alpinecountyca.gov"](#)
Subject: PSPS CANCELLATION: Notice of Cancelled Public Safety Power Shutoff (PSPS) from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:39:00 AM
Attachments: [image001.png](#)

Good morning,

An important update from Liberty. Liberty has **canceled** the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to **any part** of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Best regards,

Matt Newberry

Liberty Tahoe

Strategic Growth & Community Affairs

530-721-6834

matt.newberry@libertyutilities.com



From: [Jennifer Guenther](#)
To: ["erik.brahms@sen.ca.gov"](mailto:erik.brahms@sen.ca.gov)
Cc: ["nate solov"](#)
Subject: RE: CANCELED: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and CANCELED PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:40:00 AM
Attachments: [LibertyMap_PSPS_Cancelled_20260912.pdf](#)
[image001.png](#)

Good morning,

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Please reach out with any questions or feedback you or your constituents may have.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, September 11, 2026 5:09 PM
To: 'erik.brahms@sen.ca.gov' <erik.brahms@sen.ca.gov>
Cc: 'nate solov' <nate@solovadvocacy.com>
Subject: RE: WATCH: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and POTENTIAL PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good afternoon, This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of

a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

Feel free to reach out with any questions or feedback you may have.

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 6:21 PM

To: erik.brahms@sen.ca.gov

Cc: nate solov <nate@solovadvocacy.com>

Subject: RE: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook Post:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Wednesday, September 9, 2026 7:02 PM

To: erik.brahms@sen.ca.gov

Cc: nate solov <nate@solovadvocacy.com>

Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be

impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: [Jennifer Guenther](#)
To: [Spake, Valerie](#)
Cc: [nate solov](#)
Subject: RE: CANCELED: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:39:00 AM
Attachments: [LibertyMap_PSPS_Cancelled_20260912.pdf](#)
[image001.png](#)

Good morning,

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Please reach out with any questions or feedback you or your constituents may have.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, September 11, 2026 5:06 PM
To: 'Spake, Valerie' <valerie.spake@sen.ca.gov>
Cc: 'nate solov' <nate@solovadvocacy.com>
Subject: RE: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good afternoon,

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline

Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

Feel free to reach out with any questions or feedback you may have.

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 6:15 PM

To: Spake, Valerie <valerie.spake@sen.ca.gov>

Cc: nate solov <nate@solovadvocacy.com>

Subject: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook Post:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Wednesday, September 9, 2026 7:01 PM

To: Spake, Valerie <valerie.spake@sen.ca.gov>

Cc: nate solov <nate@solovadvocacy.com>

Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be

impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: [Jennifer Guenther](#)
To: ["james.zandastra@mail.house.gov"](mailto:james.zandastra@mail.house.gov)
Cc: ["George Redden"; Sandi Hennequin](#)
Subject: RE: CANCELED: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and CANCELED PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:41:00 AM
Attachments: [LibertyMap_PSPS_Cancelled_20260912.pdf](#)
[image001.png](#)

Good morning,

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Please reach out with any questions or feedback you or your constituents may have.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, September 11, 2026 5:10 PM
To: james.zandastra@mail.house.gov
Cc: George Redden <george@kbsgroupllp.com>; Sandi Hennequin <Sandi.Hennequin@libertyutilities.com>
Subject: RE: WATCH: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and POTENTIAL PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good afternoon,

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

Feel free to reach out with any questions or feedback you may have.

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 6:23 PM

To: james.zandastra@mail.house.gov

Cc: George Redden <george@kbsgroupllp.com>; Sandi Hennequin <Sandi.Hennequin@libertyutilities.com>

Subject: RE: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker

area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook Post:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake->

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 1:17 PM

To: james.zandastra@mail.house.gov

Cc: George Redden <george@kbsgroupllp.com>; Sandi Hennequin <Sandi.Hennequin@libertyutilities.com>

Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.

Estimated time of restoration: Sunday, September 13 at 9:00 a.m.

- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs

P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: [Jennifer Guenther](#)
To: ["ian.coolbear@asm.ca.gov"](mailto:ian.coolbear@asm.ca.gov)
Cc: ["nate solov"](#)
Subject: RE: CANCELED: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and CANCELED PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:41:00 AM
Attachments: [LibertyMap_PSPS_Cancelled_20260912.pdf](#)
[image001.png](#)

Good morning,

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Please reach out with any questions or feedback you or your constituents may have.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, September 11, 2026 5:07 PM
To: ian.coolbear@asm.ca.gov
Cc: [nate solov <nate@solovadvocacy.com>](mailto:nate@solovadvocacy.com)
Subject: RE: WATCH: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and POTENTIAL PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good afternoon,

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

Feel free to reach out with any questions or feedback you may have.

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 6:20 PM

To: ian.coolbear@asm.ca.gov

Cc: nate solov <nate@solovadvocacy.com>

Subject: RE: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook Post:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Wednesday, September 9, 2026 7:01 PM

To: ian.coolbear@asm.ca.gov

Cc: nate solov <nate@solovadvocacy.com>

Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be

impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: [Jennifer Guenther](#)
To: ["Nickens, Andrew"](#)
Cc: ["nate solov"](#)
Subject: RE: CANCELED: Notice of Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and CANCELED PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:37:00 AM
Attachments: [LibertyMap_PSPS_Cancelled_20260912.pdf](#)
[image001.png](#)

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved fire conditions. At this time, we do not anticipate the need to proactively shut off power to any part of our service area.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Please reach out with any questions or feedback you or your constituents may have.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, September 11, 2026 5:04 PM
To: 'Nickens, Andrew' <andrew.nickens@asm.ca.gov>
Cc: 'nate solov' <nate@solovadvocacy.com>
Subject: RE: WATCH: Notice of CANCELED Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston and POTENTIAL PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

Feel free to reach out with any questions or feedback you may have.

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, September 10, 2026 6:12 PM

To: 'Nickens, Andrew' <andrew.nickens@asm.ca.gov>

Cc: 'nate solov' <nate@solovadvocacy.com>

Subject: RE: WATCH: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA)*, Floriston*, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker**

areas, as detailed in the map attached that may be required due to extreme weather conditions that increase the risk of a potential wildfire. *Verdi and Floriston are currently in a monitoring stance where a PSPS is possible but less likely based on recent weather forecasts.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours
- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA
- Truckee Tahoe Airport, 10356 Truckee Airport Rd., Truckee, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Facebook Post:

Wondering how Liberty determines if a PSPS is necessary?

Liberty monitors weather, vegetation, fire conditions, and the electric system to understand wildfire risk. This information is used to calculate the Composite Risk Index (CRI).

Based on the CRI and these conditions, when wildfire risk is evaluated to be high, Liberty may take extra safety steps, such as implementing a Public Safety Power Shutoff, to help protect the public.

Learn more: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Risk Indicator	What We Monitor	Why It Matters
 Composite Risk Index (CRI)	The CRI combines utility fire likelihood and consequence to calculate the wildfire risk near Liberty's power lines	It helps us decide when extra safety steps may be needed, including a possible Public Safety Power Shutoff.
 Wind Conditions	Wind speeds and gusts from forecasts and weather stations	Strong winds can damage power lines or blow debris into them. Wind can also cause a fire to spread faster.
 Vegetation and Fuel Conditions	Fuel moisture, vegetation dryness, and fire behavior indicators	Dry plants can catch fire more easily and cause a fire to burn hotter and spread faster.
 Fire Weather Conditions	Temperature, humidity, dryness, and other fire weather warnings	Hot, dry, and windy weather can increase the chance that a fire will start and spread rapidly.

Thank you,

Jennifer Guenther | Liberty Utilities (West Region) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Wednesday, September 9, 2026 6:57 PM

To: Nickens, Andrew <andrew.nickens@asm.ca.gov>

Cc: nate solov <nate@solovadvocacy.com>

Subject: MONITORING: Notice of Potential Public Safety Power Shutoff (PSPS) from Liberty for Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

Good evening,

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key stakeholders regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 9:00 a.m.
- **Estimated time of restoration:** Sunday, September 13 at 9:00 a.m.
- **Expected duration of PSPS outage:** About 24 hours

- **Number of customers potentially impacted:** Approximately 1,633 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers starting on Saturday, September 12, at 8 a.m. - 10 p.m. that will remain open throughout the PSPS:

- Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- Walker Community Center, 442 Mule Deer Drive, Walker, CA

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). When CRCs are closed, customers can use the outage map to identify energized areas for power: <https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

In addition, [here is the website with PSPS information in multiple languages](#). Our entire website can be switched to Spanish translation in the top right-hand corner.

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

[Preparing for a PSPS Video](#)

[What to do during a PSPS Video](#)

[What to do after a PSPS Video](#)

Please reach out with any questions or concerns. I will send updates throughout the event.

Thank you,

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Director, Government & Regulatory Affairs
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: [Peter Stoltman](#)
To: [John Gulserian](#); [stevenponcelet@tdpud.org](#); [carrie.thaler@usda.gov](#); [mikefisher@sierracounty.ca.gov](#); [lmcgee@sierracounty.ca.gov](#); [LeTina Vanetti](#); [Terry Hughes](#); [ken.quiner@washoetribe.us](#); [tstreeper@alpinecountyca.gov](#); [charootunian@alpineso.com](#); [aslais@alpinecountyca.gov](#); [jbaker@alpineso.com](#); [nwilliamson@alpinecountyca.gov](#); [pwasham@alpinecountyca.gov](#)
Cc: [John Nalder](#); [Matt Newberry](#); [Scott Witt](#); [Anne Rarick](#); [Jennifer Guenther](#)
Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers and Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Friday, September 11, 2026 3:59:00 PM
Importance: High

All,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned Public Safety Power Shutoff (PSPS) event has been canceled for Liberty customers in the Verdi (CA) and Floriston communities at this time.

However, please be advised that there is still a potential PSPS event for Liberty's customers in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas, as detailed in the map attached that may be required due to extreme weather conditions that increase the risk of a potential wildfire.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- Expected start of PSPS outage: Saturday, September 12 at 10:00 a.m.
- Estimated time of restoration for PSPS outage: Sunday, September 13 at about 9:00 a.m.
- Expected duration of PSPS outage: About 23 hours
- Number of customers potentially impacted: Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal

[HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Peter Stoltman | [Liberty Utilities \(California\)](#) | Director, Wildfire Prevention

C: 530-721-5418 | E: Peter.Stoltman@libertyutilities.com

701 National Ave, Tahoe Vista, California 96148

From: [Peter Stoltman](#)
To: [John Gulserian](#); [stevenponcelet@tdpud.org](#); [mikefisher@sierracounty.ca.gov](#); [lmcgee@sierracounty.ca.gov](#); [LeTina Vanetti](#); [Terry Hughes](#); [ken.quiner@washoetribe.us](#); [tstreeper@alpinecountyca.gov](#); [aslais@alpinecountyca.gov](#); [jbaker@alpineso.com](#); [pwasham@alpinecountyca.gov](#)
Cc: [Jordan Parrillo](#); [John Nalder](#); [Scott Witt](#); [Anne Rarick](#); [Matt Newberry](#); [Jennifer Guenther](#)
Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:38:00 AM
Importance: High

An update from Liberty.

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved weather conditions. We do not anticipate the need to proactively shut off power to any part of our service area at this time.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Peter Stoltman | Liberty Utilities (California) | Director, Wildfire Prevention
C: 530-721-5418 | E: Peter.Stoltman@libertyutilities.com
701 National Ave, Tahoe Vista, California 96148

From: [Peter Stoltman](#)
To: ["rcnalders54@gmail.com"](#); ["bbullock@mono.ca.gov"](#); ["ibraun@monosheriff.org"](#)
Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers
Date: Saturday, September 12, 2026 7:57:00 AM
Importance: High

An update from Liberty.

Liberty has canceled the warning of a Public Safety Power Shutoff, or PSPS, due to improved weather conditions. We do not anticipate the need to proactively shut off power to any part of our service area at this time.

Liberty will continue to monitor the situation. On behalf of Liberty and our public safety partners, we would like to thank you for your patience and cooperation as we all work together to keep our community safe.

Peter Stoltman | [Liberty Utilities \(California\)](#) | Director, Wildfire Prevention
C: 530-721-5418 | **E:** Peter.Stoltman@libertyutilities.com
701 National Ave, Tahoe Vista, California 96148

From: [John Nalder](#)
To: ["jgreen@alpineso.com"](mailto:jgreen@alpineso.com)
Subject: Coordination Request Regarding Potential PSPS in Alpine County
Date: Thursday, September 10, 2026 4:35:00 PM

Sheriff Green,

Liberty is anticipating a potential Public Safety Power Shutoff (PSPS) in the area we serve in Alpine County, specifically in and around Markleeville, on Saturday, September 12.

I would like to establish a communication channel with your Office of Emergency Services to ensure we remain coordinated and can share updates as needed. If you could please give me a call at your earliest convenience for a brief conversation and situational update, I would greatly appreciate it.

Thank you for your time, and I look forward to speaking with you soon.

Cheers,

John Nalder | Liberty Utilities (California) | Manager, Emergency Management
Phone: 530.721.1363 Email: John.Nalder@libertyutilities.com

From: John Nalder <John.Nalder@libertyutilities.com>
Sent: Saturday, 12 September 2026 08:13:31
To: Bartlett, Lindsey (NV Energy) <Lindsey.Bartlett@nvenergy.com>; Greg Almos <almosg@eldoradosheriff.gov>; eldoradooes@edso.org <eldoradooes@edso.org>; Dave Atkinson <datkinso@placer.ca.gov>; OESDO@pplacer.gov <OESDO@pplacer.gov>; James Blattler <jblattler@townoftruckee.gov>; lvaneti@sierracounty.ca.gov <lvaneti@sierracounty.ca.gov>; tgreen@alpineso.com <tgreen@alpineso.com>; Loripini@countyofplumas.com <Loripini@countyofplumas.com>
Cc: Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Jordan Parrillo <Jordan.Parrillo@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>
Subject: PSPS Watch Update – PSPS No Longer Anticipated

Liberty Utilities has canceled its Public Safety Power Shutoff (PSPS) watch due to improved fire weather conditions. At this time, we do not anticipate the need to proactively de-energize any portion of our service area.

Liberty will continue to monitor weather, fire conditions, and system impacts and will provide updates should conditions change.

Thank you for your partnership and support throughout this event. We greatly appreciate the coordination and collaboration that helps keep our communities safe.

Have a great weekend,

John Nalder | **Liberty Utilities** (California) | Manager, Emergency Management
Phone: 530.721.1363 Email: John.Nalder@libertyutilities.com

From: [John Nalder](#)
To: [Bartlett, Lindsey \(NV Energy\)](#); [Greg Almos](#); "[eldoradoes@edso.org](#)"; [Dave Atkinson](#); "[OESDO@oplacer.gov](#)"; [James Blattler](#); "[lvaneti@sierracounty.ca.gov](#)"; [tgreen@alpineso.com](#); "[Loriplni@countyofplumas.com](#)"
Cc: [Peter Stoltman](#); [Jordan Parrillo](#); [Scott Witt](#)
Subject: PSPS Watch Update – PSPS No Longer Anticipated
Date: Saturday, September 12, 2026 8:13:00 AM

Liberty Utilities has canceled its Public Safety Power Shutoff (PSPS) watch due to improved fire weather conditions. At this time, we do not anticipate the need to proactively de-energize any portion of our service area.

Liberty will continue to monitor weather, fire conditions, and system impacts and will provide updates should conditions change.

Thank you for your partnership and support throughout this event. We greatly appreciate the coordination and collaboration that helps keep our communities safe.

Have a great weekend,

John Nalder | [Liberty Utilities \(California\)](#) | Manager, Emergency Management
Phone: 530.721.1363 Email: John.Nalder@libertyutilities.com

From: John Nalder <John.Nalder@libertyutilities.com>

Sent: Saturday, September 12, 2026 8:14 AM

To: Bartlett, Lindsey (NV Energy) <Lindsey.Bartlett@nvenergy.com>; Greg Almos <almosg@eldoradosheriff.gov>; eldoradoes@edso.org; Dave Atkinson <datkinso@placer.ca.gov>; OESDO@pplacer.gov; James Blattler <jblattler@townoftruckee.gov>; lvaneti@sierracounty.ca.gov; tgreen@alpineso.com; Pini, Lori <loripini@countyofplumas.com>

Cc: Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Jordan Parrillo <Jordan.Parrillo@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>

Subject: PSPS Watch Update – PSPS No Longer Anticipated

CAUTION: This email originated from OUTSIDE THE ORGANIZATION. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Liberty Utilities has canceled its Public Safety Power Shutoff (PSPS) watch due to improved fire weather conditions. At this time, we do not anticipate the need to proactively de-energize any portion of our service area.

Liberty will continue to monitor weather, fire conditions, and system impacts and will provide updates should conditions change.

Thank you for your partnership and support throughout this event. We greatly appreciate the coordination and collaboration that helps keep our communities safe.

Have a great weekend,

John Nalder | **Liberty Utilities** (California) | Manager, Emergency Management

From: [John Nalder](#)
To: [LeTina Vanetti](#)
Subject: PSPS Watch Update – PSPS No Longer Anticipated
Date: Saturday, September 12, 2026 8:25:00 AM

Liberty Utilities has canceled its Public Safety Power Shutoff (PSPS) watch due to improved fire weather conditions. At this time, we do not anticipate the need to proactively de-energize any portion of our service area.

Liberty will continue to monitor weather, fire conditions, and system impacts and will provide updates should conditions change.

Thank you for your partnership and support throughout this event. We greatly appreciate the coordination and collaboration that helps keep our communities safe.

Have a great weekend,

John Nalder | **Liberty Utilities (California)** | Manager, Emergency Management
Phone: 530.721.1363 Email: John.Nalder@libertyutilities.com

From: [John Nalder](#)
To: ["OESDO@placerca.gov"](mailto:OESDO@placerca.gov)
Subject: PSPS Watch Update – PSPS No Longer Anticipated
Date: Saturday, September 12, 2026 8:23:00 AM

Liberty Utilities has canceled its Public Safety Power Shutoff (PSPS) watch due to improved fire weather conditions. At this time, we do not anticipate the need to proactively de-energize any portion of our service area.

Liberty will continue to monitor weather, fire conditions, and system impacts and will provide updates should conditions change.

Thank you for your partnership and support throughout this event. We greatly appreciate the coordination and collaboration that helps keep our communities safe.

Have a great weekend,

John Nalder | [Liberty Utilities \(California\)](#) | Manager, Emergency Management
Phone: 530.721.1363 Email: John.Nalder@libertyutilities.com

From: [Scott Witt](#)
To: [Walden, Isaac - FS, NV](#); joe.walton@fire.ca.gov; Richter, Tim@CALFIRE
Subject: PSPS Update
Date: Friday, September 11, 2026 4:31:05 PM

See below. This is a dynamic forecast - expect conditions to change after Liberty's 0645 AM forecast update.

Scott Witt
Fire Prevention Specialist
Liberty Utilities

(530) 580-7495 cell/text

From: Peter Stoltman <Peter.Stoltman@libertyutilities.com>
Sent: Friday, September 11, 2026 18:59

Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers and Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

All,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Peter Stoltman | [Liberty Utilities \(California\)](#) | Director, Wildfire Prevention

C: 530-721-5418 | E: Peter.Stoltman@libertyutilities.com

701 National Ave, Tahoe Vista, California 96148

From: [Scott Witt](#)
To: [Mike Curtis](#); [Ramirez, Arnold@CALFIRE](#); [Jed Gaines](#)
Subject: PSPS Update
Date: Friday, September 11, 2026 4:28:10 PM

See below. This is a dynamic forecast - expect conditions to change after Liberty's 0645 AM forecast update.

Scott Witt
Fire Prevention Specialist
Liberty Utilities

(530) 580-7495 cell/text

From: Peter Stoltman <Peter.Stoltman@libertyutilities.com>
Sent: Friday, September 11, 2026 18:59

Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers and Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

All,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts

and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Peter Stoltman | [Liberty Utilities \(California\)](#) | Director, Wildfire Prevention
C: 530-721-5418 | E: Peter.Stoltman@libertyutilities.com
701 National Ave, Tahoe Vista, California 96148

From: [Scott Witt](#)
To: [Lori Pini](#)
Subject: PSPS Update
Date: Friday, September 11, 2026 4:38:29 PM

See below. This is a dynamic forecast - expect conditions to change after Liberty's 0645 AM forecast update.

Scott Witt
Fire Prevention Specialist
Liberty Utilities

(530) 580-7495 cell/text

From: Peter Stoltman <Peter.Stoltman@libertyutilities.com>
Sent: Friday, September 11, 2026 18:59

Subject: Notice of Canceled Public Safety Power Shutoff (PSPS) from Liberty for Verdi and Floriston customers and Potential PSPS for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

All,

I may have inadvertently left some personnel off this distribution list. Please forward this message as necessary to anyone in your organization who needs to be advised of the status update.

This is an important alert from the local electric provider, Liberty.

Due to evolving weather conditions and real-time on-site observations, the planned **Public Safety Power Shutoff (PSPS) event has been canceled** for Liberty customers in the **Verdi (CA) and Floriston** communities at this time.

However, please be advised that there is **still a potential PSPS** event for Liberty's customers in the **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire**.

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Saturday, September 12 at 10:00 a.m.
- **Estimated time of restoration for PSPS outage:** Sunday, September 13 at about 9:00 a.m.
- **Expected duration of PSPS outage:** About 23 hours
- **Number of customers potentially impacted:** Approximately 1,535 customers may be impacted by Liberty's potential PSPS. See map for details.

To view the affected areas and stay up-to-date, please visit our Public Safety Partner portal [HERE](#).

Liberty will activate two Community Resource Centers starting on Saturday, September 12 at 8 a.m.- 10 p.m. that will remain open throughout the PSPS:

- The Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA
- The Walker Community Center 442 Mule Deer Drive, Walker, CA

When CRCs are closed, customers are encouraged to use the outage map to identify energized areas for power:

<https://myaccount.libertyenergyandwater.com/portal/#/PreOutages>

Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform). Our website can be translated into Spanish by clicking the button in the upper right.

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts

and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Feel free to reach out with any questions you may have.

Peter Stoltman | [Liberty Utilities \(California\)](#) | Director, Wildfire Prevention
C: 530-721-5418 | E: Peter.Stoltman@libertyutilities.com
701 National Ave, Tahoe Vista, California 96148

From: [Scott Witt](#)
To: [Scott Witt](#)
Bcc: [Ramirez, Arnold@CALFIRE](#); [Richter, Tim@CALFIRE](#); [Walton, Joe@CALFIRE](#); [Jed Gaines](#); [Mike Curtis](#); [loripini@countyofplumas.com](#); [Walden, Isaac - FS, NV](#)
Subject: Liberty PSPSs canceled
Date: Saturday, September 12, 2026 7:27:12 AM
Importance: High

Due to improved weather forecasts, Liberty Utilities has CANCELED all scheduled PSPSs.

Fire weather concerns remain elevated, and parts of our system are now in "extreme fire mode".

Scott Witt
Fire Prevention Specialist
Liberty Utilities

(530) 580-7495 cell/text

16 Appendix C – CPUC Notifications

From: [Jordan Parrillo](#)
To: ["DeMayo, Ronald"](#); ["Noll, Anthony"](#); ["Palmer, Leslie L."](#); ["pspsnotification@cpuc.ca.gov"](#)
Cc: [Eric Schwarzrock](#); [Peter Stoltman](#); [John Nalder](#); [Scott Witt](#); [Sharon Yang](#); [Dan Marsh](#)
Subject: Liberty September 12, 2026 Public Safety Power Shutoff Event Canceled
Date: Saturday, September 12, 2026 7:38:00 AM

Good morning,

Liberty Utilities (Liberty) is providing the California Public Utilities Commission an update that the Public Safety Power Shutoff (PSPS) event in the Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas has been canceled. Due to improved weather conditions, the need to de-energize the electric grid has been averted.

Pertinent details:

- Critical fire weather conditions are no longer forecasted to reach PSPS thresholds for the aforementioned areas.
- Liberty notified the 165 customers in the Verdi (CA) and Floriston areas of the cancellation on 9/11/2026. The remaining 1,498 customers, including 18 Medical Baseline (MBL) customers, will receive notification of the cancellation.
- Public safety partners will be contacted and made aware of the cancellation.

Our team will soon begin development of the post-PSPS report using the data we collected throughout the event and submit the document to the California Public Utilities Commission by the required date.

Thank you for your support throughout this public safety event.

Sincerely,

Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo
Sent: Friday, September 11, 2026 3:59 PM
To: 'DeMayo, Ronald' <Ronald.DeMayo@cpuc.ca.gov>; 'Noll, Anthony' <Anthony.Noll@cpuc.ca.gov>; 'Palmer, Leslie L.' <Leslie.Palmer@cpuc.ca.gov>; 'pspsnotification@cpuc.ca.gov' <pspsnotification@cpuc.ca.gov>
Cc: Eric Schwarzrock <Eric.Schwarzrock@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; John Nalder <John.Nalder@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Dan Marsh <Dan.Marsh@libertyutilities.com>
Subject: Potential Liberty Public Safety Power Shutoff Event - September 12, 2026

Good afternoon,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we are still monitoring a potential Public Safety Power Shutoff (PSPS) event in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 24 hours to

reduce wildfire risk and protect the safety of the community during the anticipated extreme weather conditions.

Pertinent details:

- Extreme weather conditions are now forecasted for the aforementioned areas starting Saturday, September 12, 2026 at 10:00 AM PST until Sunday, September 13, 2026 at 3:00 AM PST. Forecasts of critical fire weather conditions have been improving throughout the monitoring period. We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.
- Due to improved critical fire weather conditions, Liberty has cancelled the PSPS event for 165 customers in the Verdi (CA) and Floriston areas.
- Approximately 1,498 customers, including 18 Medical Baseline (MBL) customers, remain in scope for the potential PSPS event.
- Liberty has notified all potentially impacted customers throughout the event. 16 MBL customers have positively affirmed that they received a notification from Liberty regarding the event. Liberty left door hangers at the remaining two MBL customer locations.
- Public safety partners have been contacted.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty will activate two Community Resource Centers (CRCs) starting on Saturday, September 12, 2026 at 8:00 AM PST at the below locations. They will be open from 8:00am-10:00pm throughout the duration of the event.
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA.
- The current estimated time of restoration is Sunday, September 13, 2026 at 9:00 AM PST.

Thank you for your continued support and cooperation as we work to keep our communities safe.

Sincerely,

Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs

P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Friday, September 11, 2026 9:06 AM

To: 'DeMayo, Ronald' <Ronald.DeMayo@cpuc.ca.gov>; 'Noll, Anthony' <Anthony.Noll@cpuc.ca.gov>; 'Palmer, Leslie L.' <Leslie.Palmer@cpuc.ca.gov>; 'pspsnotification@cpuc.ca.gov' <pspsnotification@cpuc.ca.gov>

Cc: Eric Schwarzrock <Eric.Schwarzrock@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; John Nalder <John.Nalder@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Dan Marsh <Dan.Marsh@libertyutilities.com>

Subject: Potential Liberty Public Safety Power Shutoff Event - September 12, 2026

Good morning,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we are still monitoring a potential Public Safety Power Shutoff (PSPS) event in the Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 24 hours to reduce wildfire risk and protect the safety of the community during the anticipated extreme weather conditions.

Pertinent details:

- Extreme weather conditions are now forecasted for the aforementioned areas starting Saturday, September 12, 2026 at 9:00 AM PST until Sunday, September 13, 2026 at 3:00 AM PST. Forecasts of critical fire weather conditions have been improving throughout the monitoring period. We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Approximately 1663 customers, including 18 Medical Baseline (MBL) customers, could be impacted.
- Liberty has notified all potentially impacted customers. 16 MBL customers have positively affirmed that they received a notification from Liberty regarding the event. Liberty has left door hangers at the remaining two MBL customer locations.
- Public safety partners have been contacted.
- Liberty will activate three Community Resource Centers (CRCs) starting on Saturday, September 12, 2026 at 8:00 AM PST at the below locations. They will be open from 8:00am-10:00pm throughout the duration of the event.
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA, and
 - Truckee Tahoe Airport, 10356 Truckee Airport Rd, Truckee, CA.
- The current estimated time of restoration is Sunday, September 13, 2026 at 9:00 AM PST.

Thank you for your continued support and cooperation as we work to keep our communities safe.

Sincerely,

Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs

P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Thursday, September 10, 2026 9:40 AM

To: 'DeMayo, Ronald' <Ronald.DeMayo@cpuc.ca.gov>; 'Noll, Anthony' <Anthony.Noll@cpuc.ca.gov>; 'Palmer, Leslie L.' <Leslie.Palmer@cpuc.ca.gov>; 'pspsnotification@cpuc.ca.gov' <pspsnotification@cpuc.ca.gov>

Cc: Eric Schwarzrock <Eric.Schwarzrock@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; John Nalder <John.Nalder@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Dan Marsh

<Dan.Marsh@libertyutilities.com>

Subject: Potential Liberty Public Safety Power Shutoff Event - September 12, 2026

Good morning,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we are still monitoring a potential Public Safety Power Shutoff (PSPS) event in the Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 48 hours to reduce wildfire risk and ensure the safety of the community during the anticipated extreme weather conditions.

Pertinent details:

- Extreme weather conditions are forecasted for the aforementioned areas starting Saturday, September 12, 2026 at 9:00 AM PST until Saturday, September 12, 2026 at 10:00 PM PST.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Approximately 1663 customers, including 18 Medical Baseline (MBL) customers, could be impacted.
- Liberty has notified all potentially impacted customers. 12 MBL customers have positively affirmed that they received a notification from Liberty regarding the event. Liberty will continue attempting to positively affirm that all MBL customers potentially impacted have received a notification from Liberty.
- Public safety partners have been contacted.
- Liberty will activate two Community Resource Centers (CRCs) starting on Saturday, September 12, 2026 at 8:00 AM PST at the below locations. They will be open from 8:00am-10:00pm throughout the duration of the event.
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA.
- The current estimated time of restoration is Sunday, September 13, 2026 at 9:00 AM PST.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your continued support and cooperation as we work to keep our communities safe.

Sincerely,

Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs

P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Wednesday, September 9, 2026 8:07 PM

To: 'DeMayo, Ronald' <Ronald.DeMayo@cpuc.ca.gov>; 'Noll, Anthony'

<Anthony.Noll@cpuc.ca.gov>; 'Palmer, Leslie L.' <Leslie.Palmer@cpuc.ca.gov>;

'pspsnotification@cpuc.ca.gov' <pspsnotification@cpuc.ca.gov>

Cc: Eric Schwarzrock <Eric.Schwarzrock@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; John Nalder <John.Nalder@libertyutilities.com>; Scott Witt <Scott.Witt@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Dan Marsh <Dan.Marsh@libertyutilities.com>

Subject: Potential Liberty Public Safety Power Shutoff Event - September 12, 2026

Good evening,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we are monitoring a potential Public Safety Power Shutoff (PSPS) event in the Verdi (CA), Floriston, Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 61 hours to reduce wildfire risk and ensure the safety of the community during the anticipated extreme weather conditions.

Pertinent details:

- Extreme weather conditions are forecasted for the aforementioned areas starting Saturday, September 12, 2026 at 9:00 AM PST until Saturday, September 12, 2026 at 10:00 PM PST.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Approximately 1663 customers, including 18 Medical Baseline (MBL) customers, could be impacted.
- Liberty has notified all potentially impacted customers.
- Public safety partners have been contacted.
- Liberty will activate two Community Resource Centers (CRCs) starting on Saturday, September 12, 2026 at 8:00 AM PST at the below locations. They will be open from 8:00am-10:00pm throughout the duration of the event.
 - Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and
 - Walker Community Center, 442 Mule Deer Drive, Walker, CA.
- The current estimated time of restoration is Sunday, September 13, 2026 at 9:00 AM PST.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,

Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

17 Appendix D – Local and State Public Safety Partner Engagement

Table D-1: Local and State Public Safety Partner Engagement

Appendix D: Local and State Public Safety Partner Engagement

Entity Name	PSP Type	Organization	Title	HFTD Tier	Date Contacted	Time Contacted
Joe Walton, Jed Gaines, Tim Richter, Arnold Ramirez	CAL FIRE	CAL FIRE	LMU Division Chief, AEU Division Chief, NEU Division Chief, BDU Division Chief	2	9/9/2026	5:22
Isaac Walden	Emergency Response Providers	US Forest Service	Division Chief	2	9/9/2026	5:22
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/9/2026	7:15
Group	Emergency Response Providers	NV Energy / TPUD	Group	2	9/9/2026	8:30
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/9/2026	12:04
Minda Moty	Emergency Response Providers	FireDAWG, Inc.	Chief Financial Officer	2	9/9/2026	12:30
Ken Quiner	Emergency Response Providers	Washoe Tribe	Tribal Emergency Manager	2	9/9/2026	12:40
Mike Curti	Emergency Response Providers	Antelope Valley Fire Protection District	Fire Chief	2	9/9/2026	13:01
Joe Walton, Jed Gaines, Tim Richter, Arnold Ramirez	CAL FIRE	CAL FIRE	LMU Division Chief, AEU Division Chief, NEU Division Chief, BDU Division Chief	2	9/9/2026	13:24
Jeff Menasco	Emergency Response Providers	Truckee Airport	CRC Contact	2	9/9/2026	13:30
Jeff Menasco	Emergency Response Providers	Truckee Tahoe Airport	CRC Contact	2	9/9/2026	16:40
James Blatter	Emergency Response Providers	Tahoe Truckee Airport	Emergency Services Manager	2	9/9/2026	17:10
Rob Etnyre	Emergency Response Providers	Truckee Tahoe Airport	General Manager	2	9/9/2026	17:30
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/9/2026	18:00
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/9/2026	18:47
Jamie Shilz, Lori McGee	Emergency Response Providers	Sierra County Health and Human Services	Social Services Manager, Interim Director of Social Services	2	9/9/2026	18:47
CalOES	CalOES	CalOES	N/A		9/9/2026	18:54
Andrew Nickens	Emergency Response Providers	Assemblymember Hadwick's Office	Legislative Assistant	2	9/9/2026	18:57
Erin Dobyns	Emergency Response Providers	Alpine County Health and Human Services	Deputy Director of Health and Human Services	2	9/9/2026	19:00
Teri Gilbert-Eisenga	Emergency Response Providers	Washoe Tribe	Executive Director of Tribal Health Center	2	9/9/2026	19:00
Cathy Young	Emergency Response Providers	Mono County Health and Human Services	Supervising Staff Analyst	2	9/9/2026	19:00
Bri Chappell-McGovern	Emergency Response Providers	Mono County Public Health	Emergency Preparedness Coordinator	2	9/9/2026	19:00
William Wood	Emergency Response Providers	Rolling Start Inc. ILC	Integrated Programs Manager	2	9/9/2026	19:00
Jarrett Chytka	Emergency Response Providers	Eastern Sierra Transit Authority	Transportation Contact	2	9/9/2026	19:00
David Griffith	Emergency Response Providers	Alpine County	Alpine County Supervisor	2	9/9/2026	19:00
Bill Roderick	Emergency Response Providers	Alpine County Unified School District	Superintendent	2	9/9/2026	19:00
Sam Booth	Emergency Response Providers	Alpine County	County Executive Officer	2	9/9/2026	19:00
JT Chevaliar	Emergency Response Providers	Alpine County	PIO, Economic Development Director	2	9/9/2026	19:00
John Peters	Emergency Response Providers	Mono County	Mono County Supervisor	2	9/9/2026	19:00
Shane Gleason	Emergency Response Providers	Eastern Sierra Unified School District	Facilities Director	2	9/9/2026	19:00

Valerie Spake	Emergency Response Providers	Senator Alvarado-Gil's Office	District Representative	2	9/9/2026	19:01
Ian Coolbear	Emergency Response Providers	Assemblymember Tangipa's Office	Chief of Staff	2	9/9/2026	19:01
Erik Brahms	Emergency Response Providers	Senator Dahle's Office	Chief of Staff	2	9/9/2026	19:02
N/A	Emergency Response Providers	Mono Medical Health Operational Area Coordinator	Duty Supervisor	2	9/9/2026	19:04
Sandra Moberly	Emergency Response Providers	Mono County	County Administrative Officer	2	9/9/2026	19:13
Hardy Bullock	Emergency Response Providers	Nevada County Supervisor	Nevada County Supervisor	2	9/9/2026	19:15
Lila Heuer	Emergency Response Providers	Sierra County Supervisor	Sierra County Supervisor	2	9/9/2026	19:15
Ken Quiner	Emergency Response Providers	Washoe Tribe	Tribal Emergency Manager	2	9/9/2026	19:15
CPUC	CPUC	CPUC	N/A		9/9/2026	20:07
CalOES	CalOES	CalOES	N/A		9/10/2026	6:55
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/10/2026	8:00
JT Chevallier	Emergency Response Providers	Alpine County	Public Information Officer	2	9/10/2026	8:15
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/10/2026	9:00
Rob Etnyre	Emergency Response Providers	Truckee Tahoe Airport	General Manager	2	9/10/2026	9:30
CPUC	CPUC	CPUC	N/A		9/10/2026	9:40
Lindsay Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/10/2026	9:45
Greg Almos	Emergency Response Providers	El Dorado County OES	Emergency Services Coordinator	2	9/10/2026	10:00
Bri Chappell-McGovern	Emergency Response Providers	Mono County Public Health	Emergency Preparedness Coordinator	2	9/10/2026	10:30
Jarrett Chytka	Emergency Response Providers	Eastern Sierra Transit Authority	Transportation Contact	2	9/10/2026	10:40
Yinnon Hiller	Emergency Response Providers	FREED ILC	Emergency Preparedness Coordinator	2	9/10/2026	11:00
David Atkinson	Emergency Response Providers	Placer County OES	Assistant Director, OES	2	9/10/2026	11:15
Magdalene DeBerg	Emergency Response Providers	Senior Citizens of Sierra County	Executive Director	2	9/10/2026	11:30
Cory Baird	Emergency Response Providers	Washoe Tribe	Tribal Health Center Staff	2	9/10/2026	11:40
Greg Almos	Emergency Response Providers	El Dorado County OES	Emergency Services Coordinator	2	9/10/2026	11:45
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/10/2026	12:50
James Zandastra	Emergency Response Providers	US Congressman Kiley's Office	Legislative Director	2	9/10/2026	13:17
Trent Green	Emergency Response Providers	Alpine County OES	Emergency Services Coordinator	2	9/10/2026	14:30
CalOES	CalOES	CalOES	N/A		9/10/2026	14:57
CalOES / CPUC	CalOES / Commission	CalOES / CPUC	Group		9/10/2026	16:00
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/10/2026	16:00
Greg Almos	Emergency Response Providers	El Dorado County OES	Emergency Services Coordinator	2	9/10/2026	17:15
Andrew Nickens	Emergency Response Providers	Assemblymember Hadwick's Office	Legislative Assistant	2	9/10/2026	18:12
Valerie Spake	Emergency Response Providers	Senator Alvarado-Gil's Office	District Representative	2	9/10/2026	18:15
Ian Coolbear	Emergency Response Providers	Assemblymember Tangipa's Office	Chief of Staff	2	9/10/2026	18:18
Erik Brahms	Emergency Response Providers	Senator Dahle's Office	Chief of Staff	2	9/10/2026	18:20

James Zandastra	Emergency Response Providers	US Congressman Kiley's Office	Legislative Director	2	9/10/2026	18:22
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/10/2026	18:24
Jamie Shilz, Lori McGee	Emergency Response Providers	Sierra County Health and Human Services	Social Services Manager, Interim Director of Social Services	2	9/10/2026	18:24
Erin Dobyns	Emergency Response Providers	Alpine County Health and Human Services	Deputy Director of Health and Human Services	2	9/10/2026	18:35
Teri Gilbert-Eisenga, Cory Baird	Emergency Response Providers	Washoe Tribe	Executive Director of Tribal Health Center, Tribal Health Center Staff	2	9/10/2026	18:35
Cathy Young	Emergency Response Providers	Mono County Health and Human Services	Supervising Staff Analyst	2	9/10/2026	18:35
Bri Chappell-McGovern	Emergency Response Providers	Mono County Public Health	Emergency Preparedness Coordinator	2	9/10/2026	18:35
William Wood	Emergency Response Providers	Rolling Start Inc. ILC	Integrated Programs Manager	2	9/10/2026	18:35
Jarrett Chytka	Emergency Response Providers	Eastern Sierra Transit Authority	Transportation Contact	2	9/10/2026	18:35
N/A	Emergency Response Providers	Mono Medical Health Operational Area Coordinator	Duty Supervisor	2	9/10/2026	18:35
Yinnon Hiller	Emergency Response Providers	FREED ILC	Emergency Preparedness Coordinator	2	9/10/2026	18:35
David Griffith	Emergency Response Providers	Alpine County	Alpine County Supervisor	2	9/10/2026	20:35
Ethan Gray	Emergency Response Providers	Alpine County	Deputy Director Community Development	2	9/10/2026	20:35
JT Chevalier	Emergency Response Providers	Alpine County	Alpine County PIO	2	9/10/2026	20:35
Paul Washam	Emergency Response Providers	Eastern Alpine Fire and Rescue	EMS/Fire Administrator	2	9/10/2026	20:35
Rick Johnson	Emergency Response Providers	Alpine County	HHS	2	9/10/2026	20:35
Sam Booth	Emergency Response Providers	Alpine County	Alpine County Executive Officer	2	9/10/2026	20:35
Bill Roderick	Emergency Response Providers	Alpine County School District	Interim Superintendent	2	9/10/2026	20:35
Eric Forsman	Emergency Response Providers	Alpine County School District	Superintendent of Schools	2	9/10/2026	20:35
Taylor Green	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/10/2026	20:35
Tom Minder	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/10/2026	20:35
Heidi Torix	Emergency Response Providers	Eastern Sierra Unified School District	Superintendent	2	9/10/2026	20:35
Shane Gleason	Emergency Response Providers	Eastern Sierra Unified School District	Director of Facilities & Maintenance	2	9/10/2026	20:35
Alex Keeble-Toll	Emergency Response Providers	Nevada County	Office of Emergency Services	2	9/10/2026	20:35
John Peters	Emergency Response Providers	Mono County	Mono County Supervisor	2	9/10/2026	20:35
Sandra Moberly	Emergency Response Providers	Mono County	Mono County Administrative Officer	2	9/10/2026	20:35
Hardy Bullock	Emergency Response Providers	Nevada County Supervisor	Nevada County Supervisor	2	9/10/2026	20:35

Harvey Bullock	Emergency Response Providers	Nevada County Supervisor	Nevada County Supervisor	2	9/10/2026	20:35
Lila Heuer	Emergency Response Providers	Sierra County Supervisor	Sierra County Supervisor	2	9/10/2026	20:35
Geoff Ellis	Emergency Response Providers	Washoe Tribe	Woodfords Community Council Chairman	2	9/10/2026	20:35
Steven Cruz	Emergency Response Providers	Washoe Tribe	Washoe Tribal Council Representative	2	9/10/2026	20:35
Ken Quiner	Emergency Response Providers	Washoe Tribe	Emergency Manager	2	9/10/2026	20:35
Angela Slais	Emergency Response Providers	Alpine County	HHS Director	2	9/10/2026	20:35
CalOES	CalOES	CalOES	N/A		9/11/2026	6:55
Alex Hoon	Emergency Response Providers	NV Energy	Principal Meteorologist	2	9/11/2026	7:20
Joe Walton, Jed Gaines, Tim Richter, Arnold Ramirez	CAL FIRE	CAL FIRE	LMU Division Chief, AEU Division Chief, NEU Division Chief, BDU Division Chief	2	9/11/2026	9:00
CPUC	CPUC	CPUC	N/A		9/11/2026	9:06
Lindsey Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/11/2026	9:30
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/11/2026	9:45
Cathy Young	Emergency Response Providers	Mono County Health and Human Services	Supervising Staff Analyst	2	9/11/2026	10:00
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/11/2026	10:15
Lindsey Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/11/2026	10:40
David Atkinson	Emergency Response Providers	Placer County OES	Assistant Director, OES	2	9/11/2026	11:00
Lindsey Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/11/2026	11:45
Isaac Walden	Emergency Response Providers	US Forest Service	Division Chief	2	9/11/2026	12:15
Group	Emergency Response Providers	NV Energy	Tactical Coordination	2	9/11/2026	13:30
CalOES	CalOES	CalOES	N/A		9/11/2026	14:14
Lindsey Bartlett	Emergency Response Providers	NV Energy	Sr. Emergency Management Administrator	2	9/11/2026	15:00
CPUC	CPUC	CPUC	N/A		9/11/2026	15:59
John Gulserian	Emergency Response Providers	Nevada County	Emergency Services Officer	2	9/11/2026	15:59
Steven Poncelet	Emergency Response Providers	Truckee Donner PUD	Public Information Officer	2	9/11/2026	15:59
Mike Fisher	Emergency Response Providers	Sierra County	OES Director	2	9/11/2026	15:59
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/11/2026	15:59
Lori McGee	Emergency Response Providers	Sierra County Health and Human Services	Interim Director of Social Services	2	9/11/2026	15:59
Terry Hughes	Emergency Response Providers	Alpine County	Fire Chief	2	9/11/2026	15:59
Ken Quiner	Emergency Response Providers	Washoe Tribe	Emergency Manager	2	9/11/2026	15:59
Tim Streeper	Emergency Response Providers	Alpine County	Emergency Preparedness	2	9/11/2026	15:59
Paul Washam	Emergency Response Providers	Alpine County	Sheriff	2	9/11/2026	15:59
Angela Slais	Emergency Response Providers	Alpine County	HHS Deputy Director	2	9/11/2026	15:59
John Baker	Emergency Response Providers	Alpine County	Fire Chief	2	9/11/2026	15:59
N/A	CalOES / Commission	CalOES / CPUC	Group	2	9/11/2026	16:00
Lori Pini	Emergency Response Providers	Plumas County OES	Emergency Manager	2	9/11/2026	16:40
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/11/2026	17:03

Jamie Shilz, Lori McGee	Emergency Response Providers	Sierra County Health and Human Services	Social Services Manager, Interim Director of Social Services	2	9/11/2026	17:03
Yinnon Hiller	Emergency Response Providers	FREED ILC	Emergency Preparedness Coordinator	2	9/11/2026	17:03
Andrew Nickens	Emergency Response Providers	Assemblymember Hadwick's Office	Legislative Assistant	2	9/11/2026	17:04
Valerie Spake	Emergency Response Providers	Senator Alvarado-Gil's Office	District Representative	2	9/11/2026	17:06
Ian Coolbear	Emergency Response Providers	Assemblymember Tangipa's Office	Chief of Staff	2	9/11/2026	17:07
Erin Dobyns	Emergency Response Providers	Alpine County Health and Human Services	Deputy Director of Health and Human Services	2	9/11/2026	17:08
Teri Gilbert-Eisenga, Cory Baird	Emergency Response Providers	Washoe Tribe	Executive Director of Tribal Health Center, Tribal Health Center Staff	2	9/11/2026	17:08
Erik Brahms	Emergency Response Providers	Senator Dahle's Office	Chief of Staff		9/11/2026	17:09
Cathy Young	Emergency Response Providers	Mono County Health and Human Services	Supervising Staff Analyst	2	9/11/2026	17:10
Bri Chappell-McGovern	Emergency Response Providers	Mono County Public Health	Emergency Preparedness Coordinator	2	9/11/2026	17:10
William Wood	Emergency Response Providers	Rolling Start Inc. ILC	Integrated Programs Manager	2	9/11/2026	17:10
Jarrett Chytka	Emergency Response Providers	Eastern Sierra Transit Authority	Transportation Contact	2	9/11/2026	17:10
N/A	Emergency Response Providers	Mono Medical Health Operational Area Coordinator	Duty Supervisor	2	9/11/2026	17:10
James Zandastra	Emergency Response Providers	US Congressman Kiley's Office	Legislative Director	2	9/11/2026	17:10
David Griffith	Emergency Response Providers	Alpine County	Alpine County Supervisor	2	9/11/2026	17:34
Ethan Gray	Emergency Response Providers	Alpine County	Deputy Director Community Development	2	9/11/2026	17:34
JT Chevalier	Emergency Response Providers	Alpine County	Alpine County PIO	2	9/11/2026	17:34
Paul Washam	Emergency Response Providers	Eastern Alpine Fire and Rescue	EMS/Fire Administrator	2	9/11/2026	17:34
Rick Johnson	Emergency Response Providers	Alpine County	HHS	2	9/11/2026	17:34
Sam Booth	Emergency Response Providers	Alpine County	Alpine County Executive Officer	2	9/11/2026	17:34
Bill Roderick	Emergency Response Providers	Alpine County School District	Interim Superintendent	2	9/11/2026	17:34
Eric Forsman	Emergency Response Providers	Alpine County School District	Superintendent of Schools	2	9/11/2026	17:34
Taylor Green	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/11/2026	17:34
Tom Minder	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/11/2026	17:34
Heidi Torix	Emergency Response Providers	Eastern Sierra Unified School District	Superintendent	2	9/11/2026	17:34
Shane Gleason	Emergency Response Providers	Eastern Sierra Unified School District	Director of Facilities & Maintenance	2	9/11/2026	17:34
Alex Keeble-Toll	Emergency Response Providers	Nevada County	Office of Emergency Services	2	9/11/2026	17:34

John Peters	Emergency Response Providers	Mono County	Mono County Supervisor	2	9/11/2026	17:34
Sandra Moberly	Emergency Response Providers	Mono County	Mono County Administrative Officer	2	9/11/2026	17:34
Hardy Bullock	Emergency Response Providers	Nevada County	Nevada County Supervisor	2	9/11/2026	17:34
Lila Heuer	Emergency Response Providers	Sierra County	Sierra County Supervisor	2	9/11/2026	17:34
Geoff Ellis	Emergency Response Providers	Washoe Tribe	Woodfords Community Council Chairman	2	9/11/2026	17:34
Steven Cruz	Emergency Response Providers	Washoe Tribe	Washoe Tribal Council Representative	2	9/11/2026	17:34
Ken Quiner	Emergency Response Providers	Washoe Tribe	Emergency Manager	2	9/11/2026	17:34
Angela Slais	Emergency Response Providers	Alpine County	HHS Director	2	9/11/2026	17:34
CalOES	CalOES	CalOES	N/A		9/12/2026	7:00
CPUC	CPUC	CPUC	N/A		9/12/2026	7:38
Andrew Nickens	Emergency Response Providers	Assemblymember Hadwick's Office	Legislative Assistant	2	9/12/2026	7:38
Valerie Spake	Emergency Response Providers	Senator Alvarado-Gil's Office	District Representative	2	9/12/2026	7:39
John Gulserian	Emergency Response Providers	Nevada County	Emergency Services Officer	2	9/12/2026	7:39
Steven Poncelet	Emergency Response Providers	Truckee Donner PUD	Public Information Officer	2	9/12/2026	7:39
Mike Fisher	Emergency Response Providers	Sierra County	OES Director	2	9/12/2026	7:39
LeTina Vanetti	Emergency Response Providers	Sierra County OES	Emergency Services Coordinator	2	9/12/2026	7:39
Lori McGee	Emergency Response Providers	Sierra County Health and Human Services	Interim Director of Social Services	2	9/12/2026	7:39
Terry Hughes	Emergency Response Providers	Alpine County	Fire Chief	2	9/12/2026	7:39
Ken Quiner	Emergency Response Providers	Washoe Tribe	Emergency Manager	2	9/12/2026	7:39
Tim Streeper	Emergency Response Providers	Alpine County	Emergency Preparedness	2	9/12/2026	7:39
Paul Washam	Emergency Response Providers	Alpine County	Sheriff	2	9/12/2026	7:39
Angela Slais	Emergency Response Providers	Alpine County	HHS Deputy Director	2	9/12/2026	7:39
John Baker	Emergency Response Providers	Alpine County	Fire Chief	2	9/12/2026	7:39
Ian Coolbear	Emergency Response Providers	Assemblymember Tangipa's Office	Chief of Staff	2	9/12/2026	7:40
Erik Brahms	Emergency Response Providers	Senator Dahle's Office	Chief of Staff	2	9/12/2026	7:41
James Zandastra	Emergency Response Providers	US Congressman Kiley's Office	Legislative Director	2	9/12/2026	7:42
Rich Nalder	Emergency Response Providers	Mono County	Alpine Valley Fire Chief	2	9/12/2026	7:58
Bryan Bullock	Emergency Response Providers	Mono County	EMS Chief	2	9/12/2026	7:58
Ingrid Braun	Emergency Response Providers	Mono County	Sheriff	2	9/12/2026	7:58
David Griffith	Emergency Response Providers	Alpine County	Alpine County Supervisor	2	9/12/2026	7:39
Ethan Gray	Emergency Response Providers	Alpine County	Deputy Director Community Development	2	9/12/2026	7:39
JT Chevalier	Emergency Response Providers	Alpine County	Alpine County PIO	2	9/12/2026	7:39
Paul Washam	Emergency Response Providers	Eastern Alpine Fire and Rescue	EMS/Fire Administrator	2	9/12/2026	7:39

Rick Johnson	Emergency Response Providers	Alpine County	HHS	2	9/12/2026	7:39
Sam Booth	Emergency Response Providers	Alpine County	Alpine County Executive Officer	2	9/12/2026	7:39
Bill Roderick	Emergency Response Providers	Alpine County School District	Interim Superintendent	2	9/12/2026	7:39
Eric Forsman	Emergency Response Providers	Alpine County School District	Superintendent of Schools	2	9/12/2026	7:39
Taylor Green	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/12/2026	7:39
Tom Minder	Emergency Response Providers	Alpine County	Sheriff-Coroner	2	9/12/2026	7:39
Heidi Torix	Emergency Response Providers	Eastern Sierra Unified School District	Superintendent	2	9/12/2026	7:39
Shane Gleason	Emergency Response Providers	Eastern Sierra Unified School District	Director of Facilities & Maintenance	2	9/12/2026	7:39
John Peters	Emergency Response Providers	Mono County	Mono County Supervisor	2	9/12/2026	7:39
Sandra Moberly	Emergency Response Providers	Mono County	Mono County Administrative Officer	2	9/12/2026	7:39
Geoff Ellis	Emergency Response Providers	Washoe Tribe	Woodfords Community Council Chairman	2	9/12/2026	7:39
Steven Cruz	Emergency Response Providers	Washoe Tribe	Washoe Tribal Council Representative	2	9/12/2026	7:39
Ken Quiner	Emergency Response Providers	Washoe Tribe	Emergency Manager	2	9/12/2026	7:39
Angela Slais	Emergency Response Providers	Alpine County	HHS Director	2	9/12/2026	7:39
Cathy Young	Emergency Response Providers	Mono County Health and Human Services	Supervising Staff Analyst	2	9/12/2026	8:22
Bri Chappell-McGovern	Emergency Response Providers	Mono County Public Health	Emergency Preparedness Coordinator	2	9/12/2026	8:22
William Wood	Emergency Response Providers	Rolling Start Inc. ILC	Integrated Programs Manager	2	9/12/2026	8:22
Jarrett Chytka	Emergency Response Providers	Eastern Sierra Transit Authority	Transportation Contact	2	9/12/2026	8:22
N/A	Emergency Response Providers	Mono Medical Health Operational Area Coordinator	Duty Supervisor	2	9/12/2026	8:22
Erin Dobyns	Emergency Response Providers	Alpine County Health and Human Services	Deputy Director of Health and Human Services	2	9/12/2026	8:24
Teri Gilbert-Eisenga, Cory Baird	Emergency Response Providers	Washoe Tribe	Executive Director of Tribal Health Center, Tribal Health Center Staff	2	9/12/2026	8:24

18 Appendix E - PSPS Event Data Workbook (Excel File)

Available at:

<https://california.libertyutilities.com/uploads/Liberty%20September%2012,%202026%20Potential%20Post%20Event%20Report%20Tables.xlsx>